## **City Clerk**

From: Shelby County Highway <shelbycohwy@consolidated.net>

Sent: Thursday, February 27, 2020 2:12 PM

To: City Clerk

Cc:Water CommissionerSubject:Re: Streetscape

Attachments: PL-95864-150 plans streetscape.pdf; 95864-150 bid specifications streetscape.pdf; water

service line specifications - streetscape.pdf

ok – see attached bid documents – including plans, specifications and water service line specifications that the contractor must follow.

Please forward to David and whoever else wants to see them.

On page 3 of the Plans (attached) -- We have two pay items related to the replacement of water service lines that are included in the specifications:

56200200 — Water Service Line 3/4" 56200300 - Water Service Line 1"

The contract has been awarded but has not been executed so a pre job meeting has not been scheduled.

alan

From: City Clerk

Sent: Thursday, February 27, 2020 1:32 PM

**To:** Shelby County Highway **Cc:** Water Commissioner **Subject:** Streetscape

Alan,

David Walbright would like to be involved in the preconstruction meeting for Streetscape. He would also like to see a copy of the bid specs to review the utility portion, including the replacement of any lead pipes that will be exposed.

Thank you,

Rachel IDallace

City Clerk City of Shelbyville 217/774-5531

cityclerk@shelbyvilleil.net

PLANS PREPARED BY: SHELBYVILLE ILLINOIS 62565 217-820-2278 SHELBY ENGINEERING 1010 E. NORTHLAND DR. JULLE.
JOINT UTILITY LOCATION INFORMATION FOR EXCAVATION
1-000-052-0123 SEE SHEET 2 OF 44 SHEETS SEE SHEET 2 OF 44 LIST OF STANDARDS INDEX OF SHEETS 01-17-2020 LETTING ITEM 150 STA 1050 + 71.69 BEGIN PROJECT CONTRACT NUMBER 95864 SHEETS STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION
PLANS FOR PROPOSED PART NEWSTRAN CITY OF SHELBYVILLE SECTION 13-00055-00-SW SHELBY COUNTY JOB NUMBER C-97-007-19 PROJECT NO. TU34(077) 8 4 E 3rd S. ALAN SPESSHO LICENSED PROFESSIONAL ENGINEER OF IL NUMBER 062-062965 EXPIRATION DATE 11-30-2019 PLANS PREPARED BY: 762.31 foot = PROJECT LENGTH STA 1058 + 34.00END PROJECT 0.144 miles 29-14-2819 APPROVED Noy 18 LOCATION OF SECTION INDICATED TRUS:- -PASSED Nov STATE OF ILLINOIS DEPARTMENT OF TRANSPORTATION REGION FOUR ENGINEE DISTRICT SEVEN ENGINEER OF LOCAL ROAD AND STREETS sapuel CITY OF SHELBYVILLE \*\* WAIN STREET IL NT 16 CONTRACT NO. 95864

## LIST OF STANDARDS

## NDEX OF SHEETS

34-39.	30-33.	28	26,	24-27.	21-23.	18-20.	15-17.	7-14,	p.	ça	Ş A	ы	<del>, 1</del>	SHEEL NO.
TRAFFIC SIGNAL MODIFICATIONS	STORM SEWER PLANS	HANDRAIL DETAIL	ISOMETRIC RAMP DETAILS	CURB RAMP ELEVATIONS	SIDEWALK GRADING PLANS	ROADWAY PLANS	DEMOLITION PLANS	MISCELLANEOUS DETAILS, SCHEDULES	ALIGNMENT, TIES AND BENCHMARKS	TYPICAL CROSS SECTIONS	SUMMARY OF QUANTITIES	GENERAL NOTES, INDEX OF STANDARDS, INDEX OF SHEETS	COVERSHEET	DESCRIPTION

4044

LIGHTING PLANS

## GENERAL NOTES

all elevations shown on the plans are based on an assumed datum.

BEFORE ORDERING ANY STORM SEWERS, MANHOLES, INLETS, AND PIPE DRAIN, ETC. SHALL CONSULT THE ENGINEER FOR THE EXACT LENGTHS.

THE ACTUAL LOCATION OF ALL SIGNAL FOUNDATIONS, HANDHOLES AND GULFBOXES WILL BE DETERMINED IN THE FIELD BY THE ENGINEER, NOTES WITHIN THE FLANS ARE INTENDED FOR GUIDANCE ONLY.

THESE PLANS WERE ESTABLISHED TO MEET THE CURRENT ADA POLICY IN PROVINING AN ACCESSIBLE ROUTE THROUGHOUT THE PROJECT PAREA. THE CONTRACTION SALL BE RANAGE THE PROPOSED ELEVATION ARE PROVIDED FOR GUIDANCE AND SHOULD THE PROPOSED ELEVATION RESULT IN A CROSS SLOPE GREATER THAN 2%, THE CONTRACTOR SHALL COORDINATE WITH THE ENGINEER TO FORMULATE A SOUTHON, IT SPHOULD ALSO BE FOTED THERE ARE NUMBER TO FORMULATE A SOUTHON, IT SPHOULD ALSO BE FOTED THERE ARE, NUMBER TO FABLE AND WHERE THE FIRRST 3.39 TO 5.33Y OF SIDEWALK, BEHIND THE BACK OF CURB, MAS A KINDE GRAFTER THAN 2%, THESE AREAS ARE NOT INTENDED FOR PEDESTRIAN TRACHLE, HOWEVER THE REDAINING PORTION OF SIDEWALK HAS A CROSS SLOPE LESS THAN 2%.

3. POWER E CABLE TV AMBREK CIPS ["] [""] MATTOON, ILLINOIS 91938

1. GAG

UTITUTES;

1, TELEPHONE THE ONLY UTILITIES

LONGOLIDATED CDIMUNICATIONS (\*\*) (\*\*\*)
123 SOUTH STREET
LATTOON, HLINOIS 61888
217-217-8228

AMERCA CIPS (\*\*) 4264 2400 BAST ROAD FANA, ICLINOIS 42267 217-273-0800 CITY OF SHELEVYILLE GLINDIS (") (") 151 IOUTH MORDAN STREET SHELDYNELE, BLEVOIS 67312 217-774-6731

THE STATE OF SHELD VALLE STRING'S [T] (T)

AND STATE STRING STRING'S CORRES

217-774-013 NEW--WAVE COMMUNACATIONS (\*\*) (\*\*\*) | MONTOUMENT PLAZA 4<sup>ES</sup> FLOOR | MEXTON MD 48001

(\*\*) JULLE, MEMBER
(\*\*) RELOGATION DURING CONSTRUCTION
(\*\*) RELOGATION DURING CONSTRUCTION
(\*\*) JULLE, MEMBER
(\*\*) JULLE, MEMBE

mast 1275/17 Arrioreran SAS SELTIO /V 13-00055-00-5W CITY OF SHELBY VILLE GENERAL MOTES NEWWO KPP

A Specialty Thans

SECTION: 13-00055-00-SEE

SUMMARY OF QUANTITIES

			200,000	
	FACH	MANUSCHES TYPE A STRUMETED TYPE 1 FRAME OPEN LID	DOZEGONE	
u	EACH	60221200 MANHOLES, TYPE A, 5'-DIAMETER, TYPE 3 FRAME AND GRATE	60221200	
N	EACH	SGEROUS DOMESTIC METER VAULTS TO BE ADJUSTED	-	D
2	EACH	FIRE HYDRANTS TO BE MOVED	56400100	V
10	F00T	56200300 WATER SERVICE LINE T"		D
30	FODT	SEZODZOO WATER SERVICE LINE W.		D
3	EACH	55709210 WATER VALVES TO BE ADJUSTED		Þ
115	FOOT	STORM SEWERS, CLASS A, TYPE 1 27"	560A@130	
268	FOOT	SSIABOSO STORM SEWERS, CLASS A, TYPE 1 18"	550A8090	
280	1001	STORM SEWERS, CLASS A, TYPE 1 15"	550A0070	
108.7	FOOT	50901760 PIPE HANDRAIL	50901760	D
512	POUND	REINFORCEMENT BARS, EPOXY COATED	50800205	
38	OY DE	CLASS C PATCHES, TYPE IV, 19 INCH	44201457	
20	SOYD	GLASS G PATCHES, TYPE III, 19 INCH	44201455	
26	SOYD	44201463 CLASS C PATCHES, TYPE II, 19 INCH	44201453	
16868	SQFT	SIDEWALK REMOVAL	44000600	
784	FOOT	COMBINATION CURB AND GUTTER REMOVAL	44000500	
334	SQYD	44000200 DRIVENYAY PAYEMENT REMOVAL	44000200	
939	SQYD	44000100 PAVEMENT REMOVAL	44000100	
22.55	1405	DETECTABLE WARNINGS	42400800	
15232	SOFT	42400200 PORTLAND CEMENT CONCRETE SIDEWALK & INCH	42400200	
374	ax bs	42300200 PORTLAND CEMENT CONCRETE DRIVEWAY PAYEMENT, 6 INCH	42300200	
179	SQ YD	42000680 PORTLAND CEMENT CONCRETE PAVEMENT 18"	42000680	
13	EACH	INLET AND PIPE PROTECTION	25000500	
6	UNIT	25200200 SUPPLEMENTAL WATERING	25200200	
39	SQYO	25200110 SODDING, SALT TOLERANT	26200110	
В	POUND	25000600   POTASSIUM FERTILIZER NUTRIENT	25000500	
æ	POUND	PHOSPHORUS FERTILIZER NUTRIENT	25000500	
87	POUND	25000400 NTROGEN FERTILIZER NUTRIENT	25000400	
100	FOOT	21301084 EXPLORATION TRENCH 84" DEPTH	21301084	
209	sa yo	21101685 TOPSOIL FURNISH AND PLACE, 24"	21101685	
535	CUYD	TRENCH BACKFILL	20800150	
QUANTITY	TINU	ЖЕЛ	EM #	
TOTAL				

SUMMARY OF QUANTITIES

SEZZANO (MAAHOLES, TYPE A, E-OLAMETER, TYPE 3 FRAME AND GRAYE. EXCH. 3
GESSTON INLETS, TYPE A, TYPE 3 FRAME AND GRAYE. EACH. 3

SOZESTED MANHOLES TO BE ADJUSTED WITH NEW TYPE I FRAME, OPEN LID EACH


85000200 MAINTENANCE OF EXISTING TRAFFIC SIGNAL INSTALLATION EACH 84200804 IREMOVAL OF POLE FOUNDATION 81702420 ELECTRIC CABLE IN CONDUIT, 600V (XLP-TYPE USE) 3-4/C NO. 8 FOOT X8140115 HANDHOLE TO BE ADJUSTED 87301800 ELECYRIC CABLE IN CONDUIT, EQUIPMENT GROUNDING 87301515 ELECTRIC CABLE IN CONDUIT, LEAD-IN, NO. 18 3 PAIR. 87301225 ELECTRIC CABLE IN CONDUIT, SIGNAL NO. 14 3C 84400105 | RELOCATE EXISTING LIGHTING UNIT 82500000 LIGHTING CONTROLLER, PEDESTAL MOUNTED, 240VOLT, 804MP BACH X1400013 REMOVAL OF CABLE IN CONDUIT 88602300 | REMOVE EXISTING CABLE FROM CONDUIT 97900400 | CONCRETE FOUNDATION, TYPE & 30 INCH DIAMETER 87800100 | CONCRETE FOUNDATION, TYPE A S7501100 PEDESTRIAN PUSH-BUTTON POST, GALVANIZED STEEL, TYPE 1 RACH X0327142 | LIGHTING STANDARD, TYPE 48 28502385 REMOVE EXISTING CONCRETE FOUNDATION
X0100010 SPECIAL WASTE PLANS AND REPORTS (SPECIAL) 99500200 RELOCATE EXISTING PEDESTRIAN SIGNAL HEAD 89500100 RELOCATE EXISTING SIGNAL HEAD 17351255 ELECTRIC CABLE IN CONDUIT, SIGNAL NO. 14 70 97301245 ELECTRIC CABLEIN CONDUIT, SIGNAL NO. 14 SC 9502380 REMOVE EXISTING HANDHOLE 19502375 REMOVE EXISTING TRAFFIC SIGNAL EQUIPMENT 7900100 | DRILL EXISTING POUNDATION 7702870 STEEL COMBINATION MAST ARM AND POLE 28 FT 0200800 AGGREGATE SURFACE COURSE, TYPE B 063980D TREE GRATES 9501150 RELOCATE EXISTING TRAFFIC SIGNAL POST 8800100 PEDESTRIAN PUSH-BUTTON SECTION LOOP, TYPE! 7900200 DRILL EXISTING HANDHOLE 0327141 LIGHTING STANDARD, TYPE 4A 02382 REMOVE EXISTING DOUBLE HANDHOLE 27980 PAVEMENT MARKING REMOVAL-WATER BLAST FOOT FOOT SQFT EACH LSUM EACH EACH EACH g 1007 EACH 11 EACH EACH EACH 13 EACH FOOT 1492 EACH FOOT FOOT 524 842 4158 1,472 1768 12 1301 1092

D


DD D D X8809010 LED SIGNAL FACE RETROFIT, 12" COUNTDOWN TIMER X8580120 LIGHT POLE FOUNDATION, SPECIAL Z0015000 CURB STOPS 1" Z0014900 GURB STOPS 3/4" Z0007120 WELDED WIRE FABRIC BXB XX000219 UNIT PAVERS Z0013798 CONSTRUCTION LAYOUT EACH SQ Y0 2858


A Spacialty

SECTION: 13-00055-00-SW SUMMARY OF QUANTITIES OF SHELBYVILLE

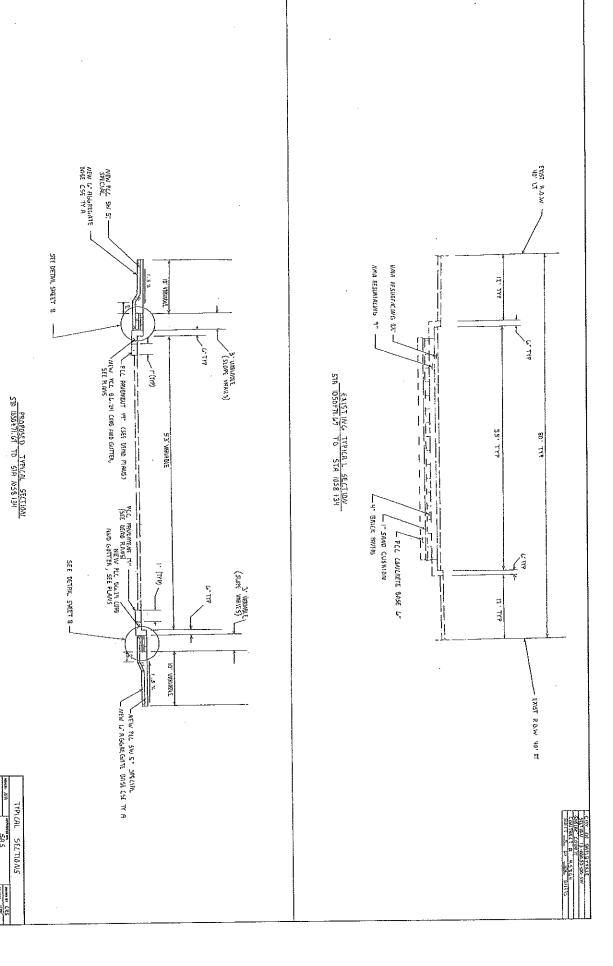


CITY OF SHELBYAILLE

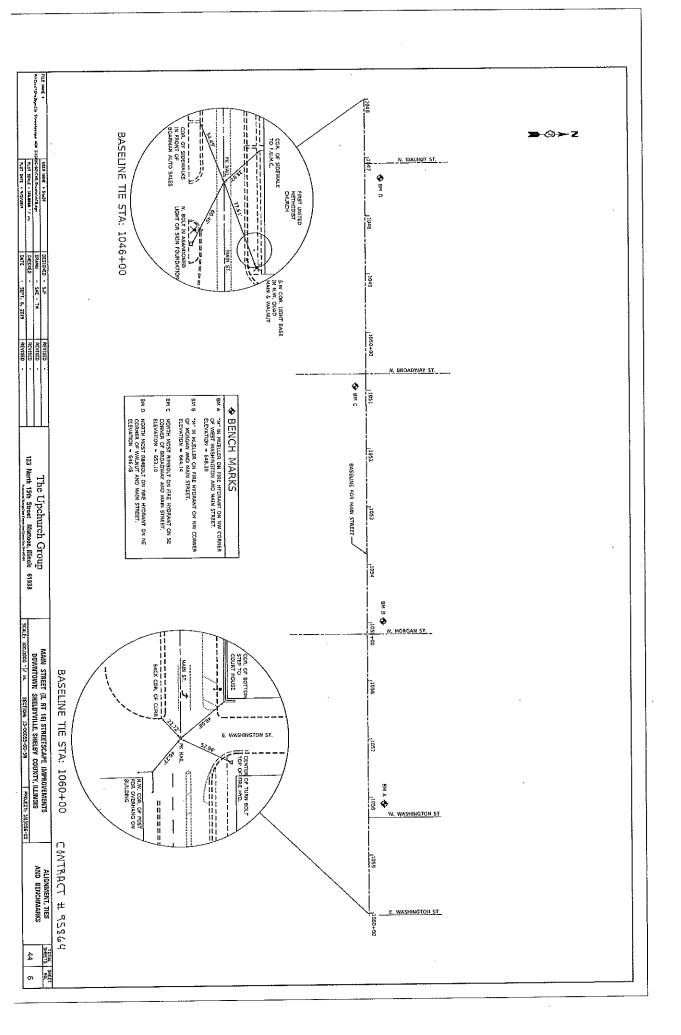



COMBINATION CONCRETE CURE BAVE THE MANS

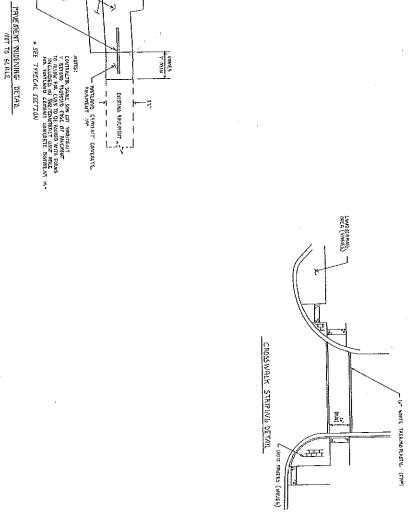

 7a To 57A
 O/S
 QUANTITY

 0070 1052-44
 U
 53.2

 23 TO 1052-32
 U
 53.2

 23 TO 1052-32
 U
 11.6

 23 TO 1054-32
 U
 52.2

 24 TO 1054-32
 U
 59.0

 25 TO 1052-43
 U
 27.1

 26 TO 1052-44
 U
 27.1


 26 TO 1053-45
 U
 12.5

 26 TO 1054-97
 U
 12.5

 26 TO 1054-97
 U
 12.5

 27 TO 1054-97
 U
 12.2


UNIT PAVERS DETAIL

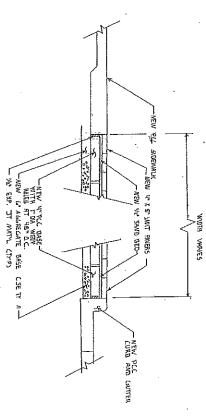


SECTION 13-00055-00-5W CITY OF SHELES VILLE

MISCELLANEOUS DETAILS

MANUEL KPP

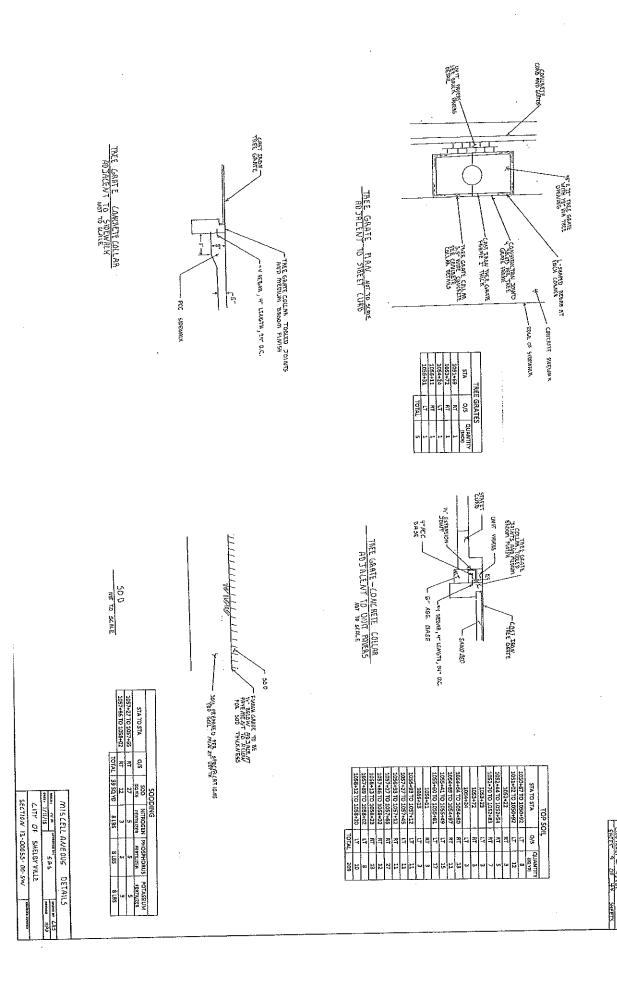

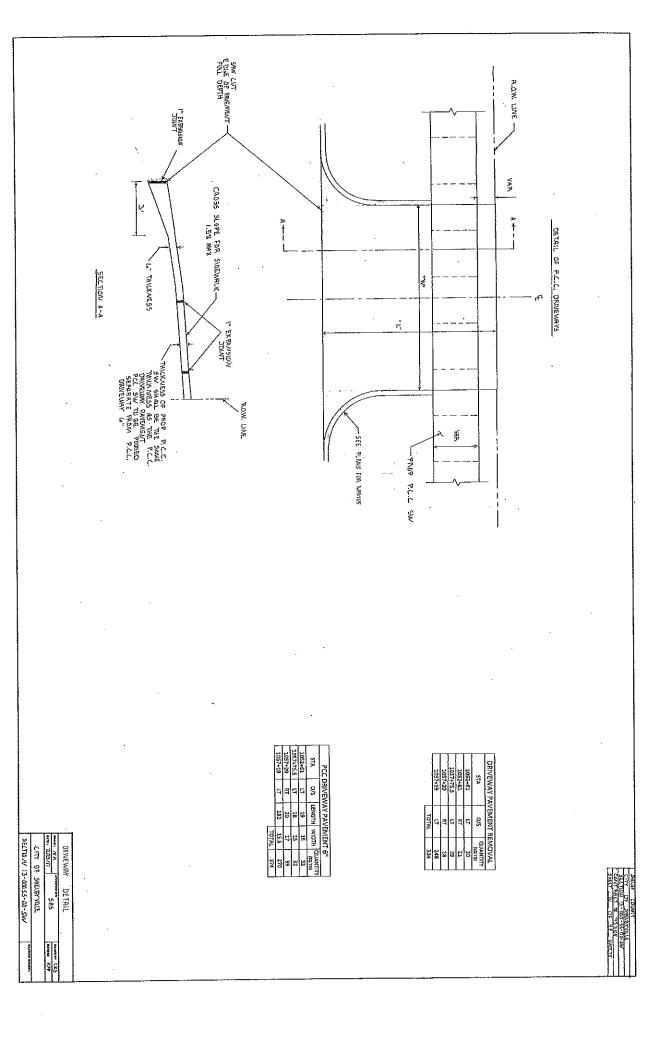

	1057+14	5+39 TO 1058+22	0+86 TO 1054+85	5+39 TO 1058+24	0+88 TO 1055+00	STA TO STA	
TOTAL	ī	2	즉	7	5	0/5	
1787	165	939	458	347	478	QUANTITY	
_	_	_					
•							

	1057+14	1055+39 TO 1058+22	1050+86 TO 1054+85	1055+39 TO 1058+24	1050+88 TO 1055+00	STA TO STA	CURB AND GUTTER 8-6.24	
101	F	2	즉	7	5	0/5	TER B-6	
787	165	339	458	347	178	QUANTITY (FOOT)	5.24	
Т								


					_						
	1057+27 TO 1058+15	1055+43 TO 1057+12	1057+85 TO 1058+22	1057+27 TO 1057+65	1055+50 TO 1057+12	1050+89 TO 1054+91	1052+69 TO 1054+97	1050+90 TO 1052+45	STA TO STA	SIDEWALK 5"	PORTLAND CEMENT CONCRETE
TOTAL	3	3	4	5	5	R	5	5	s/o	×51	TCON
15232	1379	1888	732	499	1954	4403	2526	1851	QUANTITY		CRETE

								_	
	1056+00 TO 1058+20	1056+00 TO 1058+20	1053+00 TO 1056+00	1053+00 TO 1056+00	1050+84 TO 1053+00	1050+84 TO 1053+00	STA TO STA	SIDEWALK REMOVAL	
TOTAL	잒	9	B	5	쥐	5	o/s	EMOVA	l
16868	2519	2657	3257	3394	2753	2293	CUANTITY		

CITY OF SHELBYVILLE SCHEDULES

	1056+00 TO 1058+20	1056+00 TO 1058+20	1053+00 TO 1056+00	1053+00 TO 1056+00	1050+84 TO 1053+00	1050+84 TO 1053+00	STA TO STA	PAVEMENT	
1017	7	H	2	=	2	5	0/\$	REMOVA	l
939	145	172	127	197	132	166	QUANTITY (SQYS)	۴	

Į.	7	J	7
HEET	DATE NO	2000	7
1	7 7	000	T.
F	13164	-55-00-	31,1130
313345		SW.	
-			

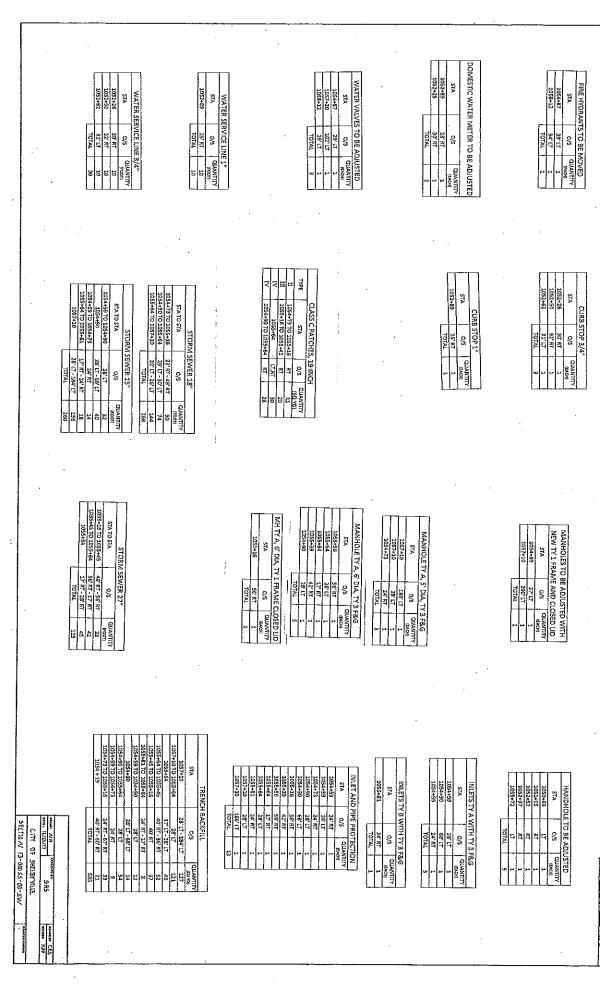

L			
SELTION 13.	CITY DE	LUCL/II : une H/V : sirves	
SELTION 13-00055-00-SW	CITY OF SHELBYVILLE	5A5	
Etymon, sawres		MENTAL KPP	

					NGTON ST	AN ST	ANST	54+75	WAY ST	WAY ST	51+06	
					LT	7.7	17	RT	RT.	4	Ľ	
Date: 1772/17	- A/D				WHITE							
H	b a			TOTAL	STOP BAR							
5AS	The market			131	16	ä	16	31	13	17	24	

		,	100		•		
<b> </b> "	16	STOP BAR	WHITE	<u> </u>	5	MORGANST	
	31	STOP BAR	WHITE	-	RT	STA 1054+75	
Ľ	13	STOP BAR	WHITE		RT	BROADWAYST	
Ľ	17	STOP BAR	HHW	-	7	BROADWAY ST	
Ĺ	24	STOP BAR	SUHAM		נז	STA 1051+06	
ξĒ	YTTUAND	TYPE	COLOR		0/5	LOCATION	
	4	ING LINE 2	NT MARK	VEME	STICPA	THERMOPLASTIC PAVEMENT MARKING LINE 24"	
_	55	TOTAL					
•	285	٢	┞	VELLOW	27	1055+00	
	117	DIAGONAL	L	VELLOW	5	1055+04	
	99	DIAGONAL	L	YELLOW	Ŀ	1056+65 TO 1058+03	
	QUANTITY FOOT	TYPE	_	COLOR	Ş	STA TO STA	

202	TOTAL			
285	DIAGONAL	YELLOW	2	1055+00
117	DIAGONAL	YELLOW	4	1055+04
98	DIAGONAL	YELLOW		056+65 TO 1058+03
QUANTITY	TYPE	COLOR	S,	STA TO STA
12"	KING LINE	EMENT MAR	TIC PAY	THERMOPLASTIC PAVEMENT MARKING LINE 12"

OSTA COLOR TYPE
D 1054+73 YELLOW DOUBLE LINE
2 1058+03 YELLOW DOUBLE LINE
D 1058+03 YELLOW DOUBLE LINE
O 1058+20 WHITE TO PARKING SYMBOL
D 1058+20 WHITE "T" PARKING SYMBOL
TOTAL


	STA 1057+03	STA 1057+03	1056+63 TO 1058+10	1055+63 TO 1058+10	1055+63 TO 1056+63	STA 1056+61	STA 1055+83	STA 1055+83	MORGAN ST	MORGAN ST	MORGAN ST	MORGAN ST	1055+61 TO 1056+61	1055+61 TO 1056+31	STA 1055+61	STA 1055+83	STA 1054+82	STA 1054+78	STA 1054+55	STA 1054+55	STA 1053+49	1054+36 TO 1054+76	1053+49 TO 1054+76	STA 1052+29	STA 1051+27	STA 1051+27	1051+06 TO 1054+79	1051+06 TO 1054+79	1051+06 TO 1052+29	1051+06 TO 1051+46	STA 1051+05	8E+05DT V1S	BROADWAY	BROADWAY	BROADWAY	BROADWAY	LOCATION	PAVEMENT MARKING REMOVAL, WATER
	ij	4	ŀ	7	3	5	9	Ş	꼭	Ą	5	5	댝	5	5	į	5	3	17	RŢ	5	ጓ	RT	5	5	7	<b>P</b> .	9	5	4	ц	1	RT	RT	17	נד	0/5	REMO
TOTAL	4"	12"	12"	4"	4+	LEFT ARROW	LEFT ARROW	RIGHT ARROW	CROSSWALK	STOP BAR	CROSSWALK	STOP BAR	e <sup>i</sup>	61	STOP BAR	CROSSWALK	CROSSWALK	STOP BAR	LEFT ARROW		LEFT ARROW	đ.	φş	LEFT ARROW	RIGHT ARROW	LEFT ARROW	÷	41	6,1	e,	STOP BAR	CROSSWALK	STOP BAR	CROSSWALK	STOP BAR	CROSSWALK	TYPE	
1768	03	36	8	194	66	16	16	16	ន	36	20	25	97	2	8	8	8	72	ĸ	36	16	27	85	16	16	16	122	122	23	27	72	8	32	40	30	30	QUANTITY	BLASTING


1056	1056	2022	1054	1052	W.W	W.V	]_	Γ.	L	Γ		Γ	ĺ	]_	Γ.	L		Ī.				1
1056+10 TO 1055+65	1056+65 TO 1055+65	1054+73 TO 1053+28	1054+73 TO 1053+50	1052+32 TO 1051+06	W WASHINGTON ST	W WASHINGTON ST	STA 1058+11	STA 1058+03	MORGAN ST	MORGAN ST	MORGAN ST	MORGAN ST	STA 1054+87	5TA 1054+79	STA 1051+02	STA 1050+94	BROADWAY ST	BROADWAY ST	BROADWAYST	BROADWAY ST	LOCATION	
ţ	1	ı	į	1	5	F	****	ı	Ę	5	7	3	ı	1		-	5	4	쟉	RT	o/s	
WHITE	WHITE	31HW	STIKW	THW	TUHW	MHITE	WHITE	THIM	WHITE	WHITE	WHITE	WHITE	WHITE	WHITE	WHITE	WHITE	WHITE	WHITE	WHITE	THW	COLOR	
E	TINE	LINE	LINE	LINE	LINE	UNE	CNE	UNE	LINE	TINE	LINE	LINE	LINE	LINE	LNE	BND	LINE	LINE	LINE	LINE	TYPE	
	Г	П	Г	Г	Г	Γ		Г	-	П			П				~		П	П	ρ	ŀ


_				
	INF	THW	ţ	1056+10 TO 1055+65
	TINE	WHITE		1056+65 TO 1055+65
	LINE	ETHW	1	1054+73 TO 1053+28
	LINE	SUHM	į	1054+73 TO 1053+50
	LINE	THW	1	1052+32 TO 1051+06
	LINE	TUHW	5	W WASHINGTON ST
	UNE	WHITE	Ę	W WASHINGTON ST
	UNE	WHITE	****	STA 1058+11
	UNE	WHITE	i	STA 1058+03
	LINE	MHITE	=	MORGAN ST
	TINE	WHITE	5	MORGAN ST
	LINE	SUHM	23	MORGANST
	LINE	WHITE	3	MORGAN ST
	UNE	WHITE	ı	STA 1054+87
	LINE	31IFW	!	5TA 1054+79
	CNE	STHW	١	STA 1051+02
	SND	STIFFA	ı	STA 1050+94
	LINE	WHITE	5	BROADWAYST
	LINE	WHITE	5	BROADWAYST
	LINE	WHITE	걐	BROADWAYST
	LINE	WHITE	굨	BROADWAYST
	TYPE	COLOR	o/s	LOCATION
	RXING LINE	THERMOPLASTIC PAVEMENT MARKING LINE 6"	STIC PA	THERMOPLA


	1055+00	1035+04	1056+65 TO 1058+03	STA TO STA	I DERIVICELASTIC PAVEMENT MARKING UNE 12"
	2	5		ç	IC PAV
	YELLOW	AETFOM	AELTOM	COLOR	EMENI MA
TOTAL	DIAGONAL	DIAGONAL	DIAGONAL	TYPE	KING LINE
501	285	117	99	QUANTITY	12"


	∄	i	
,	THANE PAVEMENT MARKING - LINE 24		
•	PA		
	Ĭ		
	3		
	A	ļ	
	ŝ		
	G-L		
5	ž		
Y PAGE	24"		
7			






















Editorine saluaves	56LT10 /V 13-00045-00-5W	"
	CITY OF SHELEYVILLE.	
жения ХРР	6. 12.12.177 SA.3	S
BEST PARTIES	WALL WAS TANKED TO BE	ŧ
		г
		1

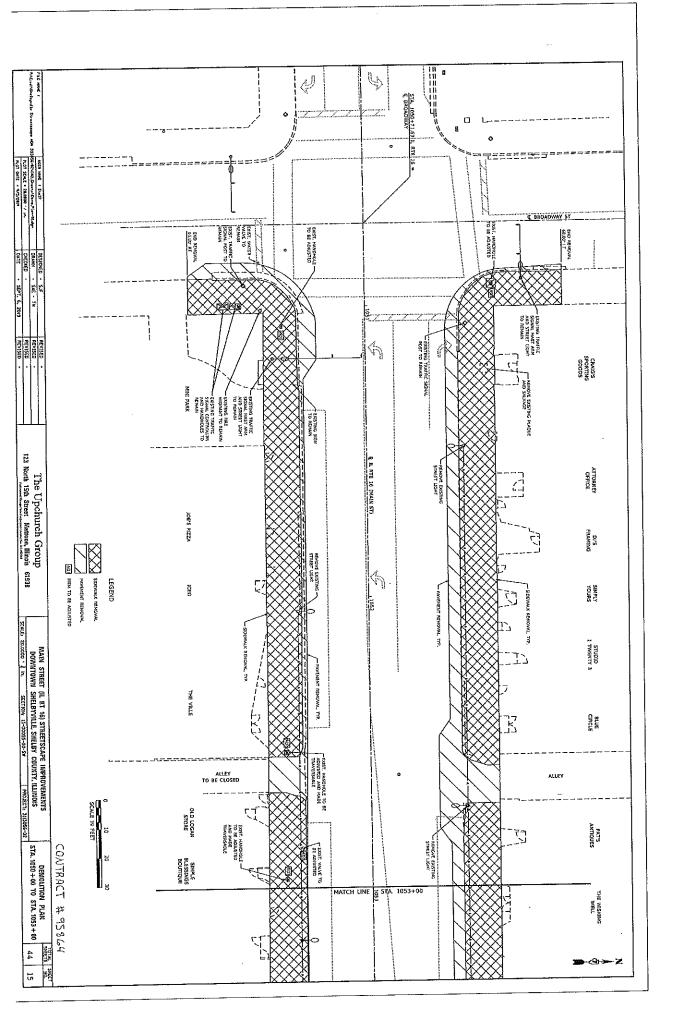


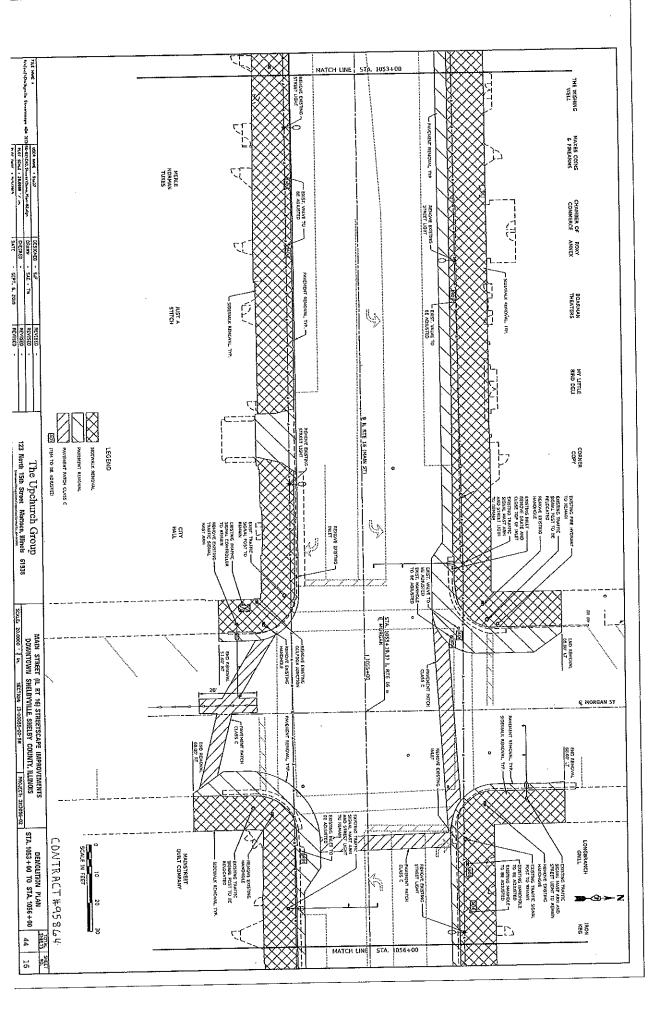


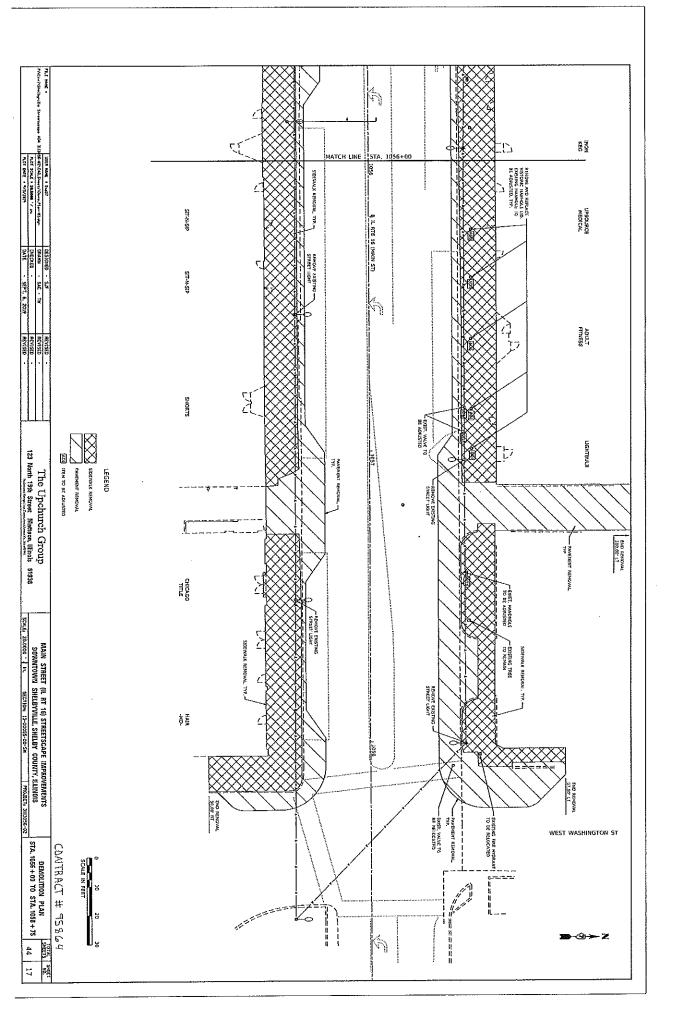


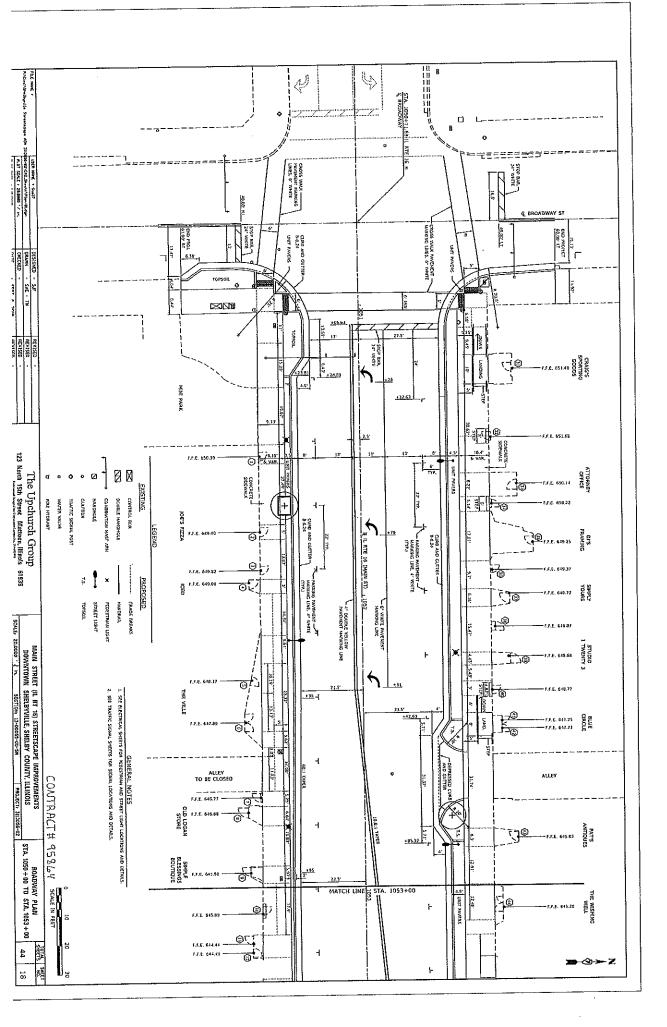


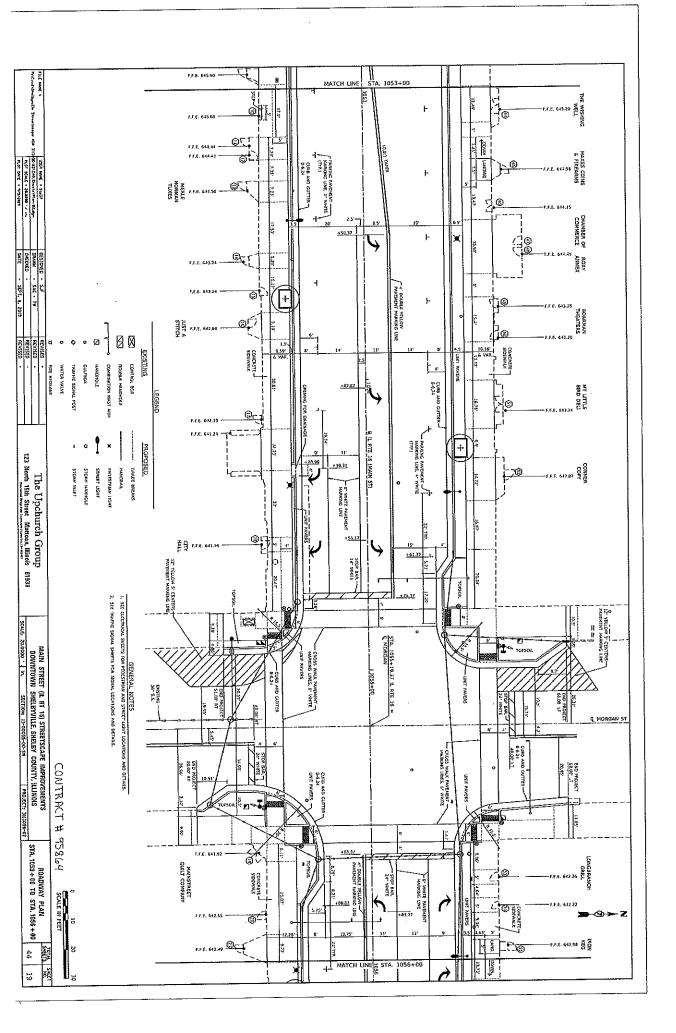


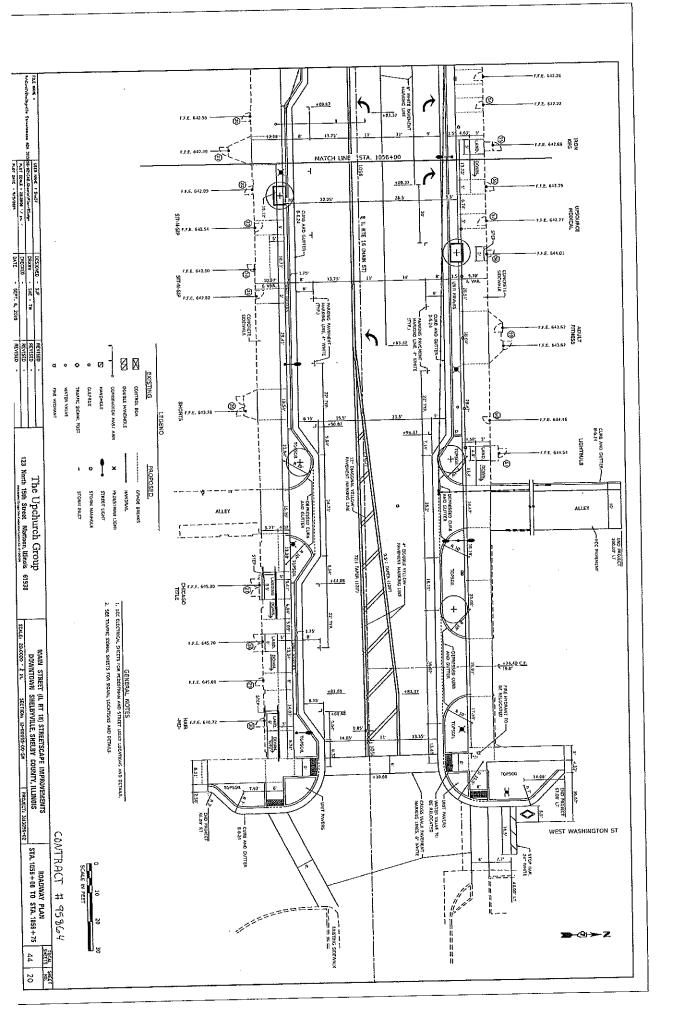


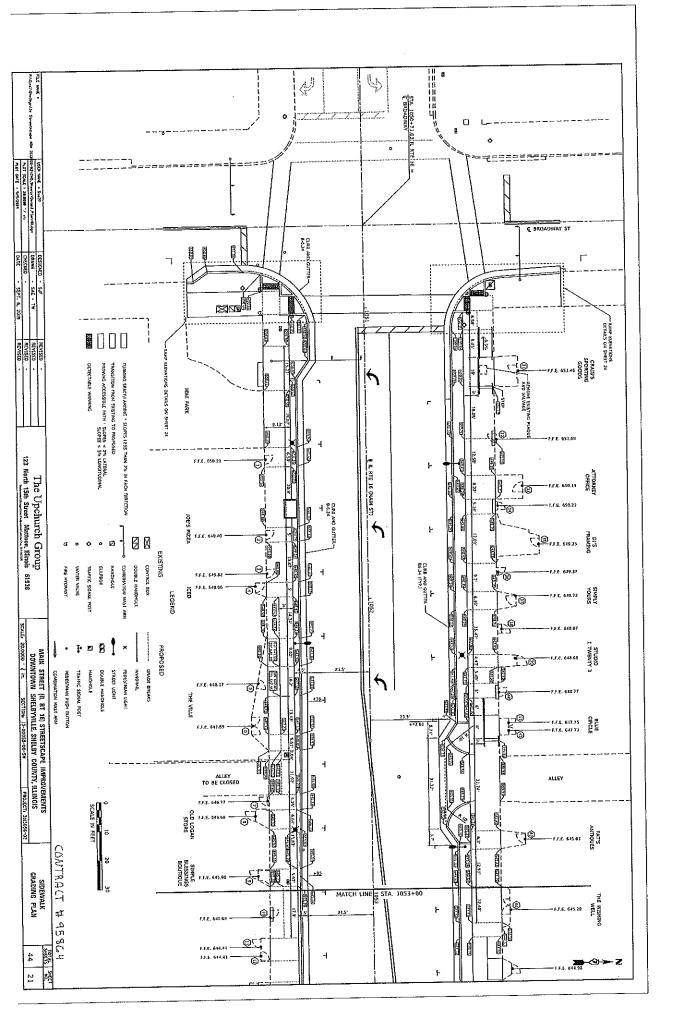


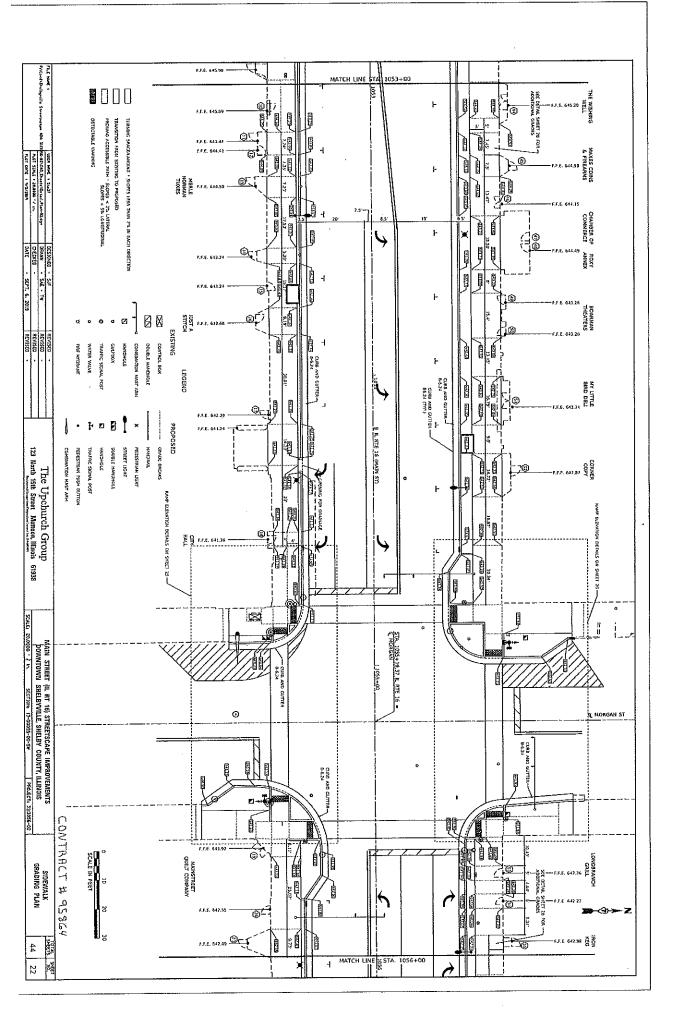


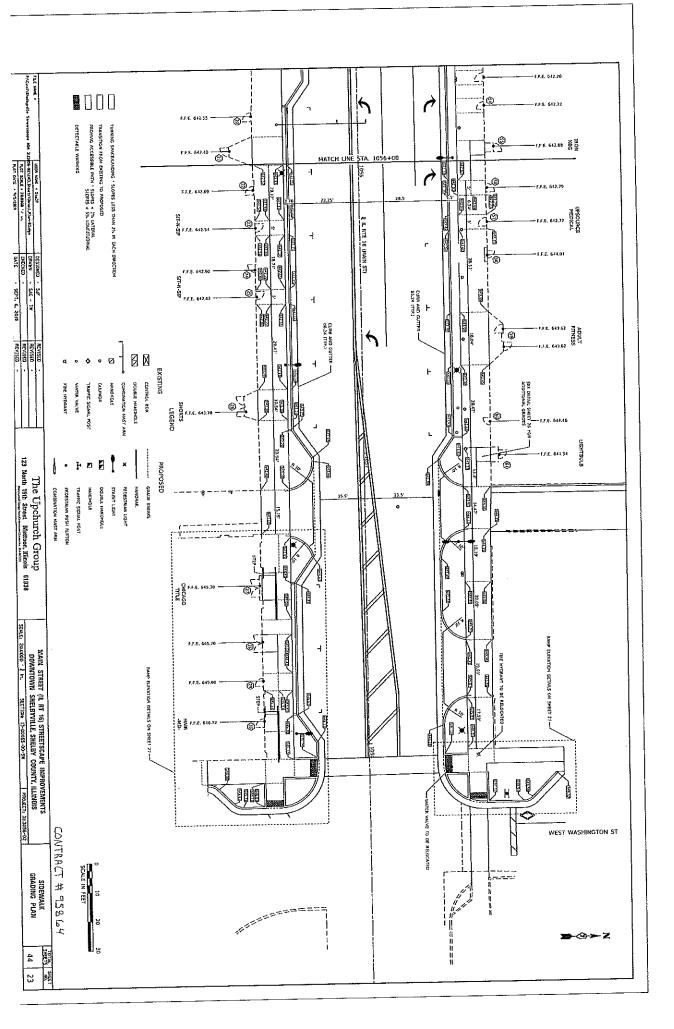

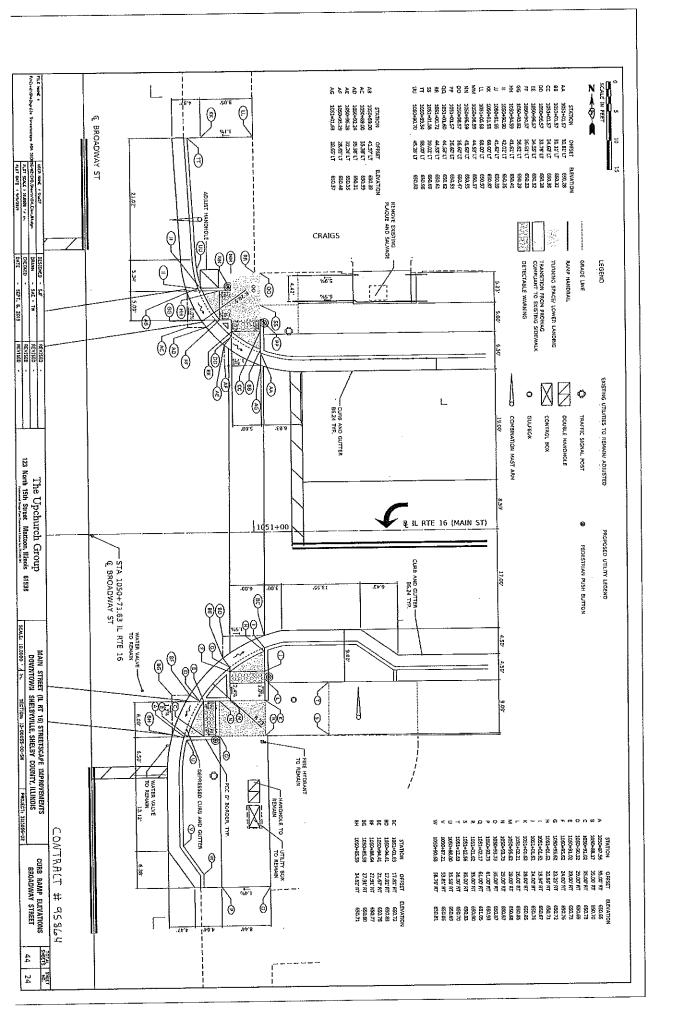


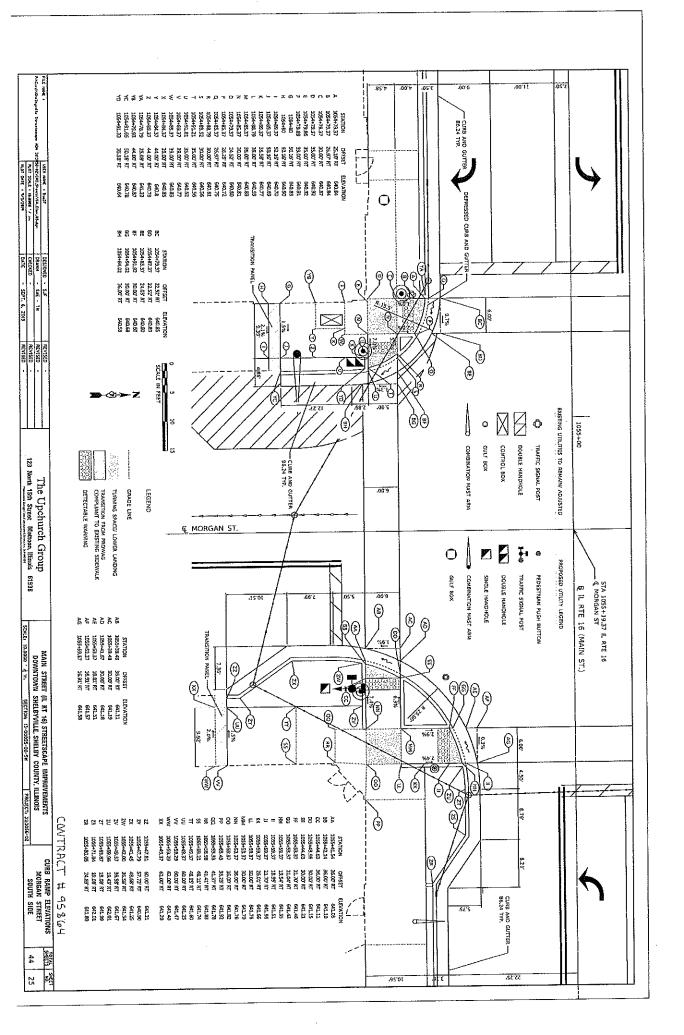


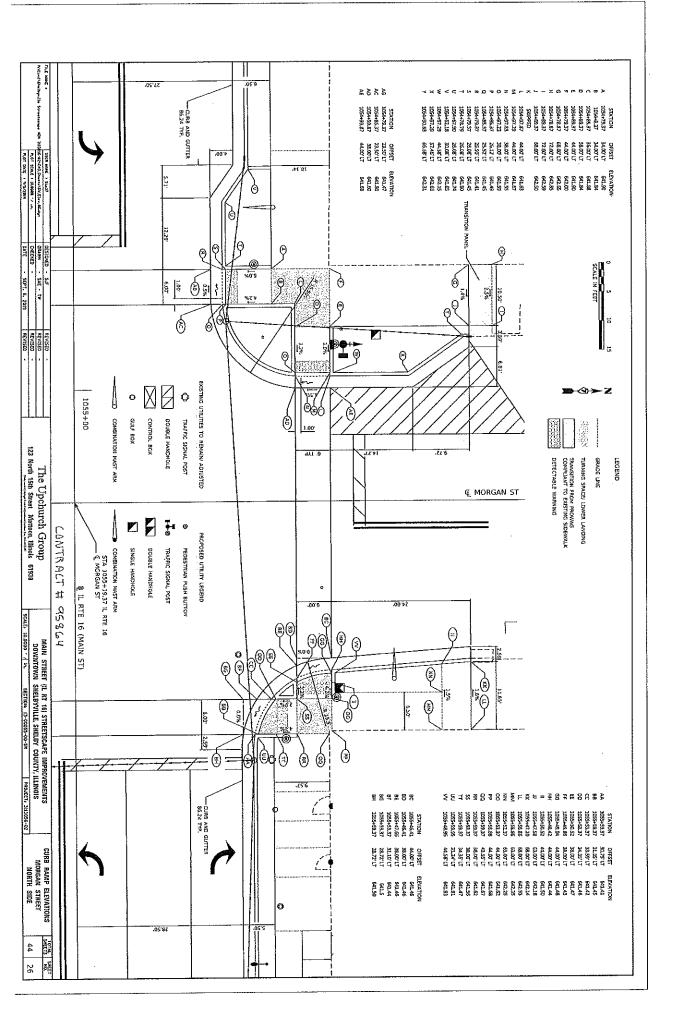


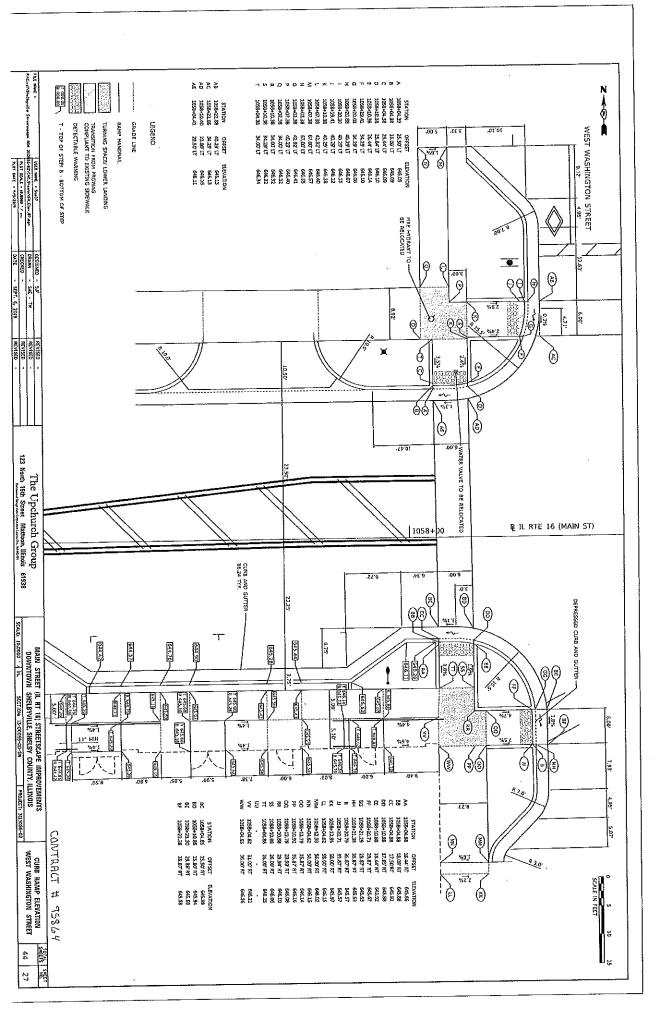



THE HOME I DESCRIBED AND THE PROPERTY OF THE HOME THE HOM	Entrance # 27 30 41.42 2 30 4.50° 5.00° 6.58° 5.00° 6.59° 5.00° 6.59° 5.00° 6.50° 5.00° 5.	(1) ISOMETRIC RAMP DETAIL	ENTRANCE &
REVISED The Upchurch Group REVISED 123 North 15th Street Matteon, Illinais 51938	Entrance # 55 51 51 528 45 55 51 500 5.00 5.00 5.00 5.00 5.00 5.0	2) ISOMETRIC RAMP DETAIL	AA BB CC HHY COMPANIE #
MAIN STREET (I. RT 16) STREETSCAPE (MEPROVEMENTS DOWNTOWN SHELBYUILE SHELBY COUNTY, ILLINOIS SECTION 12-00035-00-58 PROJECT.	Entrance # FFE Z  3 649.82 649.07  7 646.77 646.38  15 643.29 641.36  20 642.55 642.41  22 642.89 642.82  24 642.90 642.82  29 645.60 643.88  36 649.27 648.31  38 648.87 648.12  46 644.15 644.00  55 642.79 642.77  60 644.46 643.74	3 SECTION AT DOORWAY	SDEWALK 2 FEEE
PROVENENTS ISOMETRIC RAMP DETAILS (SETT) TO PROJECT 191055-02 (SETT) TO PROJECT 191055	<b>−1</b>	(4) SECTION AT DOORWAY	SIDEWALK Z Z ENTRANCE W

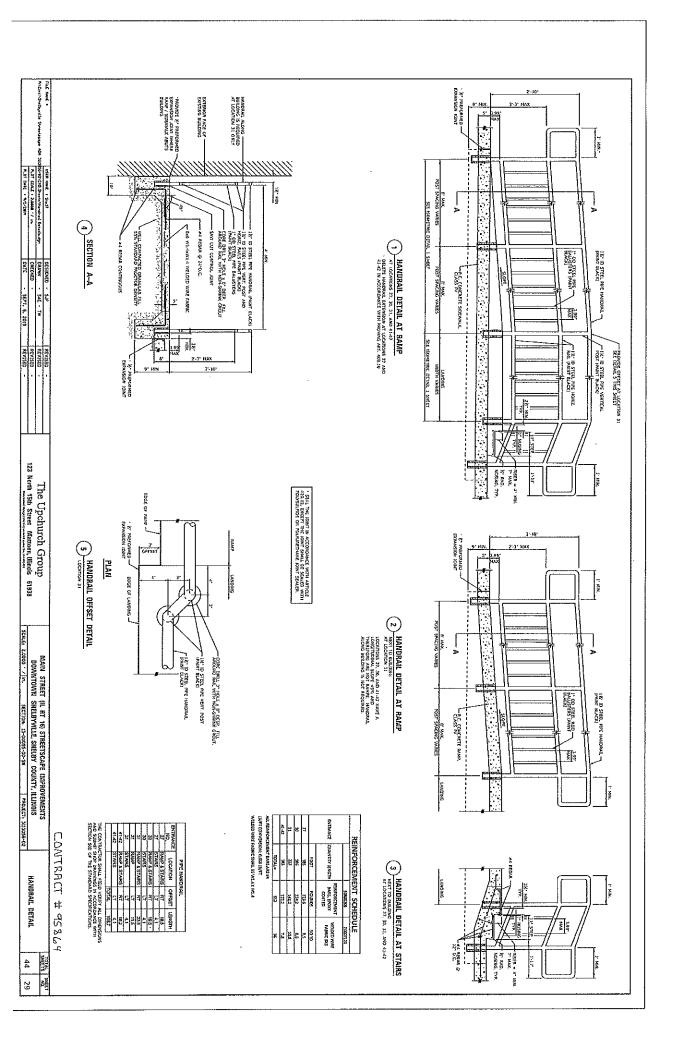


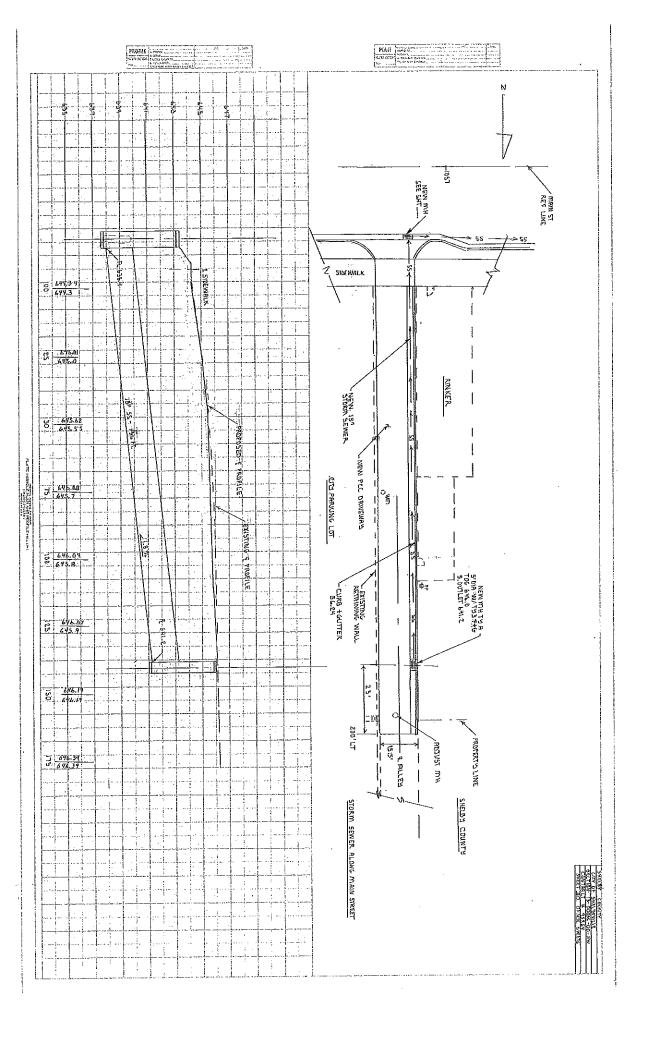


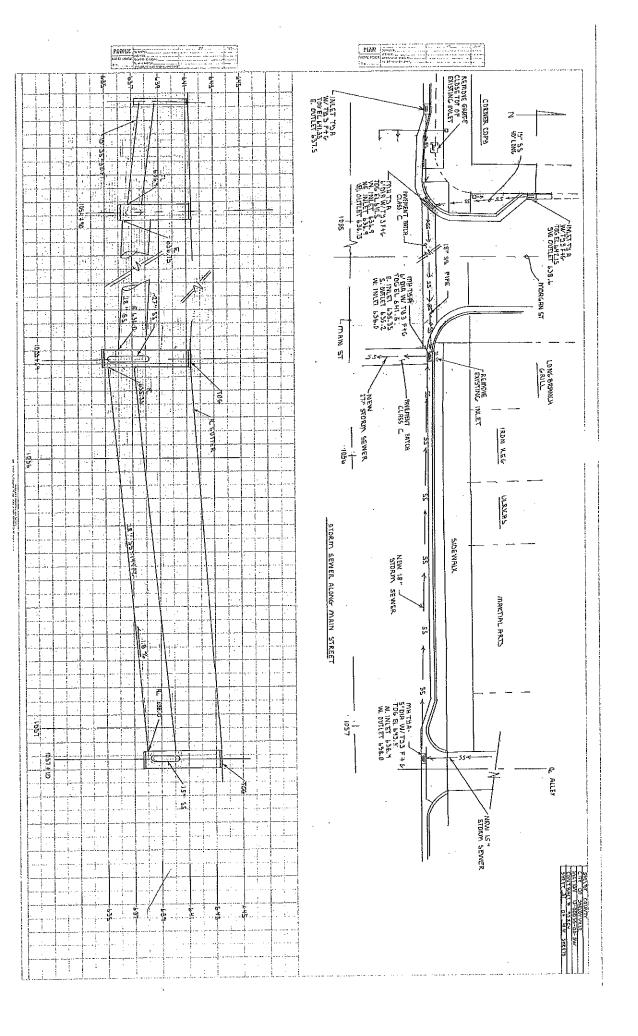

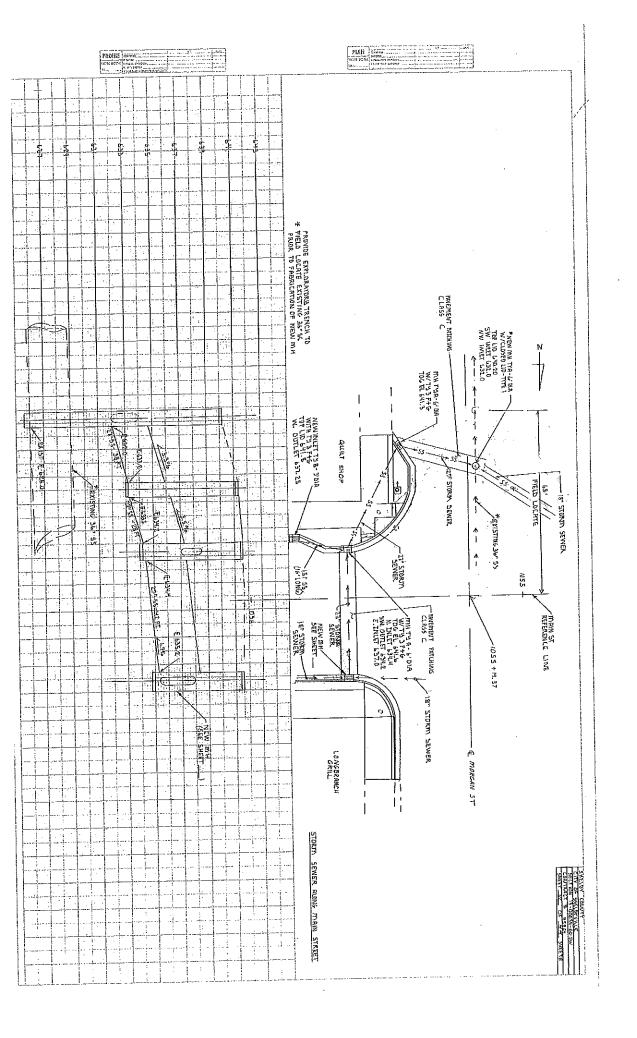

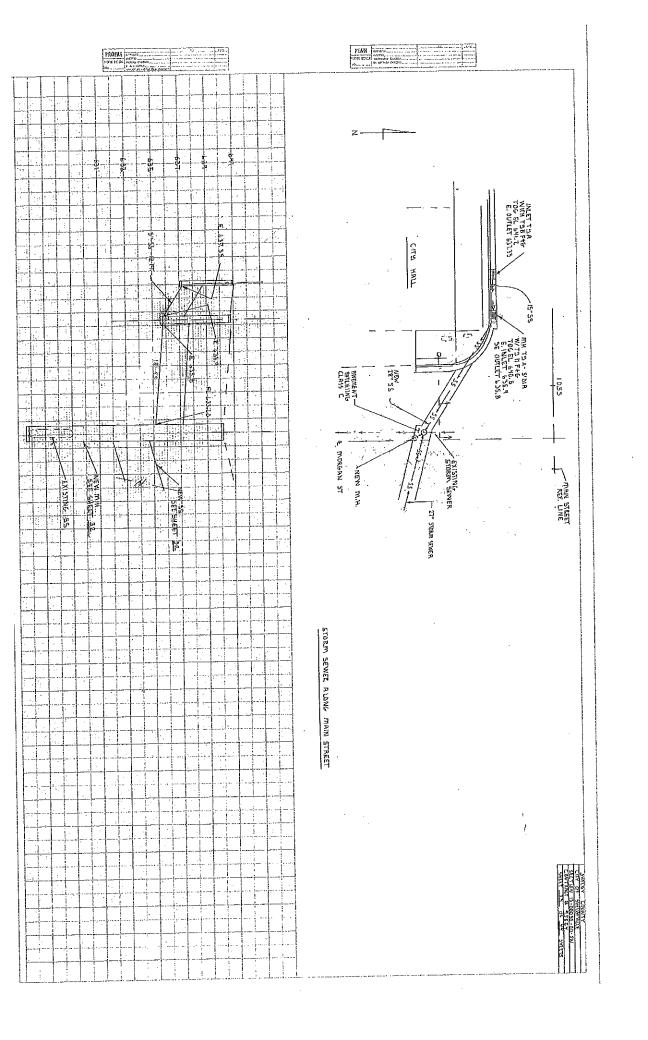

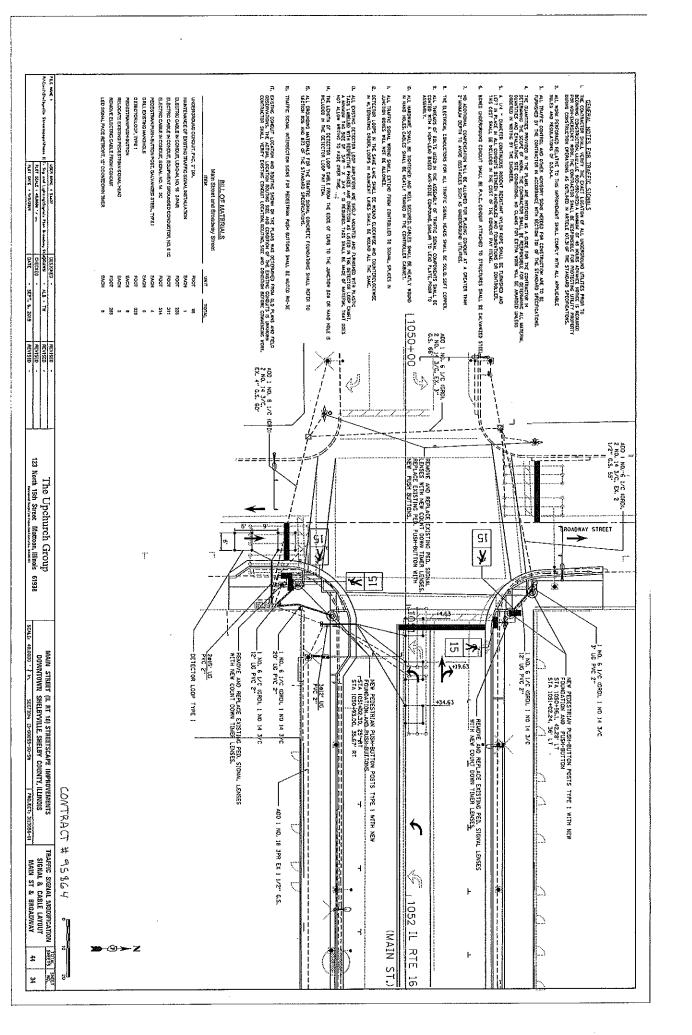

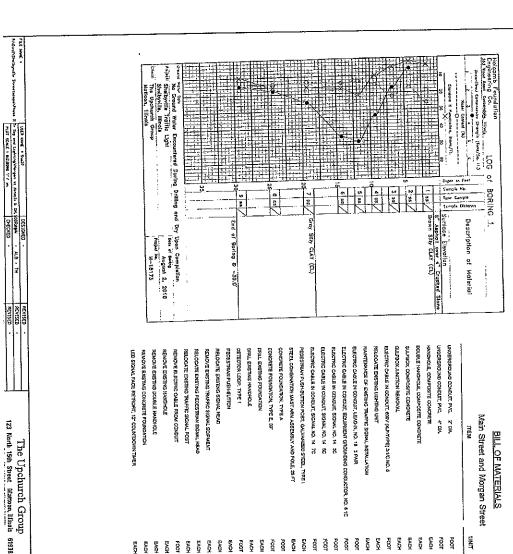

BILL OF MATERIALS

Main Street and Morgan Street ENT. TOTAL

NDERGROUND CONDUTT, PVC. 2" DIA-	POOT	716
YDERGROUND CONDUT, PVC. 4" DIA.	FOOT	23
ANOMOLE, COMPOSITE CONCRETE	EACH	ы
DUBLE HANDHOLLE, COMPOSITE CONCRETE	EACH	-
ULFBOX COMPOSITE CONCRETE	EACK	
ULFBOX-JUNCTION REMOVAL	EACH	-
LECTRIC CABLE IN CONCUIT, 600V PLP-TYPE) 3-1/C NO. 8	FODT	2019
ELOCATE EXISTING LIBHTING UNIT	EACH	_
MINTENANCE OF EXISTING TRAFFIC SIGNAL INSTALLATION	EACH	-
LEGTRIC CABLE IN CONDUIT, LEADIN, NO. 18 3 PAIR	7007	1075
LECTRIC CABLE IN CONDUIT, EQUIPMENT GROWNDING CONDUCTOR, NO. 6 1C	FOOT	761
LECTRIC CABLE IN CONDUIT, SIGNAL NO. 14 3C	FOOT	978
LECTRIC CABLE IN CONDUIT, SIGNAL NO. 14 SC	FOOT	524
LECTRIC CABLE IN CONDUIT, SIGNAL NO. 14 70	FOOT	1402
EDESTRIAN PUSH-BUTTON POST, GALVANIZED STEEL, TYPE I	EACH	œ
steel combination mast arm assembly and pole, 25 ft	EACH	
CONCRETE FOUNDATION, TYPE A	1004	Ф
CONCRETE FOUNDATION, TYPE E, 30"	FQDT	ä
DRILL EXSTING FOUNDATION	EACH	ט
DRILL EXSTERS HANDHOLE	EACH	7
DETECTOR LOOP, TYPE t	FOOT	862
PECESTRAN PUSH-BUTTON	HOVE	æ
RELOCATE EXISTING SIGNAL HEAD	EACH	٨
REMOVE EXISTENS TRAFFIO SIGNAL ECIPMENT	HONG	-
relocate exsting pedestrum signal kead	EACH	4
RELOCATE EXISTING TRAFFIC SIGNAL POST	EACH	N
REMOVE ELECTRIC CABLE FROM CONDUIT	FOOT	450
REMOVE EXSTING HANDHOLE	EACH	u
NEMOVE EXSTING DOUBLE HANDHOLE	EACH	_
REMOVE EXISTING CONCRETE FOUNDATION	EACH	u
LED SIGNAL FACE RETROFF, 12" COUNTDOWN TIMER	EACH	œ

- CEMERAL\_NOTES FOR TRAFETC SCHALS


  RE CONTRACTOR SHALL YERF THE SHACH LOCATH OF ALL INCREDEDUND UTILITIES PRICE TO
  REINMONE CONSTRUCTION OF THE SHACH CONTRACTOR SHALL HE RESPONSED A PROTECTION CHILLET PROPERTY
  REINMONE CONSTRUCTION OF THE SHACH CONTRACTOR SHALL HE RESPONSED AND THE STANDARD SECURENTIANS.


  BEHAVIOR CONSTRUCTION OF PERMITONS AS COLUMBED IN ARTICLE WITH OF THE STANDARD SECURENTIANS.
- ALL WORK PERFORMED RELATIVE TO THIS MPHOYEMENT SHALL COMPLY HITH ALL APPLICABLE RULES AND REGULATIONS OF O.S.M.A.
- AL TRAFFIC CONTROL AND OTHER ADVISORY SIDAS NEEDED FOR CONSTRUCTION ARE TO BE FUNDSHED BY THE CONTRACTOR IN ACCORDANCE WITH SECTION TO! OF THE STANDARD SPECIFICATIONS.
- THE COLUMNIES PROVINGE HE THE PLANS ARE REPORD AS A LODE FOR THE CONTRACTION ALL ALTERNAL DESTROMMING LINE SCORE OF MINNS. THE CONTRACTION SHALL BE RESPONDED FOR CONTRACTION SHALL BE RESPONDED FOR COLUMNIES AND EVALUATION STEE CONDITIONS. NO LLANDS FOR EXTEN YORK WILL BE ANABOED UNKESS ORDERED IN HINTER OF THE CONCILIENT.
- THAFFE SHAN, HEARS SHILL BE PROPERT CONSESS FOR ATTICA SHOULD SH'HE STAMMON SECRECTIONS SPORT TO MITERSTITIAN THAFFOR MA AS DESCENS OF THE ANNACES. THE COST SHALL BE INCLUDED WITH THE COST OF THE ASSOCIATION SHANDER SHOULD HEAR.
- BORED UNDERGROUND CONDUIT SHALL BE FARCL CONDUIT ATTACHED TO STRUCTURES SHALL BE CALVANGED STEEL A IVA II RAMETER CONTRADUZ RODDY RESTIANT MILON ERRE SALLI DE FUNNSHED AND LEFT IN PLACE NA LLACORQUES REMEREN NARROUSES AND FORWATIONS ON CONTROLLER. THIS COST SMALL BE NACURED IN THE COST OF THE CONDUT PAY ITEMS.
- NO ADDITIONAL COMPENSATION WILL BE ALLOWED FOR PLACING CONDUIT AT A GREATER THAN 2" MURIUM DEPTH TO AVOID OBSTACLES SUCH AS UNDERGROUND UTILITIES.
- ID. ALL THREADS OF BOLLTS USED IN THE ASSEMBLY OF TRAFFIC SONIAL COMPONENTS SHALL BE COUNTY WITH A NORW-LEAD BASED ANTI-SEZIE COMPOUND, SMALAR TO LEAD PLATE, PRIOR TO ASSEMBLY. 9, THE ELECTRICAL CONDUCTORS FOR ALL TRAFFIC SIGNAL HEADS SHALL BE SOLID. SOFT COPPER
- ALL RELOCATED POST SALL US A MANUAL OF 8 PT FEOUL THE CONTER OF THE POLT TO THE FACE OF CHIEF POST MAINTED SHALL BE SETALLED SO THAT NO PART OF THE SHOWL HEAD S WITHIN 6 PT LOT THE FACE OF COME RY HANDWARE SHALL BE TIGHTENED AND WELL SECURED CABLES SHALL BE MEATLY MOUND IN HANDHOLES, CABLES SHALL BE MEATLY TRANSED IN THE COMTROLLER CABNET.
- D. ALL TRAFFIC SIGNAL MISHOS SHALL EXTEND FROM CONTROLLER TO SIGNAL SPLICES IN JUNCTION BOXES WILL NOT BE ALLONGO.
- IA, DETECTOR LOOPS IN THE SAME LAME SHALL BE WOUND CLOCKRISE AND COUNTERCLOCKRISE IN ALTERNATING ORDER, LOOPS IN ADJACENT LAWES SHALL BE WOUND ALL THE SAME. LENSING DETECTOR LOOP AND LEERS ARE SHELF MUNITED AND FIRMSHED WITH PLASTIC TOCS LARGED WITH RESPECTING PLASES AND ORDERIONS AS LISTED IN THE DETECTION LOOP CHAFT. A LINEARY TAGE SHALL BE AND OF MAILTENAL WAIT DOES NOT ALLOW WRITHOU TO FACE OFER TIME.
- ALL GROUNDING MATERIALS FOR THE TRAFFIC SIGNAL CONCRETE FOUNDATIONS SHALL REFER TO SECTION 806 AND 873 OF THE SYMMARD SPECIFICATIONS. THE LENGTH OF DETECTOR LOOP CHAILE FROM THE EDGE OF CURB TO THE JUNCTION BOX OR HANDHOLE IS NOLLOGO IN THE DETECTOR LOOP PAY ITEM.
- 18. TRAFFIC SKINAL INTERSECTION SIONS FOR PEDESTRIAN PUSH BUTTONS SHALL BE MUTCO RIO-SE.
- IS. EXISTNO COMBUT LOCATION AND ROUTING SHOWN ON THE PLANS WAS RETENANCE FROM AND PLANS AND FILED OF SHOWN AND FILED OF PLANS AND FILED OF THE RESERVATIONS. THE ACTUAL LOCATION ROUTING SCENAR CONTINUE OF THE EXPENDITORS OF UNKNOWN COMBUTANCES. 20, THE PROPOSED MAST ARM POST SHALL MATCH THE HEICHT OF THE EXISTING POST AT THE INTERSECTION.


CONTRACT # 958'64


40 41 51 00 0000 14 / In. SECTION 13-00055-00-58


MAIN STREET (IL RT 16) STREETSCAPE IMPROVEMENTS DOWNTOWN SHELBYVILLE, SHELBY COUNTY, ILLINOIS

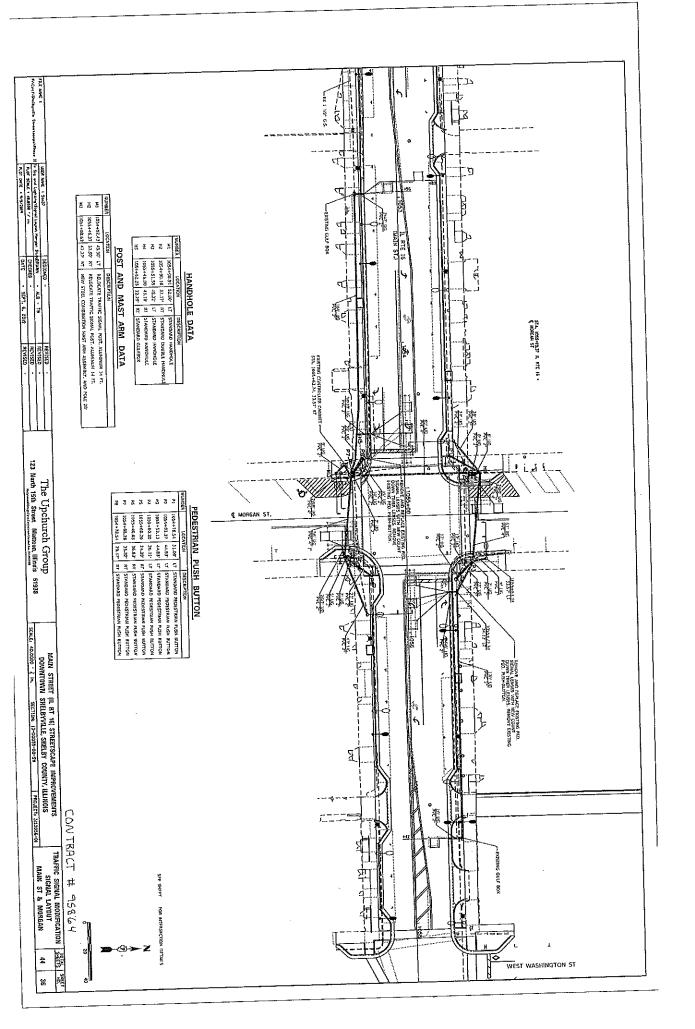


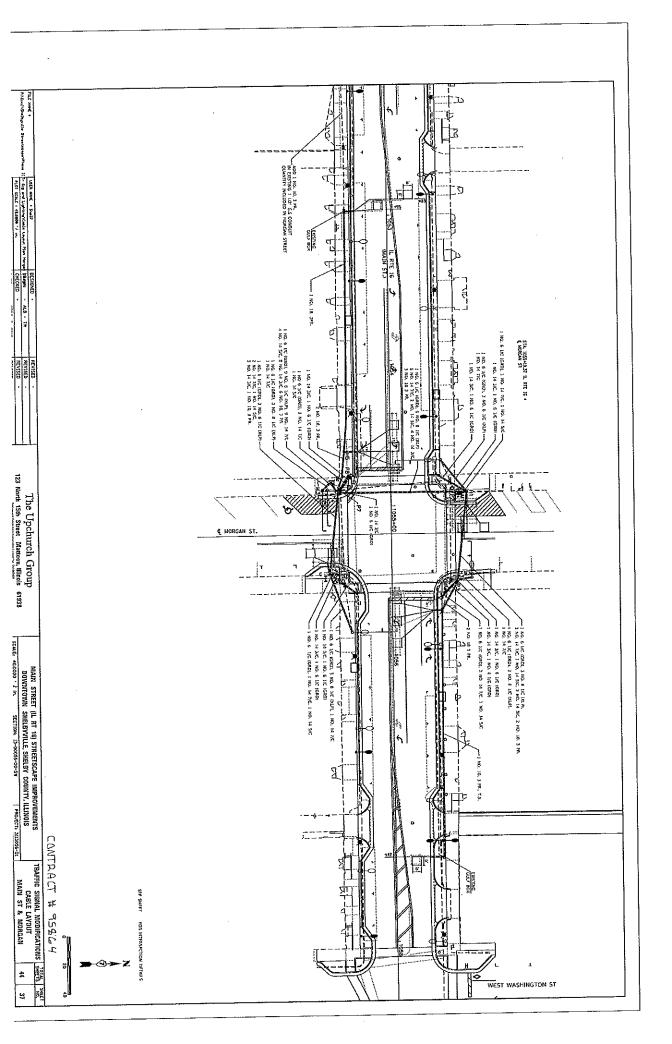

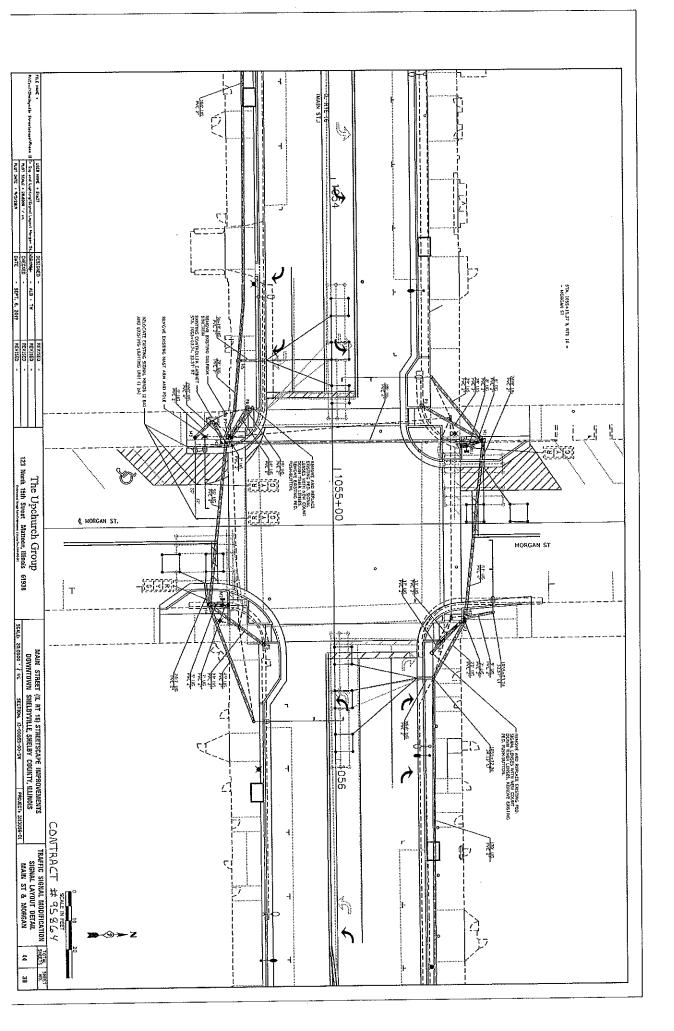

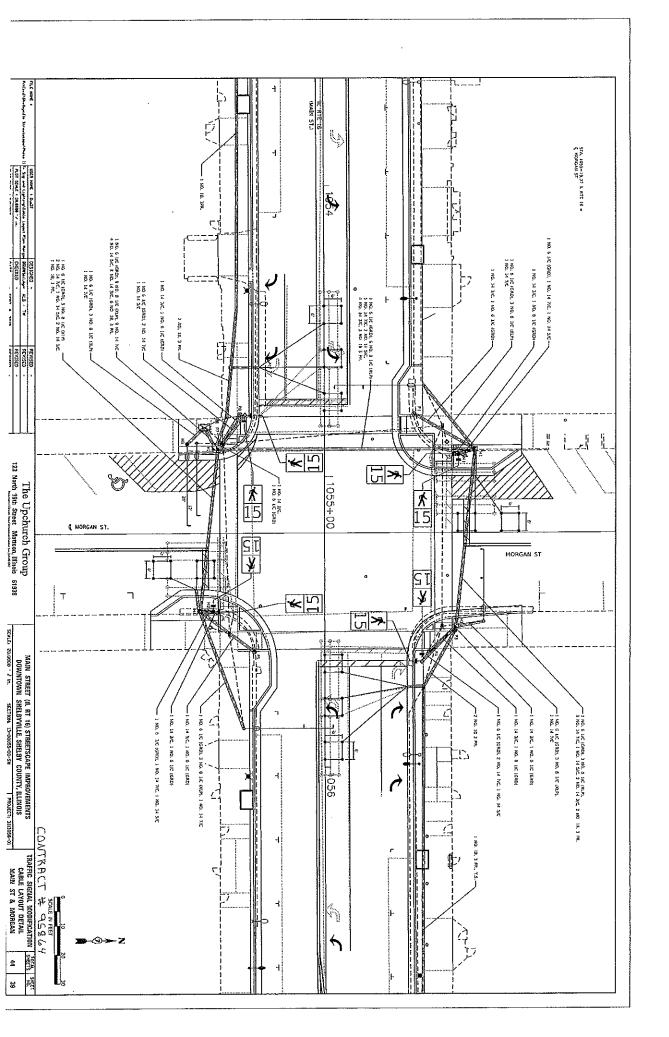

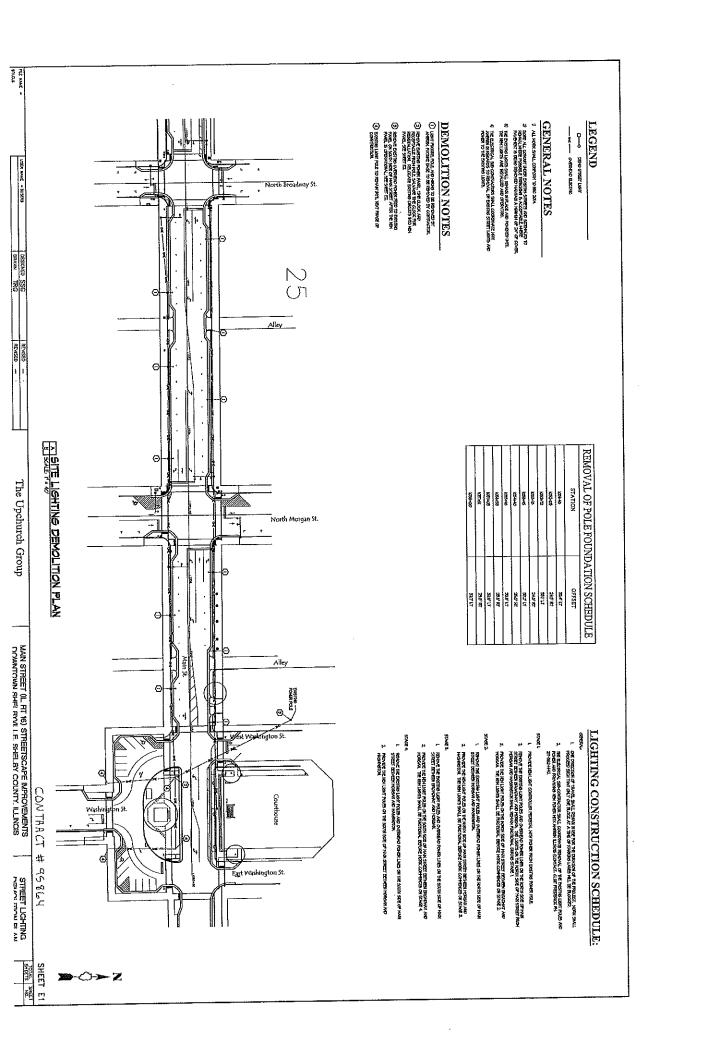

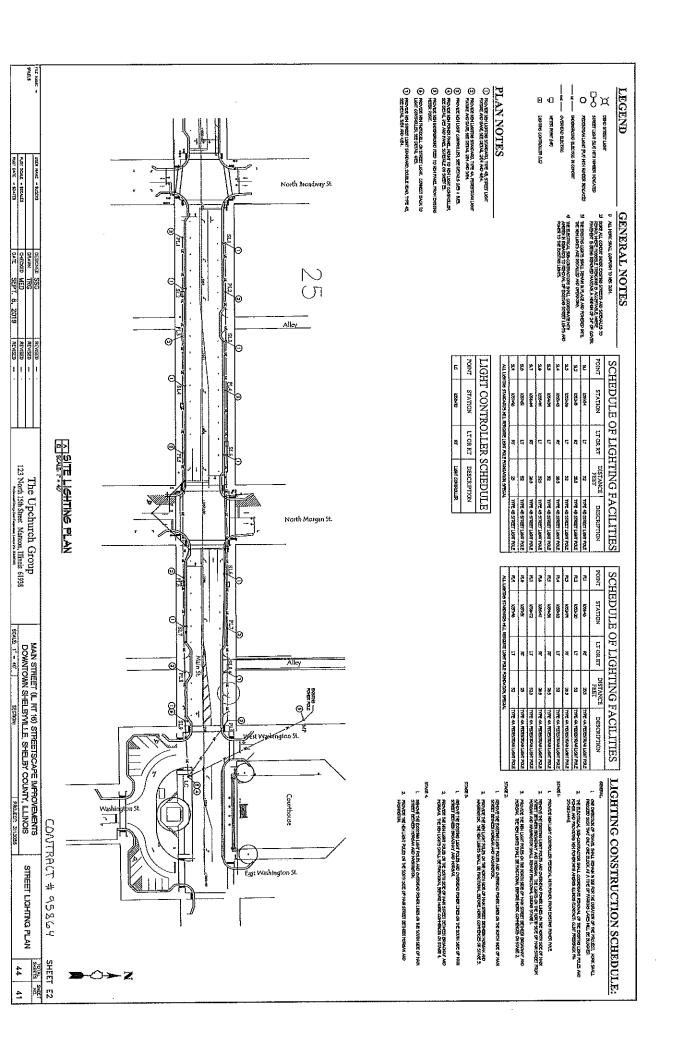

		Ш		l
i	CHECKED	DRAWN	<b>G3M2IS30</b>	ŀ
1	MED	큕	SSG	
3				l
,				
	REVISE	REVISE	REVISE	
•	,	ľ	ľ	
	ľ	ľ		
	l			Į
	l	İ		l
	l			I
	L	L		1
				I
	_			
	23		٦	
ļ	ort.	Ę	5	
	150	Ò	Ϊ.	
į	Stre	Š	3	
	2	É	3	
	alto		ž	
	ř	. (	5	
i	1001	THE Cherimon Creak	y Groun	
	613	ť	3	
	×	•		
	8			
	38			

PROJECT: 3113056

44 42

SUTUR SITE NATE

PLOT SOALE - \$5CALES

MAIN STREET (IL AT 16) STREETSCAPE IMPROVEMENTS		37/4 17/4	SAME.	TOWING COMBOTTER COCKL	DOSING - RECEIVED	BISTING - OVERAGIO RECOTIVITIES	DESCRIPTION		SCHEDULE	NEW PANEL 'A'	
SCAPE IMPROVEMENTS	CDN			5,000 00 2 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1	2 8 8 2	- 80 2 1	arti	Decrease of Decrease	BUS: 100 ALFREE MOINTING, SIRFACE	MAIN VOLTAGE 120/240	
WIRING AND PANEL	CONTRACT #95864	- 39,00	- 9/00	Cuser Lates Cars Hars 1.4078 One	EXSIDES - BOX RECOMES	EXSTITE - THE	DESCRIPTION		FACE TIPE MINAS	N PASE   MRG 5	
SHEETS NO.	<b>⊣</b>	 									

١	1	8	Б	1		3	25	2	8	2	2	č	2	72	Ę	2	£	č	72	ť	ď	:	£	PI OF FG	7
ľ		ĸ	Ŧ	£		ž.	Ē	Ę	\$	ē	ě	Ğ	Ľ	Ⴌ	3	É	2	35	č	3	Ğ		ŝ		١
		OSANIO	DE CHARTES	100100		OT S	1256-69	284	100468	1003145	NAC201	(A)	98+16G	100146	Kojidi	25452	1025-41	10,400	100000	033-66	10000		200	STATIONTO	
		00000	101/46	August A		9r153	Kilgy	K26-64	1000-17	95+H2X	20046	K2524K	G245	1050-70	1237-46	55	17.923	1000-44	243	158	60,00	1	200	STATION	
		ESSE	Ħ		3	26/26	26725	265/265	25/205	265/265	22/265	255/22	23/25	я				,				-	,	STATION TO STATION LOCATION RI LOCATION LT	
		٠				,				,	,			22	22/22	525 / 53	315 / 325	32/523	22/22	22/22	1	5/3	22/22		
		ų	₽		4	8	62	컦	£	ą	86	2	5	8	85	¥	0 <u>t</u>	Ę	a	8		5	*	DISTANCE	
					S.		ধ			ध		В			ĸ		ĸ	Ħ		į	1		ĸ	DISTANCE RECEPTACLE	
			ō		đ	ą	¢	Œ	di	đ	q	đ	g.	ď	đ	q	¢	ģ	ą			Q	đ	3TO4	
		ų	q		ç	٩	٥	¢	4	Q	٥	ø	45	đ	Q	q	15	٩	8			4	Q	SLACK	بسا
		,	DAG		DA 224	55/140	20/12	72/47	64/256*	197.00	18,995	#ZH:	Š	80/10	g//0:	34754	100/125	10000	enau	4,0	university of the same of the	P(30	1001/26	LENGTH RECEPTALIGHT	VIRING S
	Ę	,	27	2							,			,			,	-	,				٠	CONDUIT 2" DIA. PVC FOOT	WIRING SCHEDULE
-	Ĭ		•		¥	S <sub>L</sub>	62	Ą	Ş	4	86	ż	3	8	8	3		8			85	8į	8,	CONDUIT 1" DIA. PVC FOOT	Œ
	3330				200	8	ž	3	327	¥	Ħ	8	q	æ	8	ē	3	1		2	Ą	Ą	72	(RECEPTACLE) ELECTRIC CABLE IN CONDUTT, 600V (XLP- TYPE USE) 1/C NO. 10	LASATATION .
	868	-			Ş	3	4	!   "	į	2	8		a	80	4	3	6 8	1	5	4	Ą	\$	ĝ	(RECEPT. GRD.) SLECTRIC CABLE IN CONDUIT,600V (XLP TYPE USE) 1/C NO. 1	
	į,			,	134	4		ī i	9 8	-		3	<b>.</b>	5			ξ. (	9	26	Į.	186	4	8	CONDUTT, SORV CARLE IN CONDUTT, SORV CALF-TYP USE) 3-1/C NO. 8 FOOT	
	74		-	4															*		•			ELECTRIC CABLE IN E CONDUIT,600 V (XLP-TYPE C USE) 3-1/C NO. 2 FOOT	
			ŧ	•								•	•			,		•		•		,	,	ELECTRIC CALLE IN CONDUIT,600V (XLP-TYPE LISE) I/C NO. 6 FOOT	

TEGEND


10 HEIGHTON


10 HEIGHTON

10 HEIGHTON

10 HEIGHTON

11 HEIGHTO

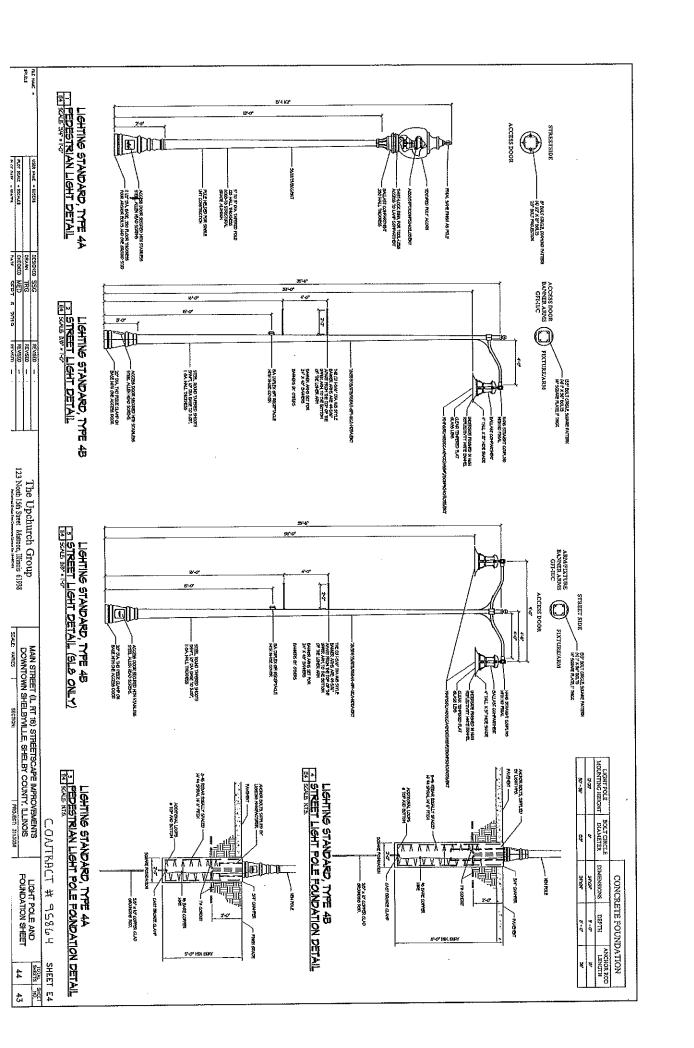

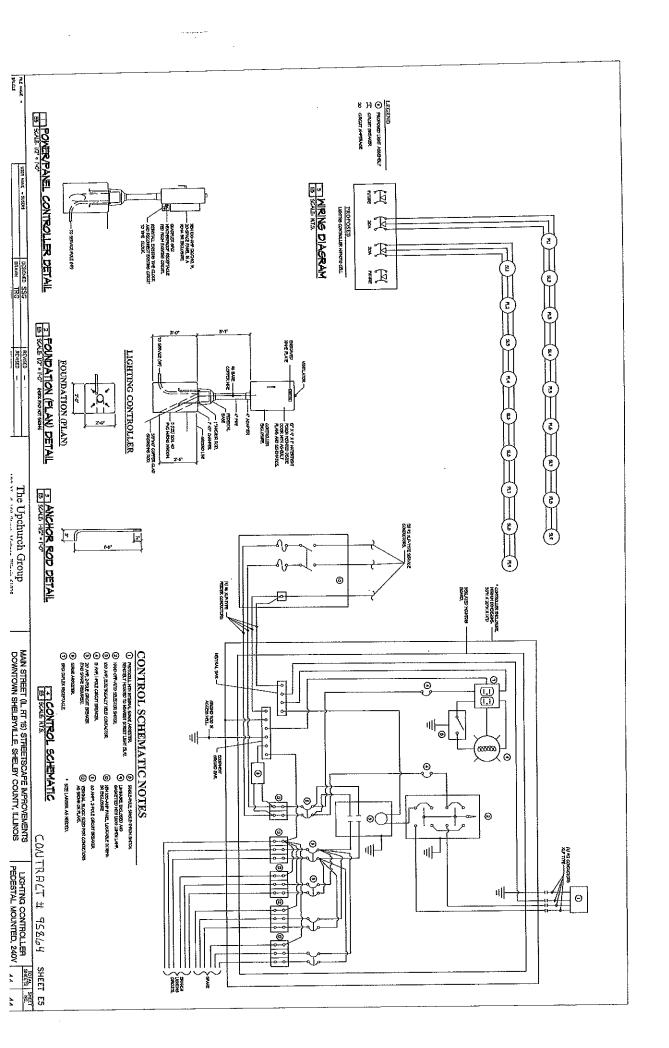

# 150

Letting January 17, 2020

### Notice to Bidders, Specifications and Proposal



Contract No. 95864 SHELBY County Section 13-00055-00-SW (Shelbyville) Route FAP 325 (Main Street) Project TU34-077 () District 7 Construction Funds

Prepared by

Checked by

(Printed by authority of the State of Illinois)

# Illinois Department of Transportation

#### **NOTICE TO BIDDERS**

- 1. TIME AND PLACE OF OPENING BIDS. Electronic bids are to be submitted to the electronic bidding system (iCX-Integrated Contractors Exchange). All bids must be submitted to the iCX system prior to 10:00 a.m. January 17, 2020 at which time the bids will be publicly opened from the iCX SecureVault.
- 2. **DESCRIPTION OF WORK**. The proposed improvement is identified and advertised for bids in the Invitation for Bids as:

Contract No. 95864 SHELBY County Section 13-00055-00-SW (Shelbyville) Project TU34-077 () Route FAP 325 (Main Street) District 7 Construction Funds

Sidwalk removal and replacement, lighting and traffic signal modifications on Main Street from Broadway Street to Washington Street in Shelbyville.

- 3. INSTRUCTIONS TO BIDDERS. (a) This Notice, the invitation for bids, proposal and letter of award shall, together with all other documents in accordance with Article 101.09 of the Standard Specifications for Road and Bridge Construction, become part of the contract. Bidders are cautioned to read and examine carefully all documents, to make all required inspections, and to inquire or seek explanation of the same prior to submission of a bid.
  - (b) State law, and, if the work is to be paid wholly or in part with Federal-aid funds, Federal law requires the bidder to make various certifications as a part of the proposal and contract. By execution and submission of the proposal, the bidder makes the certification contained therein. A false or fraudulent certification shall, in addition to all other remedies provided by law, be a breach of contract and may result in termination of the contract.
- 4. AWARD CRITERIA AND REJECTION OF BIDS. This contract will be awarded to the lowest responsive and responsible bidder considering conformity with the terms and conditions established by the Department in the rules, Invitation for Bids and contract documents. The Issuance of plans and proposal forms for bidding based upon a prequalification rating shall not be the sole determinant of responsibility. The Department reserves the right to determine responsibility at the time of award, to reject any or all proposals, to readvertise the proposed improvement, and to waive technicalities.

By Order of the Illinois Department of Transportation

Omer Osman, Acting Secretary

## INDEX FOR SUPPLEMENTAL SPECIFICATIONS AND RECURRING SPECIAL PROVISIONS

#### Adopted January 1, 2020

This index contains a listing of SUPPLEMENTAL SPECIFICATIONS, frequently used RECURRING SPECIAL PROVISIONS, and LOCAL ROADS AND STREETS RECURRING SPECIAL PROVISIONS.

ERRATA Standard Specifications for Road and Bridge Construction

(Adopted 4-1-16) (Revised 1-1-20)

#### SUPPLEMENTAL SPECIFICATIONS

Std. Spe	ec. Sec.	Page No.
106	Control of Materials	1
107	Legal Regulations and Responsibility to Public	2
109	Measurement and Payment	3
205	Embankment	4
403	Bituminous Surface Treatment (Class A-1, A-2, A-3)	5
404	Micro-Surfacing and Slurry Sealing	6
405	Cape Seal	17
406	Hot-Mix Asphalt Binder and Surface Course	27
420	Portland Cement Concrete Pavement	28
424	Portland Cement Concrete Sidewalk	. 30
442	Pavement Patching	. 31
502	Excavation for Structures	. 32
503	Concrete Structures	35
504	Precast Concrete Structures	38
506	Cleaning and Painting New Steel Structures	. 39
522	Retaining Walls	. 40
542	Pipe Culverts	41
586	Sand Backfill for Vaulted Abutments	. 42
602	Catch Basin, Manhole, Inlet, Drainage Structure, and Valve Vault Construction, Adjustment, and	d
	Reconstruction	44
603	Adjusting Frames and Grates of Drainage and Utility Structures	. 45
630	Steel Plate Beam Guardrail	. 46
631	Traffic Barrier Terminals	49
670	Engineer's Field Office and Laboratory	. 50
701	Work Zone Traffic Control and Protection	51
704	Temporary Concrete Barrier	53
780	Pavement Striping	55
781	Raised Reflective Pavement Markers	56
888	Pedestrian Push-Button	. 57
1001	Cement	. 58
1003	Fine Aggregates	59
1004	Coarse Aggregates	60
1006	Metals	63
1020	Portland Cement Concrete	65
1043	Adjusting Rings	67
1050	Poured Joint Sealers	69
1069	Pole and Tower	71
1077	Post and Foundation	72
1096	Pavement Markers	. 73
1101	General Equipment	74
1102	Hot-Mix Asphalt Equipment	75
1103	Portland Cement Concrete Equipment	77
1105	Pavement Marking Equipment	79
1106	Work Zone Traffic Control Devices	81

#### RECURRING SPECIAL PROVISIONS

The following RECURRING SPECIAL PROVISIONS indicated by an "X" are applicable to this contract and are included by reference:

CHEC	K SH	<u>EET#</u>	PAGE NO
1	Χ	Additional State Requirements for Federal-Aid Construction Contracts	83
2	Χ	Subletting of Contracts (Federal-Aid Contracts)	86
3	Χ	EEO	87
4		Specific EEO Responsibilities Non Federal-Aid Contracts	97
5		Required Provisions - State Contracts	102
6		Asbestos Bearing Pad Removal	108
7		Asbestos Waterproofing Membrane and Asbestos HMA Surface Removal	109
8		Temporary Stream Crossings and In-Stream Work Pads	110
9		Construction Layout Stakes Except for Bridges	111
10	Χ	Construction Layout Stakes	114
11		Use of Geotextile Fabric for Railroad Crossing	117
12		Subsealing of Concrete Pavements	119
13		Hot-Mix Asphalt Surface Correction	123
14		Pavement and Shoulder Resurtacing	125
15		Patching with Hot-Mix Asphalt Overlay Removal	126
16		Polymer Concrete	128
17		PVC Pipeliner	130
18		Bicycle Racks	131
19		Temporary Portable Bridge Traffic Signals	133
20		vvork Zone Public Information Signs	135
21		Nighttime inspection of Roadway Lighting	136
22	Χ	English Substitution of Metric Bolts	137
23		Calcium Chloride Accelerator for Portland Cement Concrete	138
24		Quality Control of Concrete Mixtures at the Plant	139
25		Quality Control/Quality Assurance of Concrete Mixtures	147
26		Digital Terrain Modeling for Earthwork Calculations	163
27		Reserved	165
28		Preventive Maintenance – Bituminous Surface Treatment (A-1)	166
29		Reserved	172
30		Reserved	173
31		Reserved	174
32		Temporary Raised Pavement Markers	175
33		Restoring Bridge Approach Pavements Using High-Density Foam	176
34		Portland Cement Concrete Inlay or Overlay	179
35		Portland Cement Concrete Partial Depth Hot-Mix Asphalt Patching	183
36		Longitudinal Joint and Crack Patching	186

#### LOCAL ROADS AND STREETS RECURRING SPECIAL PROVISIONS

The following LOCAL ROADS AND STREETS RECURRING SPECIAL PROVISIONS indicated by an "X" are applicable to this contract and are included by reference:

CHECK SI	<u>HEET</u>	<u>#</u>	<u>PAGE NO.</u>
LRS1		Reserved	189
LRS2		Furnished Excavation	
LRS3	Х	Work Zone Traffic Control Surveillance	191
LRS4	Х	Flaggers in Work Zones	192
LRS5		Contract Claims	
LRS6		Bidding Requirements and Conditions for Contract Proposals	194
LRS7		Bidding Requirements and Conditions for Material Proposals	200
LRS8		Reserved	206
LRS9		Bituminous Surface Treatments ,,,,,	
LRS10		Reserved	208
LRS11		Employment Practices	., 209
LRS12		Wages of Employees on Public Works	211
LRS13		Selection of Labor	213
LRS14	Х	Paving Brick and Concrete Paver Pavements and Sidewalks	214
LRS15		Partial Payments	
LRS16		Protests on Local Lettings	218
LRS17		Substance Abuse Prevention Program	219
LRS18		Multigrade Cold Mix Asphalt	

#### INDEX OF SPECIAL PROVISIONS

INTRODUCTORY PARAGRAPH	.1
LOCATION OF WORK	1
DESCRIPTION OF WORK	.1
PROJECT PREPARATION	.1
TRAFFIC CONTROL, CONSTRUCTION STAGING, AND COORDINATION WITH	1
RESIDENTS AND BUSINESSES	.1-4
AGGREGATE SURFACE COURSE, TYPE B	.4
CONSTRUCTION LAYOUT AND STAKING	.4-6
SAW CUTTING (FULL DEPTH)	.6
MAILBOXES	6
TRASH PICKUP	.6-7
OVERHAUL	7
BORROW AREAS; USE AREAS, AND/OR WASTE AREAS	7
PAVEMENT MARKINGS	7
REMOVAL OF UNCLASSIFIED MATERIAL	7
COARSE AGGREGATE GRADATION CA-6:	.7
REMOVAL OF EXISTING PIPES AND INLETS	7
MANHOLES AND INLETS	. 7
JOINT UTILITY LOCATING INFORMATION FOR EXCAVATORS	8
PRECAUTIONS FOR UTILITIES	9
UTILITIES	8-9
MANHOLES TO BE AD ILISTED	9

#### HISTORIC MANHOLE COVERS AND PLAQUE REMOVAL

AND REPLACEMENT	10
DOMESTIC METER VAULTS TO BE ADJUSTED	10
PORTLAND CEMENT CONCRETE SIDEWALK 5 INCH	10-11
WELDED WIRE FABRIC 6X6	11
CURB STOPS	11
UNIT PAVERS	.11-13
DRIVEWAY, PAVEMENT, GUTTER AND CURB REPLACEMENT	13
SIDEWALKS THRU DRIVEWAYS	. 13
TREE GRATES	13
PIPE HANDRAIL	14
PREPARATION/RESTORATION OF SITE	14
PEDESTRIAN PUSH-BUTTON	14-15
LED SIGNAL FACE RETROFIT 12" COUNTDOWN TIMER	15-16
MAINTENANCE OF EXISTING TRAFFIC SIGNAL INSTALLATION	16
HANDHOLE/DOUBLE HANDHOLE	16
LIGHTING STANDARD, TYPE 4B (STREET LIGHT AND POLE)	16-17
LIGHTING STANDARD, TYPE 4A (PEDESTRIAN LIGHT AND POLE)	17
LIGHTING CONTROLLER, PEDESTAL MOUNTED, 240 VOLT, 60 AMP	18
LIGHT POLE FOUNDATION, SPECIAL	18
MAINTAIN EXISTING LIGHTING SYSTEM	18
REMOVAL OF EXISTING LIGHTING SYSTEM	19
ELECTRICAL SERVICE INSTALLATION	19
UNDERGROUND CONDUIT	19
ELECTRIC CABLE – DETECTOR LOOP LEAD-IN	20

#### **BDE SPECIAL PROVISIONS**

The following special provisions indicated by an "X" are applicable to this contract. An  $\star$  indicates a new or revised special provision for the letting.

<u>File</u> Name	<u>Pg.</u>		Special Provision Title	<b>Effective</b>	Revised
80099			Accessible Pedestrian Signals (APS)	April 1, 2003	Jan. 1, 2014
80274			Aggregate Subgrade Improvement	April 1, 2012	April 1, 2016
80192			Automated Flagger Assistance Device	Jan. 1, 2008	• ,
80173			Bituminous Materials Cost Adjustments	Nov. 2, 2006	Aug. 1, 2017
* 80246		2 32 2	Bituminous Surface Treatment with Fog Seal	Jan. 1, 2020	
80241			Bridge Demolition Debris	July 1, 2009	Sergment (Serger Serger Serger Serger serger server as a series of the s
5026I			Building Removal-Case I (Non-Friable and Friable Asbestos)	Sept. 1, 1990	April 1, 2010
50481			Building Removal-Case II (Non-Friable Asbestos)	Sept. 1, 1990	April 1, 2010
50491			Building Removal-Case III (Friable Asbestos)	Sept. 1, 1990	April 1, 2010
5053I		-	Building Removal-Case IV (No Asbestos)	Sept. 1, 1990	April 1, 2010
* 80425			Cape Seal	Jan. 1, 2020	
80384	25	Χ	Compensable Delay Costs	June 2, 2017	April 1, 2019
80198			Completion Date (via calendar days)	April 1, 2008	4
80199			Completion Date (via calendar days) Plus Working Days	April 1, 2008	
80293			Concrete Box Culverts with Skews > 30 Degrees and Design Fills ≤	April 1, 2012	July 1, 2016
00200			5 Feet	•	•
80311			Concrete End Sections for Pipe Culverts	Jan. 1, 2013	April 1, 2016
80277			Concrete Mix Design – Department Provided	Jan. 1, 2012	April 1, 2016
80261			Construction Air Quality – Diesel Retrofit	June 1, 2010	Nov. 1, 2014
80387			Contrast Preformed Plastic Pavement Marking	Nov. 1, 2017	
80029	29	Х	Disadvantaged Business Enterprise Participation	Sept. 1, 2000	Mar. 2, 2019
80402	39	Χ	Disposal Fees	Nov. 1, 2018	
80378			Dowel Bar Inserter	Jan. 1, 2017	Jan. 1, 2018
80405			Elastomeric Bearings	Jan. 1, 2019	
* 80421	- 41	Х	Electric Service Installation	Jan. 1, 2020	
80415			Emulsified Asphalts	Aug. 1, 2019	
* 80423	43	X	Engineer's Field Office Laboratory	Jan, 1, 2020	
80388	46	Χ	Equipment Parking and Storage	Nov. 1, 2017	
80229			Fuel Cost Adjustment	April 1, 2009	Aug. 1, 2017
80417			Geotechnical Fabric for Pipe Underdrains and French Drains	Nov. 1, 2019	
80420			Geotextile Retaining Walls	Nov. 1, 2019	
80304			Grooving for Recessed Pavement Markings	Nov. 1, 2012	Nov. 1, 2017
* 80422			High Tension Cable Median Barrier Reflectors	Jan. 1, 2020	melligi ( ) and project ( ) an
80416			Hot-Mix Asphalt – Binder and Surface Course	July 2, 2019	Nov. 1, 2019
80398			Hot-Mix Asphalt – Longitudinal Joint Sealant	Aug. 1, 2018	Nov. 1, 2019
* 80406			Hot-Mix Asphalt – Mixture Design Verification and Production	Jan. 1, 2019	Jan. 2, 2020
			(Modified for I-FIT Data Collection)		
80347			Hot-Mix Asphalt – Pay for Performance Using Percent Within Limits – Jobsite Sampling	Nov. 1, 2014	July 2, 2019
80383			Hot-Mix Asphalt – Quality Control for Performance	April 1, 2017	July 2, 2019
80411			Luminaires, LED	April 1, 2019	July 2, 2013
80393	47	Х	Manholes, Valve Vaults, and Flat Slab Tops	Jan. 1, 2018	Mar. 1, 2019
80045	71	_^_	Material Transfer Device	June 15, 1999	Aug. 1, 2014
80418			Mechanically Stabilized Earth Retaining Walls	Nov. 1, 2019	7.ag. 1, 2017
* 80424	haddalaada dagaad Alamayaa daga		Micro-Surfacing and Slurry Sealing	Jan. 1, 2020	
80165			Moisture Cured Urethane Paint System	Nov. 1, 2006	Jan. 1, 2010
80412			Obstruction Warning Luminaires, LED	Aug. 1, 2019	Juli, 1, 2010
80349			Pavement Marking Blackout Tape	Nov. 1, 2014	April 1, 2016
80371	49	Х	Pavement Marking Removal	July 1, 2016	, ipin 1, 2010
80389	50	X	Portland Cement Concrete	Nov. 1, 2017	
	30				Nev. 4, 0040
80359			Portland Cement Concrete Bridge Deck Curing	April 1, 2015	Nov. 1, 2019

<u>File</u>	<u>Pg.</u>		Special Provision Title	<b>Effective</b>	Revised
<u>Name</u>				. "	A
80300			Preformed Plastic Pavement Marking Type D - Inlaid	April 1, 2012	April 1, 2016
80328	51	_X_	Progress Payments	Nov. 2, 2013	1 1 0000
34261			Railroad Protective Liability Insurance	Dec. 1, 1986	Jan. 1, 2006
80157			Railroad Protective Liability Insurance (5 and 10)	Jan. 1, 2006	
* 80306		į.	Reclaimed Asphalt Pavement (RAP) and Reclaimed	Nov. 1, 2012	Jan. 2, 2020
			Asphalt Shingles (RAS)		
* 80407	52	X	Removal and Disposal of Regulated Substances		Jan: 1, 2020
80419	63	Χ	Silt Fence, Ground Stabilization and Riprap Filter Fabric	Nov. 1, 2019	
80395			Sloped Metal End Section for Pipe Culverts	Jan. 1, 2018	
80340			Speed Display Trailer	April 2, 2014	Jan. 1, 2017
80127			Steel Cost Adjustment	April 2, 2014	Aug. 1, 2017
80408			Steel Plate Beam Guardrail Manufacturing	Jan. 1, 2019	
80413			Structural Timber	Aug. 1, 2019	
80397	66	Х	Subcontractor and DBE Payment Reporting	April 2, 2018	
80391	67	Х	Subcontractor Mobilization Payments	Nov. 2, 2017	April 1, 2019
80317			Surface Testing of Hot-Mix Asphalt Overlays	Jan. 1, 2013	Aug. 1, 2019
80298			Temporary Pavement Marking	April 1, 2012	April 1, 2017
80403			Traffic Barrier Terminal, Type 1 Special	Nov. 1, 2018	
80409	68	X	Traffic Control Devices - Cones	Jan. 1, 2019	
* 80410			Traffic Spotters	Jan. 1, 2019	
20338		Ballian College	Training Special Provisions	Oct. 15, 1975	
80318			Traversable Pipe Grate for Concrete End Sections	Jan. 1, 2013	Jan. 1, 2018
80288			Warm Mix Asphalt	Jan. 1, 2012	April 1, 2016
80302	69	X	Weekly DBE Trucking Reports	June 2, 2012	April 2, 2015
80414			Wood Fence Sight Screen	Aug. 1, 2019	
80071	70	X	Working Days	Jan. 1, 2002	

The following special provisions are in the 2020 Supplemental Specifications and Recurring Special Provisions.

<u>File</u>	Special Provision Title	New Location(s)	<u>Effective</u>	<u>Revised</u>
<u>Name</u> 80404	Coarse Aggregate Quality for Micro-Surfacing and Cape Seals	Article 1004.01(b)	Jan. 1, 2019	
80392	Lights on Barricades	Articles 701.16, 701.17(c)(2) & 603.07	Jan. 1, 2018	
80336 80400	Longitudinal Joint and Crack Patching Mast Arm Assembly and Pole	Check Sheet #36 Article 1077.03(b)	April 1, 2014 Aug. 1, 2018	April 1, 2016
80394 80390	Metal Flared End Section for Pipe Culverts Payments to Subcontractors	Articles 542.07(c) and 542.11 Article 109.11	Jan. 1, 2018 Nov. 2, 2017	April 1, 2018 April 1, 2017

The following Special Provisions supplement the "Standard Specifications for Road and Bridge Construction" adopted, April 1,2016, the latest edition of the "Illinois Manual on Uniform Traffic Control Devices for Streets and Highways" and the "manual for Test Procedures for Materials" in effect on the date of invitations for bids, and the "Supplemental Specifications and Recurring Special Provisions" adopted, January 1, 2020, indicated on the Check Sheet included herein which apply to and govern the construction of section number 13-00055-00 SW, in the City of Shelbyville, Shelby County, State of Illinois, and in case of conflict with and parts of said specifications, the Special Provisions shall take precedence and shall govern.

#### **LOCATION OF WORK:**

The work included in Section 13-00055-00 SW is located along Illinois Route 16 (Main Street) from Broadway Street East to Washington Street in the City of Shelbyville, State of Illinois.

#### **DESCRIPTION OF WORK:**

This project consist of all construction activities related to the removal and replacement of Sidewalks, Curbs and Gutters, ADA ramps, storm sewer; installation of street and pedestrian lights, Unit Pavers, Pavement markings, contractor layout, traffic signal modifications, business entrance ramps along with other items of work shall be included in the contract to complete this section.

#### PROJECT PREPARATION:

Prior to beginning any portion of the project, the Contractor shall video the existing conditions for the entire length of the project. The video shall be in DVD format and shall be turned over to the Engineer and City before any construction activity.

This requirement shall be considered included in the contract and no additional compensation will be allowed.

### TRAFFIC CONTROL, CONSTRUCTION STAGING AND COORDINATION WITH RESIDENTS AND BUSINESSES:

#### 1. Traffic Control Plan:

Traffic control shall be in accordance with the applicable sections of the Standard Specification for Road and Bridge Construction, the applicable guidelines contained in the Illinois Manual of Uniform Traffic Control Devices for Streets and Highways, these Special Provisions, and any Special Details and Highway Standards contained herein and in the contract plans and standard specifications for traffic control items.

Traffic: One lane in each direction shall remain open at all times. Special attention is called to Articles 107.09, 107.14 and Section 701 of the Standard Specifications for Road and Bridge Construction, the Highway Standard in the plans, Special Provision LRS 4 Flaggers in Work Zones and other Special Provisions Relating to traffic control.

 Traffic Control and Protection required under the following standards will be considered as included in the contract price and will not be measured for payment and no additional compensation will be allowed the contractor.

Standard	701001
Standard	701006
Standard	701301
Standard	701311
Standard	701901

Traffic Control and Protection required under the following standards will be paid for at the contract unit prices for the related standards.

Standard	701501
Standard	701502
Standard	701801

- All sidewalks within the project limits shall be closed using Standard 701801 as directed by the Engineer.

The contractor shall use Standard 701501 for all the removals and replacements along Illinois RT. 16

- Typical applications using Standard 701301 or 701502 in this contract include the following operations:
  - Core Drilling
  - String Lining
  - Sawing
  - Layout
- Typical applications using Standard 701311 in this contract include the following operations:
  - Pavement Markings
- Infrequently, personnel working on this project may do layout or inspection outside the limits of Traffic Control and Protection provide during various contractors' operation.

In order to provide adequate Traffic Control and Protection during the layout and inspection, the contractor shall furnish signs, barricades, flagmen, and other necessary traffic control items as directed by the Engineer. This work will be paid in accordance with Article 109.04.

#### 2. Construction Staging

The Contractor shall stage the construction of this project to meet the requirements of this special provision and as directed by the Engineer. This plan described in this special provision is intended to be

a guide for the anticipated sequence of work. The Contractor will be responsible for developing substages within the described stages as necessary to complete the work.

It is the desire of the City for the construction to take place in the most efficient manner while addressing the needs of the affected businesses, residents, the public and the City. Deviations from this plan must be in the best interest of all affected parties and will only be allowed with prior written approval by the Engineer.

All major items of work shall be completed on one side of the street prior to beginning work on the opposite side within the same block. Parking may be blocked off for required work space on the side of the block that is being worked on. Parking shall be maintained on all blocks not being worked on.

The proposed sequence of work is as follows: A detailed Plan from the Contractor shall be submitted at the pre-job meeting for approval.

- Curb and Gutter and Storm Sewer removal and replacement
- Street and Pedestrian Lighting installation
- Sidewalk removal and replacement and Unit Paver installed
- Final Pavement marking

**NOTE:** See lighting for additional staging requirements

#### 3. Cooperation and Control of Work

In addition to the requirements of Section 105, the Contractor shall make every effort to communicate their schedule and proposed construction activities to affected business owners on a daily basis. The Contractor shall identify a single person, on the work site at all times, to act as the liaison between property owners, residents, business owners, the City and the Contractor. This person shall have full authority from the Contractor to negotiate access matters with all parties and shall meet the approval of the City. The Contractor shall meet with all business owners in each block a minimum of 5 days prior to beginning work in that block to advise them of the proposed schedule. The Contractor's liaison shall meet with business owners and residents affected by the work weekly to keep them updated on the actual construction progress.

Residents and businesses shall have 24 hour access to their property. A list of local residents and businesses will be supplied by The City of Shelbyville to the contractor for this purpose. The arrangements may include but are not limited to parking on the other side of the road, parking in alleys, placing temporary entrances or leaving a gap in the sidewalk for resident ingress and egress.

The City shall have the authority to require the Contractor to replace this liaison should the City be dissatisfied with their performance for any reason. If required by the City, the Contractor shall designate a new liaison within 5 working days, meeting the approval of the City.

#### 4. Pedestrian Access

The Contractor shall provide and maintain temporary access for businesses and residents within the project limits at all times meeting the requirements of the Illinois Accessibility Code. This requirement shall also apply to temporary connections between new construction and existing surfaces. Access shall be provided to the buildings via their main entrances continuously throughout the project duration

unless the Contractor makes other arrangements with the affected parties in writing and those written agreements are approved in advance by the Engineer. The Contractor shall provide copies of all written agreements to the Engineer prior to beginning work in these locations. The Contractor shall make every effort to minimize the length of time any such entrance is impacted during construction of the project. The Contractor shall stage the construction to ensure no entrance requires temporary access bridges or structures for more than 10 consecutive calendar days. Temporary pedestrian access shall meet all the requirements of the Illinois Accessibility Code.

The Contractor shall provide and maintain access to all businesses within the project limits at all times during regular business hours. Regular business hours shall be defined as the hours of each affected business for the duration of the project. The Contractor shall coordinate any temporary removal of access during non-business hours with the business owner a minimum of 24 hours in advance.

The Contractor shall provide and maintain access to all residential properties within the project limits.

#### 5. Temporary Connections

The following shall apply in addition to the requirements of Article 107.09. The Contractor shall make temporary connections to allow vehicular and pedestrian travel between the various stages and blocks under construction. Pedestrian access and connections shall meet Illinois Accessibility Codes requirements. The Contractor shall place aggregate and/or plywood bridges at these temporary connections to maintain vehicular and pedestrian access. Aggregate for connections shall meet the requirements of Section 402 of the Standard Specifications for Road and Bridge Construction. A nominal quantity of 50 tons has been allocated to the project to establish a unit price.

TRAFFIC CONTROL, CONSTRUCTION STAGING AND COORDINATION WITH RESIDENTS AND BUSINESSES will not be measured for payment. The cost of this work shall be included in the unit prices bid for the various traffic control standards and no additional compensation will be allowed.

#### AGGREGATE SURFACE COURSE, TYPE B

Aggregate for temporary access to businesses and residences shall be measured in tons and paid for at the contract unit price in tons as AGGREGATE SURFACE COURSE, TYPE B the cost of which shall include all labor, materials and equipment to install and removal to complete the work.

#### CONSTRUCTION LAYOUT AND STAKING

This work shall consist of construction staking according to Article 105.09 of the "Standard Specifications for Road and Bridge Construction" and Check Sheet #10, except as modified herein.

The Local Agency will provide reference points to the centerline of survey and bench marks as shown on the plans and listed herein. All additional control points as outlined in the following that are set by the Local Agency will be identified in the field to the Contractor and a copy of all field notes will be given to the Contractor.

Other than outlined in the following under "Responsibility of the Local Agency", the Contractor shall provide all labor, equipment and material necessary to secure a correct layout.

The Contractor shall be responsible for having the finished work conform to the lines, grades, elevations and dimensions called for on the plans. Inspection or checking of the Contractor's layout by the Engineer and the acceptance of all or any part of it shall not relieve the Contractor of his/her

responsibility to secure the proper dimensions, grades and elevations of the several parts of the work. The Contractor shall exercise care in the preservation of stakes and benchmarks and shall have them reset at his/her expense when any are disturbed.

#### Responsibility of the Local Agency

- Removal limits will be marked by painting or setting lathes.
- Control points referenced to the survey Baseline will be provided at intervals not exceeding 500 feet.
- Beginning and end of each section of improvement will be marked
- · Centerline of intersecting roadways will be marked
- Bench marks will be established along the project outside of the construction limits lines not exceeding 500 feet intervals horizontally and 20 feet vertically.
- Drainage structures will be marked to establish the proposed horizontal and vertical locations of the drainage system.
- At the completion of the removal and grading operations, stakes will be set at 25 feet intervals at an offset distance to the proposed back of curb as directed by the Contactor.
- Light pole foundation locations will be marked to establish the proposed horizontal positions.
   The Contractor will be responsible for the top finish grade of foundation to match surrounding grades.
- The Local Agency will accept responsibility for the accuracy of the initial control points and stakes as provided herein. The Contractor shall assume full responsibility for all dimensions and measurements taken or derived by the Contractor from control points or stakes set by the Local Agency. It is not the responsibility of the Local Agency, except as provided herein, to check the correctness of the Contractor's stakes.

#### Responsibility of the Contractor

- In order to adequately address construction staking scheduling, the Contractor shall provide
  written requests for all marking to be provided by the Local Agency. A minimum of 72 hour
  advance notice will be required prior to the commencement of all requested activities.
- The Contractor shall establish from the given survey points and bench marks, all additional
  elevations, grades, etc. not covered in the "Responsibility of the local Agency" section above as
  necessary to construct the individual project elements. It is the Contractor's responsibility to
  preserve all control points and bench marks provided by the Local Agency during construction
  activities.
- The Contractor shall provide all additional layout and staking not covered in the "Responsibility
  of the local Agency" section above as required to assure completion of the work in substantial
  conformance with the plans.
- The Contractor shall be responsible for re-establishing all stakes removed or disturbed by construction operations.

- In addition to the above: Special attention should be noted as follows: the Contractor is responsible for staking and layout for sidewalks, building entrances and curb ramps to comply with ADA standards in accordance with the plans and standards. The elevations on the plans are to be used as a guide to meet the longitudinal slope ratios and cross-slope ratios as detailed on the standards to meet ADA (see Standard 424001; 424006; 424011; 606001). The elevations for curb ramps shown on the plans may need to be adjusted to meet the Standards for running slopes and cross slopes.
- All work shall be according to normally accepted self-checking surveying practices. Field
  notebooks and those books shall become the property of the Department at the completion of
  the project. All notes shall be neat, orderly and in accepted form.

The cost to comply with this special provision shall be a lump sum included in the cost for CONSTRUCTION LAYOUT. No additional compensation is allowed for adjusting elevations in the field of sidewalk, ramps, and other pay items noted in the plans to comply with ADA requirements.

#### **SAW CUTTING (FULL DEPTH)**

This work shall consist of saw cutting pavement between existing pavement, gutters and/or combination curb and gutter, sidewalks and against buildings (where required). The saw cut and removal shall be in accordance with Section 440 of the Standard Specifications for Road and Bridge Construction. The Contractor shall take care not to damage, discolor or dirty adjacent private property. Any such damage or physical affect shall be repaired and/or remedied at the Contractor's expense.

This work shall not be measured for payment separately and will be considered as included in the pay item(s) for which the work is being performed.

#### **MAILBOXES:**

Whenever existing mailboxes or mail delivery interfere with construction operations, they shall be carefully removed and immediately reset at their temporary location as determined by the Engineer, the US Postal Service, and the affected postal customer. Then upon completion set at their permanent location. Any mailboxes or posts damaged during construction shall be replaced at no cost to the satisfaction of the Engineer and property owner.

The Contractor will be responsible to see that all mail be delivered to all affected residents and businesses. Special arrangements may need to be made with individual property owners.

This work will not be paid for separately, but shall be considered included in the cost of the contract pay items and no additional compensation will be allowed the contractor.

#### **TRASH PICKUP:**

The contractor shall assure that all residents and businesses continue to receive their weekly trash pickup. This may mean the contractor may have to pick up the trash and take it to a central location. The contractor will be required to coordinate with the residents, and businesses and the trash haulers to comply with this special provision.

The cost to comply with this special provision shall be included in the cost of the contract and no additional compensation shall be allowed.

#### **OVERHAUL:**

No payment for overhaul will be allowed for earth moved to or from any source.

#### **BORROW AREAS; USE AREAS, AND/OR WASTE AREAS:**

In addition to the provisions contained in Article 107.22 of the Standard Specifications, any required submittal(s) to the District office shall require four (4) copies sent for processing. All copies of pictures submitted shall be in color.

#### **PAVEMENT MARKINGS:**

The contractor shall give 3 days notice to the Engineer prior to application so proper layout may be performed. This is to be included in the contract unit price and no additional compensation shall be allowed.

#### **REMOVAL OF UNCLASSIFIED MATERIAL:**

Unclassified material shall be removed at the locations shown on the plans and as designated by the Engineer. The removed material shall be disposed of beyond the limits of the Right-of-Way in accordance with Article 202.03 of the Standard Specifications and as directed by the Engineer.

The above work will not be paid for separately, but shall be considered as included in the cost of the contract, and no additional compensation will be allowed the contractor.

#### **COARSE AGGREGATE GRADATION CA-6:**

Coarse Aggregate gradation CA-10 may be used whenever coarse aggregate CA-6 is specified in the Standard Specifications.

#### **REMOVAL OF EXISTING PIPES AND INLETS:**

Existing Pipes and inlets shall be removed by the contractor.

Locations where the Existing Pipes or Existing Inlets are not going to have proposed pipes or inlets to replace them, shall be backfilled with Trench Backfill Material. The Trench Backfill Material shall be placed in lifts not exceeding 8 inches loose measurement and compacted by mechanical means to the satisfaction of the Engineer.

The removal of the Existing Pipes and Inlets and Trench Backfill Materials required by this Special Provision shall be included in the cost of the storm sewer pipe and inlet pay items and no additional compensation will be allowed. This shall include all Labor, Equipment, and Materials required to complete this special provision.

#### **MANHOLES AND INLETS:**

The contractor shall submit shop drawings for all Manhole Structures to the office of the City Engineer for review and approval prior to the beginning of their constructed.

#### **JOINT UTILITY LOCATING INFORMATION FOR EXCAVATORS:**

J.U.L.I.E.: Joint Utility Locating Information for Excavators. The contractor's attention is directed to the fact that there exists within the State of Illinois a Joint Utility Locating Information for Excavators (J.U.L.I.E.) System

Instead of the contractor notifying each individual utility owner that he will be working within the area, it will only be necessary to dial the number of the Joint Utility Information for Excavators Systems, which is (800) 892-0123. A minimum of forty-eight hours advance notice is required and the political name of the township where the work is located, as shown on the cover sheet, along with other location information such as land section and quarter section.

#### PRECAUTIONS FOR UTILITIES:

The Standard Specifications and Supplemental Specifications shall apply for any adjustment of utilities located at the project. The contractor shall take whatever precautions which may be necessary to protect the property of the various public utilities which may be located underground or above ground, at or adjacent to the site of this improvement. He will be required to repair or replace, any public utility property, which has been damaged through his efforts. The procedure and specifications of repair will be in accordance with the regulations and/or policy of the utility. Names and addresses of known utility companies have been shown in the Plans and Special Provisions for the convenience of the contractor.

#### **UTILITIES:**

THE ONLY UTILITIES KNOWN TO BE ON THIS PROJECT ARE AS FOLLOWS:

1. TELEPHONE CONSOLIDATED COMMUNICATIONS (\*\*) (\*\*\*)

121 SOUTH 17TH STREET

MATTOON, ILLINOIS 61938

217-234-9971

2. GAS AMEREN CIPS (\*\*) (\*\*\*)

711 SOUTH 9TH STREET MATTOON, ILLINOIS 61938

3. POWER AMEREN CIPS (\*\*) (\*\*\*)

420N 2400 EAST ROAD

PANA, ILLINOIS 62557

4. WATER CITY OF SHELBYVILLE ILLINOIS (\*\*) (\*\*\*)

**151 SOUTH MORGAN STREET** 

#### SHELBYVILLE, ILLINOIS 62562

5. SEWER

CITY OF SHELBYVILLE ILLINOIS (\*\*) (\*\*\*)

**151 SOUTH MORGAN STREET** 

SHELBYVILLE, ILLINOIS 62565

6. CABLE TV

**Newwave Communication** 

Taylorville, Illinois

(\*\*) J.U.L.I.E. MEMBER

(\*\*\*) POSSIBLE RELOCATION DURING CONSTRUCTION

FOR JOINT UTILITY INFORMATION CALL, 1-800-892-0123

ALL UTILITY ADJUSTMENTS ARE TO BE MADE BY OTHERS

The above represents the best information of the department and is only included for the convenience of the bidders. The applicable provisions of Articles 102.05, 105.07, 107.20 of the Standard Specifications for Road and Bridge Construction and BLR 105 shall apply.

If any utility adjustment or removal has not been completed when required by the contractor's operations, the contractor should notify the Engineer in writing. A request for an extension of time will be considered to the extent that the contractor's operation was affected.

#### MANHOLES TO BE ADJUSTED:

This work shall be done after the placement of the driveways or sidewalk is completed.

The manholes will be cross tied by the Engineer and the contractor prior to start of construction.

The contractor shall saw-cut the pavement 24 inches in each direction of the outer edge of the casting and remove the pavement full depth.

The manholes shall be adjusted to grade and Class PP2 concrete poured around the casting. The Class PP2 concrete shall have 735 pounds of Portland Cement in one cubic yard and have a finish that matches the pavement already placed. The adjustment of the manholes shall be paid for at the unit price per each for Manholes to Be Adjusted. This unit price shall include all work required by this special provision and the contract plan details and no additional compensation will be allowed the contractor.

#### HISTORIC MANHOLE COVERS AND PLAQUE REMOVAL AND REPLACEMENT

There are four historic manhole covers and one ornamental plaque located in the existing sidewalk. They shall be removed and replaced in the locations designated by the engineer.

The above work will not be paid for separately, but shall be considered as included in the cost of the contract, and no additional compensation will be allowed the contractor.

#### **DOMESTIC METER VAULTS TO BE ADJUSTED**

This work shall consist of adjusting water service boxes to match the proposed grades as indicated on the plans and shall be in accordance with Section 565. Any existing vaults damaged as part of the pavement removal, sidewalk removal or adjustment work shall be replaced with new vaults of the same kind as, or equal to, the damaged vaults at no additional cost to the contract.

This work shall be paid for at the contract unit price each for DOMESTIC METER VAULTS TO BE ADJUSTED. Excavation, backfill, new risers, adjusting rings, all hardware, labor and equipment necessary to complete the work shall be considered as included in the unit price bid.

#### PORTLAND CEMENT CONCRETE SIDEWALK 5 INCH

This work consists of constructing new concrete sidewalks as shown on the plans. All Sidewalks shall be a minimum of 5 inches in thickness. Existing sidewalks adjacent to the existing buildings where the building face rests on the sidewalk will require saw cut full depth approximately 4 to 6 inches from the building face. Building fronts must be protected from saw cutting operations. All sidewalks shall be constructed in accordance with applicable portions of Section 424 of the Standard Specifications for Road and Bridge Construction and shall meet ADA requirements (see standards).

The top of sidewalk elevation at the Private Business walls and Door entrances shall match existing with the exception of those shown on the plans to have a step removed and replaced with a step and for those shown on the plans to have a step removed and replaced with a ramp. The thickness of the ramps and steps shall be increased as required to match the thickness of the adjacent 5 inch sidewalk.

All SIDEWALK REPLACEMENT shall have four (4) inches of fine aggregate bed placed under it and shall be included in cost of the related items of work and no additional compensation will be allowed. Joints shall be spaced in accordance with the Standard Specifications but in no situation shall the spacing exceed 25 square feet in area.

The Contractor shall provide sign post sleeves for handrails at locations indicated on the plans or as directed by the Engineer. Sleeves shall be 4 inch diameter schedule 40 PVC and be 1 foot in length.

Ramped entrances to business entrances as shown on the plans shall meet American Disability Act requirements for maximum longitudinal slopes of 8.3%, maximum cross slopes of 2% (see standards), handrails, steps, landings and turning spaces. This includes the elimination of some existing business steps as indicated on the plans.

The Contractor shall construct concrete CURB WALL at the locations shown in the plans. This work shall be accomplished in accordance with applicable portions of Section 606 of the Standard for Road and Bridge Construction and the details shown in the plans.

The Contractor will provide layout and staking for this work item (including curb ramps and building entrance ramps). The Contractor is responsible for complying ADA requirements for the sidewalk and curb ramps in accordance with the Standards and as shown on the Plans. This work shall be measured for payment in accordance with Article 424.12 except that earth excavation, sign post sleeves, joint patterns, curb walls, curb ramps at intersections, expansion joint material, steps, welded wire fabric, and ramped entrances to existing buildings shall be included in this pay item and shall not be measured for payment.

This work shall be paid for at the contract unit price per square foot for PORTLAND CEMENT CONCRETE SIDEWALK 5 INCH of the thickness specified which price shall include all labor and material to complete this work.

#### **WELDED WIRE FABRIC 6X6:**

Welded wire fabric 6 X6 shall be placed at locations shown in the plans and as directed by the engineer.

All welded wire fabric shall be W 4.0 X W 4.0 weighing 58 # / 100 sq. ft.

The cost of all labor, equipment and materials required to comply with this special provision shall be included in the contract unit price per sq. yd. for Welded wire fabric 6 X6.

#### **CURB STOPS**

Curb Stops of the size specified shall be install at locations shown in the plans.

All Curb Stops shall be install as shown in the plan details and EPA Standard Number 17.

The cost of all labor, equipment and materials required to comply with this special provision shall be included in the contract unit price per Each for CURB STOPS of the size specified.

#### **UNIT PAVERS**

This work shall consist of the placement of unit pavers according to Check Sheet #14 and the following.

Description: This work applies to unit pavers within the pedestrian areas and consists of preparation of subbase, preparation of aggregate base course, concrete side curbs and base slab with weep holes, setting sand and concrete unit pavers.

#### **Submittals:**

- (a) The following items shall be submitted and approved prior to operations: information about proposed unit pavers, samples: minimum of 2 pavers representing full range of paver coloration and list of equipment anticipated for the work.
- (b) The following items shall be submitted during operations: concrete load tickets and concrete sample test results.

**Warranty:** For a period of two years following acceptance of project contractor shall warranty against paver shifting, settling or other irregularities and paver breakage, sparling or other material failure.

#### **Products:**

#### (a) Unit Pavers

Unit pavers shall be rectangular pavers of nominal dimension 4" x 8" x 2-3/4" with beveled edges and spacer lugs. Unit Pavers shall be Holland Premier Heritage Brown – Premier Series as manufactured by Unilock, 301 E. Sullivan Road, Aurora, IL 60504, 630-892-9191.

- (b) Setting sand shall be fine crushed stone aggregate gradation FA-08 in compliance with IDOT Standard Specifications Section 1003, Fine Aggregate.
  - (c) Base shall be Portland cement concrete type SI.

#### **Construction Requirements:**

- (a) Time of operation. Pavers shall be installed when the base can be properly prepared and when setting sand is dry.
- (b) Concrete base shall include the following in accordance with Section 424, PC Concrete Sidewalk:

Preparation of Grade

Installation and compaction of sub-base

Installation of concrete base

Concrete Base shall have weep holes for drainage as shown on the plans.

(c) Setting Sand.

Setting Sand shall be placed over concrete base to a fluffed-up thickness of  $\frac{1}{2}$ " minimum to 1" maximum. Sand shall be screeded over entire area to provide a smooth and uniformly sloped surface.

(d) Unit Pavers.

Pavers shall be set on an area of freshly screeded sand. It is recommended that an area of pavers be installed and vibrated in place the same day. Pavers shall be set according to manufacturer's recommendation in patterns shown on plans.

This work will be measured for payment in place and the area computed in square feet. Only the area of the brick payers shall be measured for payment.

This work will be paid for at the contract unit price per square foot for UNIT PAVERS of the type and color specified in this special. This unit price shall include all aggregate base course, concrete base slab, weep holes, setting sand, unit pavers and P.C.C. edging required for the construction of the unit

pavers as shown on the plans and as outlined in this special provision and no additional compensation will be allowed.

#### **DRIVEWAY, PAVEMENT, GUTTER, AND CURB REPLACEMENT:**

This work shall be done in accordance with the applicable portions of the Standard Specifications for Road and Bridge Construction, and this special provision.

Any and all excavation and fill necessary to construct these items to grade shall be included in cost of the related items of work and no additional compensation will be allowed.

All DRIVEWAY, PAVEMENT, GUTTER, AND CURB REPLACEMENT shall have six (6) inches of Aggregate Base Type A placed under it and shall be included in cost of the related items of work and no additional compensation will be allowed.

All concrete for DRIVEWAY, PAVEMENT, SIDEWALK, GUTTER, AND CURB REPLACEMENT, shall be Class PV.

#### **SIDEWALKS THRU DRIVEWAYS:**

Sidewalks that go through driveways shall be thickened to six (6) inches in accordance with Section 424.04 of the Standard Specifications for Road and Bridge Construction and shall be poured separate from the adjacent driveway (i.e. it is not acceptable to pour the sidewalk monolithic with the driveway pavement).

This cost shall be included in cost of the pay item called PORTLAND CEMENT DRIVEWAY and no additional compensation will be allowed the contractor.

#### TREE GRATES:

This work shall consist of furnishing all materials, labor and equipment necessary to install tree grates and frames with concrete tree grate collars at the locations shown on the plans and as directed by the Engineer.

Prior to commencement of operations, the Contractor shall submit for approval

- Cut sheets for tree grates and frames
- Manufacturer's product warranty

Tree grates shall be 2-piece, 48" x 72" with 18" openings. 3/8" maximum slot openings for ADA requirements. Grate Model R-8815-1 and Frame to fit grate as manufactured by Neenah Foundry Company. Each grate shall contain one circular plug out grate for underground lighting.

The work will be paid for at the contract unit price each for TREE GRATES, which price shall include concrete collars, iron frames and grates, labor and equipment and installation and no additional compensation will be allowed.

#### **PIPE HANDRAIL**

This work shall consist of furnishing and installing Pipe Handrail at locations designated in the plans in accordance with Handrail Detail and Section 509 METAL RAILINGS of the Standard Specifications except as modified herein.

Connection of steel rail balusters to railing shall be by the use of welding. Welded joints shall be continuous, and welded surfaces shall be ground smooth. Pipe Handrail shall have a top coat color of Semi-Gloss Black. The proposed coating system shall be submitted to the Engineer for approval prior to the start of fabrication.

Pipe Handrail shall be smooth to the touch without sharp edges or spurs. Areas not approved by the Engineer shall be repaired at the expense of the Contractor.

Pipe Handrail damaged during transport or installation shall be repaired or replaced at the expense of the Contractor.

This work will be paid for at the contract unit price per FOOT for PIPE HANDRAIL and shall include all labor, material, and equipment for a complete installation.

#### **PREPARATION / RESTORATION OF SITE:**

It shall be the responsibility of the contractor to remove and replace all obstructions necessary to construct this project. This shall include, but not be limited to, rocks, tree roots, decorative rock, stumps, rubbish rubble or any other obstruction to construction. This will be included in the contract and there will be no additional compensation allowed for removing obstructions. Tree trimming required for construction of this improvement shall be provided by the contractor and approved by the city and engineer at no additional cost to the project.

Vertical cutting of tree trunks will not be allowed. Pruning of roots greater than one inch diameter, which are in conflict with the proposed construction shall be cut subject to approval of the engineer.

All excavated areas shall be backfilled within seven (7) calendar days. Items removed shall also be replaced within seven (7) calendar days.

#### PEDESTRIAN PUSH-BUTTON

This work shall consist of furnishing and installing pedestrian pushbuttons of the type specified in accordance with Section 888 and Article 1074.02 of the Standard Specifications except as modified herein.

The pushbuttons shall meet ADA requirements. All pedestrian pushbuttons shall have a round case and be equipped with a 2" diameter button for easy access.

The pedestrian pushbuttons shall have a yellow housing and shall utilize a sloid state switch or reed relay.

The following model is approved for use within the District: Polara Bulldog model BDSP-010.

The pedestrian pushbutton installation shall include all crossing signs and hardware required to mount the pedestrian pushbutton. All hardware shall be of stainless steel construction. All bolts shall be ¼" Hex Head and no self-tapping/drilling screws will be allowed. Anti-seize paste shall be installed on all fasteners.

The following pedestrian pushbuttons signs currently meet Department Specifications: Pelco, Models SF-1073-11, SF-1074-11 or approved equivalent. This work will be paid for the contract unit prices Each for PEDESTRIAN PUSH-BUTTON and shall include all labor, material, and equipment for a complete installation.

#### LED SIGNAL FACE RETROFIT 12" COUNTDOWN TIMER

This work shall consist of furnishing and installing specified in accordance with Section 895 of the Standard Specifications except as modified herein.

The LED pedestrian face retrofit 12" countdown timer shall be state approved and conform to the following:

The LED pedestrian and countdown signal face retrofit shall not require special tools for installation. The signal face retrofit shall be weather tight, fit securely in the existing housing, include an installed gasket and connect directly to the existing electrical wiring.

Pedestrian signals shall consist of Portland orange numbers that are at least 9 inches in height on a black opaque background. The "hand" shall be Portland Orange. The walking person shall be lunar white The countdown pedestrian signal shall be located immediately below the upraised hand/walking man.

The lenses and shell material of the LED retrofit shall be UV stabilized polycarbonate with a min thickness ¼".

All internal LED and electric components shall be adequately supported to withstand mechanical shock and vibration from high winds and other sources.

The LED pedestrian and countdown signal face retrofit shall be rated for use in the ambient operating temperature range of -40 F to +140 F.

The LED pedestrian and countdown signal face shall be designed to attract the attention of and be readable by a viewer (both day and night) at all distances in the area to be crossed.

The countdown pedestrian signal shall display the number of seconds remaining until the termination of the pedestrian change interval (flashing upraised hand). Countdown displays shall not be used during the walk interval or during the red clearance interval of the concurrent vehicular phase.

This work will be paid for the contract unit price Each for LED SIGNAL FACE RETROFIT 12" COUNTDOWN TIMER and shall include all labor, material, and equipment for a complete installation.

#### MAINTENANCE OF EXISTING TRAFFIC SIGNAL INSTALLATION:

This work shall be in accordance with Section 850 of the Standard Specifications with the following additions: The Contractor shall not be required to maintain the existing detector loops at each location. The Contractor shall be allowed 1 working day per traffic signal location to turn off the traffic signals to re-connect the signals to the controller as shown in the plans. During the time the traffic signals are not in operation flagmen and appropriate traffic control devices shall be supplied as approved by the Engineer.

#### HANDHOLE / DOUBLE HANDHOLE:

This work shall consist of furnishing and installing a handhole or double handhole in accordance with Section 814 and Articles 1088.05 of the Standard Specifications except as described herein.

The handhole shall be constructed of composite concrete. The nominal dimensions of the handhole shall be a minimum  $17''(W) \times 30''(L) \times 36''(D)$  and the nominal dimensions of the double handhole shall be a minimum  $30''(W) \times 48''(L) \times 36''(D)$ .

The cover shall contain the legend "TRAFFIC SIGNALS" and shall be held down by two stainless steel hex head bolts. The cover shall contain 2 recessed lift pins. The cover for a double handhole shall be a split lid, two-piece cover.

This work will be paid for at the contract unit price EACH for HANDHOLE or DOUBLE HANDHOLE, COMPOSITE CONCRETE and shall include all labor, material, and equipment for a complete installation.

#### LIGHTING STANDARD, TYPE 4B (STREET LIGHT AND POLE)

The light poles shall be designed and installed in accordance with details in the plans and Section 830 of the Standard Specifications except as modified herein. The light poles shall be round tapered smooth steel Sternberg model 78/35'6"/S/RTS/RSB4/GFI/DBA/BKT with a mast height as shown on the plans.

Ballasts for the lighting fixtures shall be Advance or equal, high pressure sodium ballasts, Catalog No. 71A8071 for 100 watt luminaires and Catalog No. 71A8171 for 150 watt luminaires. Ballasts shall be multi tap or 240 volt.

All poles shall include a reinforced hand hole with cover not less than 3" x 8" and the hand holes shall be located on the backside of the pole away from the street. The hand hole cover shall be attached by stainless steel allen head screws. All poles shall be pre-wired to conform to the National Electric Code.

Each pole shall be provided with a ground lug or stud accessible through the hand hole.

Poles shall be furnished with bolt covers.

Each pole shall be equipped with a single or double 4' Sternberg CCA modified roadway arm, hang straight arm coupling, Sternberg model 1914FG/CCA4(MOD) 150 watt high pressure sodium fixture, clear flat tempered lens, roof optics, type 3 with 31" diameter shade Sternberg model RLM431.

The pole shall be Sternberg Williamsburg 7800 style base and shall include four anchor bolts and one ground lug, a post center cap, and shall be black textured finish.

The pole foundation shall be of the size and depth detailed in the plans and shall be paid for as Light Pole Foundation, Special. The pole shall be equipped with a banner bracket. The bracket shall be spaced 4' distant and the bottom bracket shall be 16' above grade. The pole shall be equipped with a 15 amp duplex GFCI receptacle with a weatherproof cover to be located 15' above grade.

This work will be paid for at the contract unit price EACH for LIGHTING STANDARD, TYPE 4B and shall include all labor, material, and equipment for a complete installation.

#### LIGHTING STANDARD, TYPE 4A (PEDESTRIAN LIGHT & POLE)

The light poles shall be designed and installed in accordance with details in the plans and Section 830 of the Standard Specifications except as modified herein. The light poles shall be round tapered smooth 5" to 3" aluminum Sternberg model 36/12/T5/BCC/GFI/BKT with a fixture height as shown on the plans.

Ballasts for the lighting fixtures shall be Advance or equal, high pressure sodium ballasts, Catalog No. 71A8071 for 100 watt luminaires and Catalog No. 71A8171 for 150 watt luminaires. Ballasts shall be multi tap or 240 volt.

All poles shall include a reinforced hand hole with cover not less than  $3'' \times 8''$  and the hand holes shall be located on the backside of the pole away from the street. The hand hole cover shall be attached by stainless steel allen head screws.

All poles shall be pre-wired to conform to the National Electric Code.

Each pole shall be provided with a ground lug or stud accessible through the hand hole.

Poles shall be furnished with bolt covers.

Each pole shall be equipped with a Sternberg A850/5TPT 100 watt high pressure sodium fixture, textured poly acorn lens, type 3 optics.

The pole shall be Sternberg Williamsburg 3600 style base and shall include four anchor bolts and one ground lug, a ball center cap, and shall be black textured finish.

The pole foundation shall be of the size and depth detailed in the plans and shall be paid for as Light Pole Foundation, Special.

This work will be paid for at the contract unit price EACH for LIGHTING STANDARD, TYPE 4A and shall include all labor, material, and equipment for a complete installation.

#### LIGHTING CONTROLLER, PEDESTAL MOUNTED, 240 VOLT, 60 AMP

The lighting controller shall be as detailed in the plans and in accordance with Section 825 of the Standard Specifications except as modified herein.

Lighting and appliance branch circuit panelboards: NEMA PB1; circuit breaker type.

Enclosure: NEMA PB1; type 3R. Surface mounted cabinet. Finish in manufacturer's standard gray enamel.

Provide panelboards with copper bus, ratings as shown on Drawings.

Minimum Integrated Short Circuit Rating: 10,000 amperes RMS symmetrical for 120/240 volt panelboards

Molded Case Circuit Breakers: NEMA AB 1; bolt on type thermal magnetic trip circuit breakers, with common trip handle for all poles. Provide circuit breakers listed by a Nationally recognized testing laboratory as Type SWD for lighting circuits. Provide Class A ground fault interrupter circuit breakers listed by a nationally recognized testing laboratory where scheduled on Drawings. Do not use tandem circuit breakers.

Provide typed directory in panel.

This work shall be paid for at the contract unit price EACH for LIGHTING CONTROLLER, PEDESTAL MOUNTED, 240 VOLT, 60 AMP and shall include all labor, material, and equipment for a complete installation.

#### LIGHT POLE FOUNDATION, SPECIAL

The concrete foundation for the Lighting Standard, Types 4A & 4B shall be as detailed in the plans and in accordance with Section 836 of the Standard Specifications.

This work shall be paid for at the contract unit price EACH for LIGHT POLE FOUNDATION, SPECIAL and shall include all labor, material, and equipment for a complete installation.

#### MAINTAIN EXISTING LIGHTING SYSTEM

The contract shall maintain the existing street lighting within the project as described in the Lighting Plans.

This work shall not be paid for separately but should be included in the contract unit price each for Light Standard, Type 4A and 4B.

### REMOVAL OF EXISTING LIGHTING SYSTEM

The existing street lighting shall be removed as described in the Lighting Plans. The Contractor shall coordinate the removal with Ameren Illinois. Ameren Illinois shall remove the luminaires, poles and wiring.

There are various items of work included in the Demolition Plan included in the plans. Unless otherwise specified all labor, material and equipment needed to complete the demolition work shall not be paid for separately but should be included in the contract unit price each for Light Standard, Type 4A and 4B.

The Contractor shall remove all light pole foundations, including conduits, wires, etc., in accordance with Section 842 of the Standard Specifications. This work shall be paid for at the contract unit price EACH for REMOVAL OF POLE FOUNDATIONS and shall include all labor, material, and equipment for a complete removal.

### **ELECTRICAL SERVICE INSTALLATION**

The service installation shall be as shown in the plans and in accordance with Section 804 of the Standard Specifications except as modified herein.

Provide a new photocell Intermatic model K4123C mounted on a new street light as shown in the plans.

The Contractor shall remove and dispose all unused existing materials in accordance with Article 202.03 of the Standard Specifications.

This work shall be paid for at the contract unit price EACH for ELECTRIC SERVICE INSTALLATION and shall include all labor, material, and equipment for a complete installation.

### **UNDERGROUND CONDUIT**

This work shall consist of furnishing and installing a conduit of the type and size specified, in accordance with Section 810 of the Standard Specifications except as described herein.

When PVC is specified, the substitution of Coilable Nonmetallic Conduit, in accordance with Article 1088.01 (c), in place of the PVC conduit of the size and type specified in the plans is permitted with no change in compensation for this item.

When PVC Conduit is required to be spliced to steel conduit sections, a heavy wall set screw connector with a PVC female adapter shall be installed and sealed by duct seal and plastic tape.

A ¼" polypropylene pull rope shall be installed in all conduit runs exceeding 20 feet. A minimum of 2 feet of rope shall be provided at each end of a conduit run.

This work will be paid for at the contract unit price per FOOT for UNDERGROUND CONDUIT, of the size and type specified and shall include all labor, material, and equipment for a complete installation.

# **ELECTRIC CABLE - DETECTOR LOOP LEAD-IN**

This work shall consist of furnishing and installing electric cable in conduit in accordance with Sections 873 and 1076.04 of the Standard Specifications except as described herein.

Incoming detector loop wires shall not extend more than 2 inches from the protective shielding. The crimp-on connectors for incoming detector loop wires shall also be soldered.

This work will be paid for at the contract unit price per FOOT for ELECTRIC CABLE, of the type, size, and number of conductors specified and shall include all labor, material, and equipment for a complete installation.

# **ELECTRIC CABLE IN CONDUIT**

This work shall consist of furnishing and installing electric cable in conduit in accordance with Sections 873 and 1076.04 of the Standard Specifications except as described herein.

The conductors shall be solid copper.

This work will be paid for at the contract unit price per FOOT for ELECTRIC CABLE IN CONDUIT, of the type, size, and number of conductors specified and shall include all labor, material, and equipment for a complete installation.

# REMOVE AND RELOCATE EXISTING TRAFFIC SIGNAL EQUIPMENT

This work shall be in accordance with Sections 845 and 895 of the Standard Specifications. The work shall include the removal of the existing street light, including davit arm, and traffic signal heads for relocation; and complete removal of an existing steel combination mast arm and post.

The work associated with the removal and relocation of the existing street lighting, including davit arm, shall be paid for at the contract unit price EACH for RELOCATE EXISTING LIGHTING UNIT and shall include all labor, material, and equipment for a complete relocation.

The work associated with the removal and relocation of the existing traffic signal heads shall be paid for at the contract unit price EACH for RELOCATE EXISTING SIGNAL HEAD and shall include all labor, material, and equipment for a complete relocation.

The work associated with the removal of the existing steel combination mast arm and post shall be paid for at the contract unit price EACH for REMOVE EXISTING TRAFFIC SIGNAL EQUIPMENT and shall include all labor, material, and equipment for a complete removal.

# SPECIAL WASTE PLANS AND REPORTS (SPECIAL)

The work shall involve the proper excavation and disposal of the following locations as directed by the Engineer. The work shall be according to Article 669 of the Standard Specifications and the following:

Qualifications. The term environmental firm shall mean an environmental firm with at least five (5) documented leaking underground storage tank (LUST) cleanups or that is pre-qualified in hazardous

waste by the Department. Documentation includes but not limited to verifying remediation and special waste operations for sites contaminated with gasoline, diesel, or waste oil in accordance with all Federal, State, or local regulatory requirements and shall be provided to the Engineer for approval. The environmental firm selected shall not be a former or current consultant or have any ties with any of the properties contained within and/or adjacent to this construction project.

<u>General.</u> This Special Provision will likely require the Contractor to subcontract for the execution of certain activities.

All contaminated materials shall be managed as either "uncontaminated soil" or non-special waste. This work shall include monitoring and potential sampling, analytical testing, and management of a material contaminated by regulated substances. The Environmental Firm shall continuously monitor all soil excavation for worker protection and soil contamination. Phase I Preliminary Engineering information is available through the District's Environmental Studies Unit. Soil samples or analysis without the approval of the Engineer will be at no additional cost to the Department. The lateral distance is measured from centerline and the farthest distance is the offset distance or construction limit whichever is less.

The Contractor shall manage any excavated soils and sediment within the following areas:

## Site 2843-22 - Legend's Draft House, 124 E. Main Street, Shelbyville, Shelby County

Station 1051+84 to Station 1052+95 (IL 16/Main Street), 0 to 40 feet RT – The Engineer has determined this material meets the criteria of, and shall be managed in accordance with Article 669.09(b)(1). COCs sampling parameter: pH.

## Site 2843-22 - Legend's Draft House, 124 E. Main Street, Shelbyville, Shelby County

• Station 1051+84 to Station 1052+95 (IL 16/Main Street), 0 to 40 feet RT – The Engineer has determined this material meets the criteria of, and shall be managed in accordance with Article 669.09(b)(1). COCs sampling parameter: pH.

# Site 2843-28 - Mixed Use Building, 148 E. Main Street, Shelbyville, Shelby County

Station 1052+95 to Station 1054+06 (IL 16/Main Street), 0 to 40 feet RT – The Engineer has determined this material meets the criteria of, and shall be managed in accordance with Article 669.09(b)(1). COCs sampling parameter: pH.

### Site 2843-33 - Corner Copy, 157 E. Main Street, Shelbyville, Shelby County

 Station 1053+96 to Station 1054+69 (IL 16/Main Street), 0 to 45 feet LT - The Engineer has determined this material meets the criteria of, and shall be managed in accordance with Article 669.09(a)(2). COCs sampling parameter: Lead.

# Site 2843-37 - Commercial Building, 212-216 E. Main Street, Shelbyville, Shelby County

• Station 1055+78 to Station 1056+63 (IL 16/Main Street), 0 to 40 feet RT – The Engineer has determined this material meets the criteria of, and shall be managed in accordance with Article 669.09(a)(5). COCs sampling parameters: Arsenic, lead, and manganese.

# Site 2843-41 - Commercial Building, 229 E. Main Street, Shelbyville, Shelby County

- Station 1056+66 to Station 1057+40 (IL 16/Main Street), 0 to 54 feet LT This material meets the criteria of, and shall be managed in accordance with Article 669.09(a)(5). COCs sampling parameter: Benzene.
- Station 1057+10 to Station 1057+27 (IL 16/Main Street), 102 to 172 feet LT The Engineer has
  determined this material meets the criteria of, and shall be managed in accordance with Article
  669.09(a)(5). COCs sampling parameters: Arsenic and antimony.

# Site 2843-44 - Hair MD, 244 E. Main Street, Shelbyville, Shelby County

 Station 1057+40 to Station 1057+88 (IL 16/Main Street), 0 to 45 feet LT – The Engineer has determined this material meets the criteria of, and shall be managed in accordance with Article 669.09(a)(1). COCs sampling parameter: Lead.

# Site 2843-45 - Parking Lot, 200 block of E. Main Street, Shelbyville, Shelby County

- Station 1057+40 to Station 1057+88 (IL 16/Main Street), 0 to 45 feet LT The Engineer has determined this material meets the criteria of, and shall be managed in accordance with Article 669.09(a)(1). COCs sampling parameter: Lead.
- Station 1057+88 to Station 1058+65 (IL 16/Main Street), 0 to 62 feet LT The Engineer had determined this material meets the criteria of, and shall be managed in accordance with Article 669.09(b)(1). COCs sampling parameter: Ph.

This work shall be paid for at the contract unit price per LUMP SUM for SPECIAL WASTE PLANS AND REPORTS (SPECIAL)

# **CHANGEABLE MESSAGE SIGN:**

This work consists of furnishing, installation, maintenance, and removal of Changeable Message Signs as directed by the Engineer, in accordance with Section 701 of the Standard Specifications, and as herein specified.

The Changeable Message Signs to be installed under this item are to be used as advanced notification of the impending work. The Engineer will determine the messages to be displayed. Two Changeable Message Signs will be required for this project (one at each end of the project).

The Changeable Message Signs shall be in place a minimum of the 7 days directly prior to the commencement of work that requires a lane closure. Delays caused by failure to provide the required notice shall not be considered justification for a change in the working days allowed on the contract.

This work shall be paid for at the contract unit price per CAL DAY for CHANGEABLE MESSAGE SIGNS. The maximum pay for this pay item is 7 calendar days per message sign. If the contractor delays their start date the message signs shall remain in place until lane closures are necessary and no payment will be made for any days beyond the 7 day maximum.

### REMOVAL OF CABLE IN CONDUIT

The existing cable shall be removed from the existing conduit at locations shown on the plans or as directed by the engineer. The existing conduit shall remain in place to be reused. Existing conduit damaged by the contractor's operation shall be replaced at their expense.

The cost to comply with this special provision shall be included in the unit price per FOOT for REMOVAL OF CABLE IN CONDUIT and no additional compensation will be allowed.

## HAND HOLE TO BE ADJUSTED

The existing hand hole shall be adjusted to the lines and grades shown on the plans or as directed by the engineer. The adjustment shall be to the satisfaction of the engineer. The completed adjustment must also comply with all ADA requirements.

He cost to comply with this Special provision shall be included in the unit price per EACH for HAND HOLE TO BE ADJUSTED and no additional compensation will be allowed.

# State of Illinois Department of Transportation Bureau of Local Roads and Streets

### SPECIAL PROVISION FOR INSURANCE

Effective: February 1, 2007 Revised: August 1, 2007

All references to Sections or Articles in this specification shall be construed to mean specific Section or Article of the Standard Specifications for Road and Bridge Construction, adopted by the Department of Transportation.

The Contractor shall name the following entities as additional insured under the Contractor's general liability insurance policy in accordance with Article 107.27:
City of Shelbyville, IL 170 East Main Street Shelbyville, IL
The entities listed above and their officers, employees, and agents shall be indemnified and held harmless in accordance with Article 107.26.

### COMPENSABLE DELAY COSTS (BDE)

Effective: June 2, 2017 Revised: April 1, 2019

Revise Article 107.40(b) of the Standard Specifications to read:

- "(b) Compensation. Compensation will not be allowed for delays, inconveniences, or damages sustained by the Contractor from conflicts with facilities not meeting the above definition; or if a conflict with a utility in an unanticipated location does not cause a shutdown of the work or a documentable reduction in the rate of progress exceeding the limits set herein. The provisions of Article 104.03 notwithstanding, compensation for delays caused by a utility in an unanticipated location will be paid according to the provisions of this Article governing minor and major delays or reduced rate of production which are defined as follows.
  - (1) Minor Delay. A minor delay occurs when the work in conflict with the utility in an unanticipated location is completely stopped for more than two hours, but not to exceed two weeks.
  - (2) Major Delay. A major delay occurs when the work in conflict with the utility in an unanticipated location is completely stopped for more than two weeks.
  - (3) Reduced Rate of Production Delay. A reduced rate of production delay occurs when the rate of production on the work in conflict with the utility in an unanticipated location decreases by more than 25 percent and lasts longer than seven calendar days."

Revise Article 107.40(c) of the Standard Specifications to read:

- "(c) Payment. Payment for Minor, Major, and Reduced Rate of Production Delays will be made as follows.
  - (1) Minor Delay. Labor idled which cannot be used on other work will be paid for according to Article 109.04(b)(1) and (2) for the time between start of the delay and the minimum remaining hours in the work shift required by the prevailing practice in the area.
    - Equipment idled which cannot be used on other work, and which is authorized to standby on the project site by the Engineer, will be paid for according to Article 109.04(b)(4).
  - (2) Major Delay. Labor will be the same as for a minor delay.

Equipment will be the same as for a minor delay, except Contractor-owned equipment will be limited to two weeks plus the cost of move-out to either the

Contractor's yard or another job and the cost to re-mobilize, whichever is less. Rental equipment may be paid for longer than two weeks provided the Contractor presents adequate support to the Department (including lease agreement) to show retaining equipment on the job is the most economical course to follow and in the public interest.

(3) Reduced Rate of Production Delay. The Contractor will be compensated for the reduced productivity for labor and equipment time in excess of the 25 percent threshold for that portion of the delay in excess of seven calendar days. Determination of compensation will be in accordance with Article 104.02, except labor and material additives will not be permitted.

Payment for escalated material costs, escalated labor costs, extended project overhead, and extended traffic control will be determined according to Article 109.13."

Revise Article 108.04(b) of the Standard Specifications to read:

- "(b) No working day will be charged under the following conditions.
  - (1) When adverse weather prevents work on the controlling item.
  - (2) When job conditions due to recent weather prevent work on the controlling item.
  - (3) When conduct or lack of conduct by the Department or its consultants, representatives, officers, agents, or employees; delay by the Department in making the site available; or delay in furnishing any items required to be furnished to the Contractor by the Department prevents work on the controlling item.
  - (4) When delays caused by utility or railroad adjustments prevent work on the controlling item.
  - (5) When strikes, lock-outs, extraordinary delays in transportation, or inability to procure critical materials prevent work on the controlling item, as long as these delays are not due to any fault of the Contractor.
  - (6) When any condition over which the Contractor has no control prevents work on the controlling item."

Revise Article 109.09(f) of the Standard Specifications to read:

"(f) Basis of Payment. After resolution of a claim in favor of the Contractor, any adjustment in time required for the work will be made according to Section 108. Any adjustment in the costs to be paid will be made for direct labor, direct materials, direct equipment, direct jobsite overhead, direct offsite overhead, and other direct costs allowed by the resolution. Adjustments in costs will not be made for interest charges, loss of anticipated profit, undocumented loss of efficiency, home office overhead and unabsorbed overhead other than as allowed by Article 109.13, lost opportunity, preparation of claim expenses and other consequential indirect costs regardless of method of calculation.

The above Basis of Payment is an essential element of the contract and the claim cost recovery of the Contractor shall be so limited."

Add the following to Section 109 of the Standard Specifications.

"109.13 Payment for Contract Delay. Compensation for escalated material costs, escalated labor costs, extended project overhead, and extended traffic control will be allowed when such costs result from a delay meeting the criteria in the following table.

Contract Type	Cause of Delay	Length of Delay
Working Days	Article 108.04(b)(3) or Article 108.04(b)(4)	No working days have been charged for two consecutive weeks.
Completion Date	Article 108.08(b)(1) or Article 108.08(b)(7)	The Contractor has been granted a minimum two week extension of contract time, according to Article 108.08.

Payment for each of the various costs will be according to the following.

- (a) Escalated Material and/or Labor Costs. When the delay causes work, which would have otherwise been completed, to be done after material and/or labor costs have increased, such increases will be paid. Payment for escalated material costs will be limited to the increased costs substantiated by documentation furnished by the Contractor. Payment for escalated labor costs will be limited to those items in Article 109.04(b)(1) and (2), except the 35 percent and 10 percent additives will not be permitted.
- (b) Extended Project Overhead. For the duration of the delay, payment for extended project overhead will be paid as follows.
  - (1) Direct Jobsite and Offsite Overhead. Payment for documented direct jobsite overhead and documented direct offsite overhead, including onsite supervisory and administrative personnel, will be allowed according to the following table.

Original Contract Amount	Supervisory and Administrative Personnel
Up to \$5,000,000	One Project Superintendent
Over \$ 5,000,000 - up to \$25,000,000	One Project Manager, One Project Superintendent or Engineer, and One Clerk
Over \$25,000,000 - up to \$50,000,000	One Project Manager, One Project Superintendent, One Engineer, and

	One Clerk
Over \$50,000,000	One Project Manager, Two Project Superintendents, One Engineer, and One Clerk

- (2) Home Office and Unabsorbed Overhead. Payment for home office and unabsorbed overhead will be calculated as 8 percent of the total delay cost.
- (c) Extended Traffic Control. Traffic control required for an extended period of time due to the delay will be paid for according to Article 109.04.

When an extended traffic control adjustment is paid under this provision, an adjusted unit price as provided for in Article 701.20(a) for increase or decrease in the value of work by more than ten percent will not be paid.

Upon payment for a contract delay under this provision, the Contractor shall assign subrogation rights to the Department for the Department's efforts of recovery from any other party for monies paid by the Department as a result of any claim under this provision. The Contractor shall fully cooperate with the Department in its efforts to recover from another party any money paid to the Contractor for delay damages under this provision."

### DISADVANTAGED BUSINESS ENTERPRISE PARTICIPATION (BDE)

Effective: September 1, 2000 Revised: March 2, 2019

<u>FEDERAL OBLIGATION</u>. The Department of Transportation, as a recipient of federal financial assistance, is required to take all necessary and reasonable steps to ensure nondiscrimination in the award and administration of contracts. Consequently, the federal regulatory provisions of 49 CFR Part 26 apply to this contract concerning the utilization of disadvantaged business enterprises. For the purposes of this Special Provision, a disadvantaged business enterprise (DBE) means a business certified by the Department in accordance with the requirements of 49 CFR Part 26 and listed in the Illinois Unified Certification Program (IL UCP) DBE Directory.

STATE OBLIGATION. This Special Provision will also be used by the Department to satisfy the requirements of the Business Enterprise for Minorities, Females, and Persons with Disabilities Act, 30 ILCS 575. When this Special Provision is used to satisfy state law requirements on 100 percent state-funded contracts, the federal government has no involvement in such contracts (not a federal-aid contract) and no responsibility to oversee the implementation of this Special Provision by the Department on those contracts. DBE participation on 100 percent state-funded contracts will not be credited toward fulfilling the Department's annual overall DBE goal required by the US Department of Transportation to comply with the federal DBE program requirements.

<u>CONTRACTOR ASSURANCE</u>. The Contractor makes the following assurance and agrees to include the assurance in each subcontract the Contractor signs with a subcontractor.

The Contractor, subrecipient, or subcontractor shall not discriminate on the basis of race, color, national origin, or sex in the performance of this contract. The Contractor shall carry out applicable requirements of 49 CFR Part 26 in the award and administration of contracts funded in whole or in part with federal or state funds. Failure by the Contractor to carry out these requirements is a material breach of this contract, which may result in the termination of this contract or such other remedy as the recipient deems appropriate, which may include, but is not limited to:

- (a) Withholding progress payments;
- (b) Assessing sanctions;
- (c) Liquidated damages; and/or
- (d) Disqualifying the Contractor from future bidding as non-responsible.

OVERALL GOAL SET FOR THE DEPARTMENT. As a requirement of compliance with 49 CFR Part 26, the Department has set an overall goal for DBE participation in its federally assisted contracts. That goal applies to all federal-aid funds the Department will expend in its federally assisted contracts for the subject reporting fiscal year. The Department is required to make a

good faith effort to achieve the overall goal. The dollar amount paid to all approved DBE companies performing work called for in this contract is eligible to be credited toward fulfillment of the Department's overall goal.

CONTRACT GOAL TO BE ACHIEVED BY THE CONTRACTOR. This contract includes a specific DBE utilization goal established by the Department. The goal has been included because the Department has determined the work of this contract has subcontracting opportunities that may be suitable for performance by DBE companies. The determination is based on an assessment of the type of work, the location of the work, and the availability of DBE companies to do a part of the work. The assessment indicates, in the absence of unlawful discrimination and in an arena of fair and open competition, DBE companies can be expected to perform \_\_5.00\_\_% of the work. This percentage is set as the DBE participation goal for this contract. Consequently, in addition to the other award criteria established for this contract, the Department will only award this contract to a bidder who makes a good faith effort to meet this goal of DBE participation in the performance of the work. A bidder makes a good faith effort for award consideration if either of the following is done in accordance with the procedures set for in this Special Provision:

- (a) The bidder documents enough DBE participation has been obtained to meet the goal or,
- (b) The bidder documents a good faith effort has been made to meet the goal, even though the effort did not succeed in obtaining enough DBE participation to meet the goal.

DBE LOCATOR REFERENCES. Bidders shall consult the IL UCP DBE Directory as a reference source for DBE-certified companies. In addition, the Department maintains a letting and item specific DBE locator information system whereby DBE companies can register their interest in providing quotes on particular bid items advertised for letting. Information concerning DBE companies willing to quote work for particular contracts may be obtained by contacting the Department's Bureau of Small Business Enterprises at telephone number (217) 785-4611, or by visiting the Department's website at: <a href="http://www.idot.illinois.gov/doing-business/certifications/disadvantaged-business-enterprise-">http://www.idot.illinois.gov/doing-business/certifications/disadvantaged-business-enterprise-</a>

BIDDING PROCEDURES. Compliance with this Special Provision is a material bidding requirement and failure of the bidder to comply will render the bid not responsive.

certification/il-ucp-directory/index.

The bidder shall submit a DBE Utilization Plan (form SBE 2026), and a DBE Participation Statement (form SBE 2025) for each DBE company proposed for the performance of work to achieve the contract goal, with the bid. If the Utilization Plan indicates the contract goal will not be met, documentation of good faith efforts shall also be submitted. The documentation of good faith efforts must include copies of each DBE and non-DBE subcontractor quote submitted to the bidder when a non-DBE subcontractor is selected over a DBE for work on the contract. The required forms and documentation must be submitted as a single .pdf file using the "Integrated Contractor Exchange (iCX)" application within the Department's "EBids System".

The Department will not accept a Utilization Plan if it does not meet the bidding procedures set forth herein and the bid will be declared not responsive. In the event the bid is declared not responsive, the Department may elect to cause the forfeiture of the penal sum of the bidder's proposal guaranty and may deny authorization to bid the project if re-advertised for bids.

GOOD FAITH EFFORT PROCEDURES. The contract will not be awarded until the Utilization Plan is approved. All information submitted by the bidder must be complete, accurate and adequately document enough DBE participation has been obtained or document the good faith efforts of the bidder, in the event enough DBE participation has not been obtained, before the Department will commit to the performance of the contract by the bidder. The Utilization Plan will be approved by the Department if the Utilization Plan documents sufficient commercially useful DBE work to meet the contract goal or the bidder submits sufficient documentation of a good faith effort to meet the contract goal pursuant to 49 CFR Part 26, Appendix A. This means the bidder must show that all necessary and reasonable steps were taken to achieve the contract goal. Necessary and reasonable steps are those which, by their scope, intensity and appropriateness to the objective, could reasonably be expected to obtain sufficient DBE participation, even if they were not successful. The Department will consider the quality, quantity, and intensity of the kinds of efforts the bidder has made. Mere pro forma efforts, in other words efforts done as a matter of form, are not good faith efforts; rather, the bidder is expected to have taken genuine efforts that would be reasonably expected of a bidder actively and aggressively trying to obtain DBE participation sufficient to meet the contract goal.

- (a) The following is a list of types of action that the Department will consider as part of the evaluation of the bidder's good faith efforts to obtain participation. These listed factors are not intended to be a mandatory checklist and are not intended to be exhaustive. Other factors or efforts brought to the attention of the Department may be relevant in appropriate cases and will be considered by the Department.
  - (1) Soliciting through all reasonable and available means (e.g. attendance at pre-bid meetings, advertising and/or written notices) the interest of all certified DBE companies that have the capability to perform the work of the contract. The bidder must solicit this interest within sufficient time to allow the DBE companies to respond to the solicitation. The bidder must determine with certainty if the DBE companies are interested by taking appropriate steps to follow up initial solicitations.
  - (2) Selecting portions of the work to be performed by DBE companies in order to increase the likelihood that the DBE goals will be achieved. This includes, where appropriate, breaking out contract work items into economically feasible units to facilitate DBE participation, even when the Contractor might otherwise prefer to perform these work items with its own forces.
  - (3) Providing interested DBE companies with adequate information about the plans, specifications, and requirements of the contract in a timely manner to assist them in responding to a solicitation.

- (4) a. Negotiating in good faith with interested DBE companies. It is the bidder's responsibility to make a portion of the work available to DBE subcontractors and suppliers and to select those portions of the work or material needs consistent with the available DBE subcontractors and suppliers, so as to facilitate DBE participation. Evidence of such negotiation includes the names, addresses, and telephone numbers of DBE companies that were considered; a description of the information provided regarding the plans and specifications for the work selected for subcontracting; and evidence as to why additional agreements could not be reached for DBE companies to perform the work.
  - b. A bidder using good business judgment would consider a number of factors in negotiating with subcontractors, including DBE subcontractors, and would take a firm's price and capabilities as well as contract goals into consideration. However, the fact that there may be some additional costs involved in finding and using DBE companies is not in itself sufficient reason for a bidder's failure to meet the contract DBE goal, as long as such costs are reasonable. Also the ability or desire of a bidder to perform the work of a contract with its own organization does not relieve the bidder of the responsibility to make good faith efforts. Bidders are not, however, required to accept higher quotes from DBE companies if the price difference is excessive or unreasonable. In accordance with the above Bidding Procedures, the documentation of good faith efforts must include copies of each DBE and non-DBE subcontractor quote submitted to the bidder when a non-DBE subcontractor was selected over a DBE for work on the contract.
- (5) Not rejecting DBE companies as being unqualified without sound reasons based on a thorough investigation of their capabilities. The bidder's standing within its industry, membership in specific groups, organizations, or associations and political or social affiliations (for example union vs. non-union employee status) are not legitimate causes for the rejection or non-solicitation of bids in the bidder's efforts to meet the project goal.
- (6) Making efforts to assist interested DBE companies in obtaining bonding, lines of credit, or insurance as required by the recipient or Contractor.
- (7) Making efforts to assist interested DBE companies in obtaining necessary equipment, supplies, materials, or related assistance or services.
- (8) Effectively using the services of available minority/women community organizations; minority/women contractors' groups; local, state, and federal minority/women business assistance offices; and other organizations as allowed on a case-by-case basis to provide assistance in the recruitment and placement of DBE companies.
- (b) If the Department determines the bidder has made a good faith effort to secure the work commitment of DBE companies to meet the contract goal, the Department will award the contract provided it is otherwise eligible for award. If the Department determines the

bidder has failed to meet the requirements of this Special Provision or that a good faith effort has not been made, the Department will notify the responsible company official designated in the Utilization Plan that the bid is not responsive. The notification will also include a statement of reasons for the adverse determination. If the Utilization Plan is not approved because it is deficient as a technical matter, unless waived by the Department, the bidder will be notified and will be allowed no more than a five calendar day period to cure the deficiency.

(c) The bidder may request administrative reconsideration of an adverse determination by emailing the Department at "DOT.DBE.UP@illinois.gov" within the five calendar days after the receipt of the notification of the determination. The determination shall become final if a request is not made on or before the fifth calendar day. A request may provide additional written documentation or argument concerning the issues raised in the determination statement of reasons, provided the documentation and arguments address efforts made prior to submitting the bid. The request will be reviewed by the Department's Reconsideration Officer. The Reconsideration Officer will extend an opportunity to the bidder to meet in person to consider all issues of documentation and whether the bidder made a good faith effort to meet the goal. After the review by the Reconsideration Officer, the bidder will be sent a written decision within ten working days after receipt of the request for reconsideration, explaining the basis for finding that the bidder did or did not meet the goal or make adequate good faith efforts to do so. A final decision by the Reconsideration Officer that a good faith effort was made shall approve the Utilization Plan submitted by the bidder and shall clear the contract for award. A final decision that a good faith effort was not made shall render the bid not responsive.

CALCULATING DBE PARTICIPATION. The Utilization Plan values represent work anticipated to be performed and paid for upon satisfactory completion. The Department is only able to count toward the achievement of the overall goal and the contract goal the value of payments made for the work actually performed by DBE companies. In addition, a DBE must perform a commercially useful function on the contract to be counted. A commercially useful function is generally performed when the DBE is responsible for the work and is carrying out its responsibilities by actually performing, managing, and supervising the work involved. The Department and Contractor are governed by the provisions of 49 CFR Part 26.55(c) on questions of commercially useful functions as it affects the work. Specific counting guidelines are provided in 49 CFR Part 26.55, the provisions of which govern over the summary contained herein.

- (a) DBE as the Contractor: 100 percent goal credit for that portion of the work performed by the DBE's own forces, including the cost of materials and supplies. Work that a DBE subcontracts to a non-DBE does not count toward the DBE goals.
- (b) DBE as a joint venture Contractor: 100 percent goal credit for that portion of the total dollar value of the contract equal to the distinct, clearly defined portion of the work performed by the DBE's own forces.

- (c) DBE as a subcontractor: 100 percent goal credit for the work of the subcontract performed by the DBE's own forces, including the cost of materials and supplies, excluding the purchase of materials and supplies or the lease of equipment by the DBE subcontractor from the Contractor or its affiliates. Work that a DBE subcontractor in turn subcontracts to a non-DBE does not count toward the DBE goal.
- (d) DBE as a trucker: 100 percent goal credit for trucking participation provided the DBE is responsible for the management and supervision of the entire trucking operation for which it is responsible. At least one truck owned, operated, licensed, and insured by the DBE must be used on the contract. Credit will be given for the following:
  - (1) The DBE may lease trucks from another DBE firm, including an owner-operator who is certified as a DBE. The DBE who leases trucks from another DBE receives credit for the total value of the transportation services the lessee DBE provides on the contract.
  - (2) The DBE may also lease trucks from a non-DBE firm, including from an owner-operator. The DBE who leases trucks from a non-DBE is entitled to credit only for the fee or commission is receives as a result of the lease arrangement.
- (e) DBE as a material supplier:
  - (1) 60 percent goal credit for the cost of the materials or supplies purchased from a DBE regular dealer.
  - (2) 100 percent goal credit for the cost of materials of supplies obtained from a DBE manufacturer.
  - (3) 100 percent credit for the value of reasonable fees and commissions for the procurement of materials and supplies if not a DBE regular dealer or DBE manufacturer.

CONTRACT COMPLIANCE. Compliance with this Special Provision is an essential part of the contract. The Department is prohibited by federal regulations from crediting the participation of a DBE included in the Utilization Plan toward either the contract goal or the Department's overall goal until the amount to be applied toward the goals has been paid to the DBE. The following administrative procedures and remedies govern the compliance by the Contractor with the contractual obligations established by the Utilization Plan. After approval of the Utilization Plan and award of the contract, the Utilization Plan and individual DBE Participation Statements become part of the contract. If the Contractor did not succeed in obtaining enough DBE participation to achieve the advertised contract goal, and the Utilization Plan was approved and contract awarded based upon a determination of good faith, the total dollar value of DBE work calculated in the approved Utilization Plan as a percentage of the awarded contract value shall become the amended contract goal. All work indicated for performance by an approved DBE shall be performed, managed, and supervised by the DBE executing the DBE Participation Commitment Statement.

- (a) <u>NO AMENDMENT</u>. No amendment to the Utilization Plan may be made without prior written approval from the Department's Bureau of Small Business Enterprises. All requests for amendment to the Utilization Plan shall be emailed to the Department at DOT.DBE.UP@illinois.gov.
- (b) <u>CHANGES TO WORK</u>. Any deviation from the DBE condition-of-award or contract plans, specifications, or special provisions must be approved, in writing, by the Department as provided elsewhere in the Contract. The Contractor shall notify affected DBEs in writing of any changes in the scope of work which result in a reduction in the dollar amount condition-of-award to the contract. Where the revision includes work committed to a new DBE subcontractor, not previously involved in the project, then a Request for Approval of Subcontractor, Department form BC 260A or AER 260A, must be signed and submitted. If the commitment of work is in the form of additional tasks assigned to an existing subcontract, a new Request for Approval of Subcontractor will not be required. However, the Contractor must document efforts to assure the existing DBE subcontractor is capable of performing the additional work and has agreed in writing to the change.
- (c) <u>SUBCONTRACT</u>. The Contractor must provide copies of DBE subcontracts to the Department upon request. Subcontractors shall ensure that all lower tier subcontracts or agreements with DBEs to supply labor or materials be performed in accordance with this Special Provision.
- (d) <u>ALTERNATIVE WORK METHODS</u>. In addition to the above requirements for reductions in the condition of award, additional requirements apply to the two cases of Contractorinitiated work substitution proposals. Where the contract allows alternate work methods which serve to delete or create underruns in condition of award DBE work, and the Contractor selects that alternate method or, where the Contractor proposes a substitute work method or material that serves to diminish or delete work committed to a DBE and replace it with other work, then the Contractor must demonstrate one of the following:
  - (1) The replacement work will be performed by the same DBE (as long as the DBE is certified in the respective item of work) in a modification of the condition of award; or
  - (2) The DBE is aware its work will be deleted or will experience underruns and has agreed in writing to the change. If this occurs, the Contractor shall substitute other work of equivalent value to a certified DBE or provide documentation of good faith efforts to do so; or
  - (3) The DBE is not capable of performing the replacement work or has declined to perform the work at a reasonable competitive price. If this occurs, the Contractor shall substitute other work of equivalent value to a certified DBE or provide documentation of good faith efforts to do so.

(e) TERMINATION AND REPLACEMENT PROCEDURES. The Contractor shall not terminate or replace a DBE listed on the approved Utilization Plan, or perform with other forces work designated for a listed DBE except as provided in this Special Provision. The Contractor shall utilize the specific DBEs listed to perform the work and supply the materials for which each is listed unless the Contractor obtains the Department's written consent as provided in subsection (a) of this part. Unless Department consent is provided for termination of a DBE subcontractor, the Contractor shall not be entitled to any payment for work or material unless it is performed or supplied by the DBE in the Utilization Plan.

As stated above, the Contractor shall not terminate or replace a DBE subcontractor listed in the approved Utilization Plan without prior written consent. This includes, but is not limited to, instances in which the Contractor seeks to perform work originally designated for a DBE subcontractor with its own forces or those of an affiliate, a non-DBE firm, or with another DBE firm. Written consent will be granted only if the Bureau of Small Business Enterprises agrees, for reasons stated in its concurrence document, that the Contractor has good cause to terminate or replace the DBE firm. Before transmitting to the Bureau of Small Business Enterprises any request to terminate and/or substitute a DBE subcontractor, the Contractor shall give notice in writing to the DBE subcontractor, with a copy to the Bureau, of its intent to request to terminate and/or substitute, and the reason for the request. The Contractor shall give the DBE five days to respond to the Contractor's notice. The DBE so notified shall advise the Bureau and the Contractor of the reasons, if any, why it objects to the proposed termination of its subcontract and why the Bureau should not approve the Contractor's action. If required in a particular case as a matter of public necessity, the Bureau may provide a response period shorter than five days.

For purposes of this paragraph, good cause includes the following circumstances:

- (1) The listed DBE subcontractor fails or refuses to execute a written contract;
- (2) The listed DBE subcontractor fails or refuses to perform the work of its subcontract in a way consistent with normal industry standards. Provided, however, that good cause does not exist if the failure or refusal of the DBE subcontractor to perform its work on the subcontract results from the bad faith or discriminatory action of the Contractor;
- (3) The listed DBE subcontractor fails or refuses to meet the Contractor's reasonable, nondiscriminatory bond requirements;
- (4) The listed DBE subcontractor becomes bankrupt, insolvent, or exhibits credit unworthiness;
- (5) The listed DBE subcontractor is ineligible to work on public works projects because of suspension and debarment proceedings pursuant 2 CFR Parts 180, 215 and 1200 or applicable state law.

- (6) The Contractor has determined the listed DBE subcontractor is not a responsible contractor;
- (7) The listed DBE subcontractor voluntarily withdraws from the projects and provides written notice to the Contractor of its withdrawal;
- (8) The listed DBE is ineligible to receive DBE credit for the type of work required;
- (9) A DBE owner dies or becomes disabled with the result that the listed DBE subcontractor is unable to complete its work on the contract;
- (10) Other documented good cause that compels the termination of the DBE subcontractor. Provided, that good cause does not exist if the Contractor seeks to terminate a DBE it relied upon to obtain the contract so that the Contractor can self-perform the work for which the DBE contractor was engaged or so that the Contractor can substitute another DBE or non-DBE contractor after contract award.
  - When a DBE is terminated or fails to complete its work on the Contract for any reason, the Contractor shall make a good faith effort to find another DBE to substitute for the original DBE to perform at least the same amount of work under the contract as the terminated DBE to the extent needed to meet the established Contract goal. The good faith efforts shall be documented by the Contractor. If the Department requests documentation under this provision, the Contractor shall submit the documentation within seven days, which may be extended for an additional seven days if necessary at the request of the Contractor. The Department will provide a written determination to the Contractor stating whether or not good faith efforts have been demonstrated.
- (f) FINAL PAYMENT. After the performance of the final item of work or delivery of material by a DBE and final payment therefore to the DBE by the Contractor, but not later than 30 calendar days after payment has been made by the Department to the Contractor for such work or material, the Contractor shall submit a DBE Payment Agreement on Department form SBE 2115 to the Resident Engineer. If full and final payment has not been made to the DBE, the DBE Payment Agreement shall indicate whether a disagreement as to the payment required exists between the Contractor and the DBE or if the Contractor believes the work has not been satisfactorily completed. If the Contractor does not have the full amount of work indicated in the Utilization Plan performed by the DBE companies indicated in the Utilization Plan and after good faith efforts are reviewed, the Department may deduct from contract payments to the Contractor the amount of the goal not achieved as liquidated and ascertained damages. The Contractor may request an administrative reconsideration of any amount deducted as damages pursuant to subsection (h) of this part.
- (g) <u>ENFORCEMENT</u>. The Department reserves the right to withhold payment to the Contractor to enforce the provisions of this Special Provision. Final payment shall not be

made on the contract until such time as the Contractor submits sufficient documentation demonstrating achievement of the goal in accordance with this Special Provision or after liquidated damages have been determined and collected.

(h) <u>RECONSIDERATION</u>. Notwithstanding any other provision of the contract, including but not limited to Article 109.09 of the Standard Specifications, the Contractor may request administrative reconsideration of a decision to deduct the amount of the goal not achieved as liquidated damages. A request to reconsider shall be delivered to the Contract Compliance Section and shall be handled and considered in the same manner as set forth in paragraph (c) of "Good Faith Effort Procedures" of this Special Provision, except a final decision that a good faith effort was not made during contract performance to achieve the goal agreed to in the Utilization Plan shall be the final administrative decision of the Department. The result of the reconsideration process is not administratively appealable to the U.S. Department of Transportation.

### **DISPOSAL FEES (BDE)**

Effective: November 1, 2018

Replace Articles 109.04(b)(5) – 109.04(b)(8) of the Standard Specifications with the following:

- "(5) Disposal Fees. When the extra work performed includes paying for disposal fees at a clean construction and demolition debris facility, an uncontaminated soil fill operation or a landfill, the Contractor shall receive, as administrative costs, an amount equal to five percent of the first \$10,000 and one percent of any amount over \$10,000 of the total approved costs of such fees.
- (6) Miscellaneous. No additional allowance will be made for general superintendence, the use of small tools, or other costs for which no specific allowance is herein provided.
- (7) Statements. No payment will be made for work performed on a force account basis until the Contractor has furnished the Engineer with itemized statements of the cost of such force account work. Statements shall be accompanied and supported by invoices for all materials used and transportation charges. However, if materials used on the force account work are not specifically purchased for such work but are taken from the Contractor's stock, then in lieu of the invoices, the Contractor shall furnish an affidavit certifying that such materials were taken from his/her stock, that the quantity claimed was actually used, and that the price and transportation claimed represent the actual cost to the Contractor.

Itemized statements at the cost of force account work shall be detailed as follows.

- a. Name, classification, date, daily hours, total hours, rate, and extension for each laborer and foreman. Payrolls shall be submitted to substantiate actual wages paid if so requested by the Engineer.
- b. Designation, dates, daily hours, total hours, rental rate, and extension for each unit of machinery and equipment.
- c. Quantities of materials, prices and extensions.
- d. Transportation of materials.
- e. Cost of property damage, liability and workmen's compensation insurance premiums, unemployment insurance contributions, and social security tax.
- (8) Work Performed by an Approved Subcontractor. When extra work is performed by an approved subcontractor, the Contractor shall receive, as administrative costs, an amount equal to five percent of the total approved costs of such work with the minimum payment being \$100.

(9) All statements of the cost of force account work shall be furnished to the Engineer not later than 60 days after receipt of the Central Bureau of Construction form "Extra Work Daily Report". If the statement is not received within the specified time frame, all demands for payment for the extra work are waived and the Department is released from any and all such demands. It is the responsibility of the Contractor to ensure that all statements are received within the specified time regardless of the manner or method of delivery."

### **ELECTRIC SERVICE INSTALLATION (BDE)**

Effective: January 1, 2020

Revise Article 804.04 of the Standard Specifications to read:

"804.04 Installation. The electric service installation shall extend from the existing utility owned transformer to the point of cable termination of the incoming power at the controller enclosure.

The Contractor shall ascertain the work being provided by the electric utility and shall provide all additional material and work required to complete the electric service installation while meeting the requirements of the utility. Unless otherwise required by the utility, grounding shall be according to Section 806, raceways shall be according to Sections 810 - 812, and conductors shall be according to Sections 817 - 818.

The electric service installation shall include an appropriate service disconnect and when required, metering. Metering shall include all metering material, including potential and current transformers. The metering and service disconnect shall be installed remote to the controller enclosure where possible.

The total length of aerial and underground service between the controller enclosure and utility transformer shall not exceed 250 ft (76 m). The service pole or structure and controller shall be located adjacent to the right-of-way line or a minimum distance of 30 ft (9 m) from the edge of pavement. The exact location will be established by the Engineer.

Specific requirements for aerial and underground electric service installations shall be as follows.

(a) Aerial Electric Service. The aerial service shall be mounted on a wood pole, along with a weatherhead, disconnect switch, meter base (if required), and all appurtenances to complete the installation.

The wood pole shall be installed according to Article 830.03(c), except the pole shall be a minimum of 25 ft (7.5 m) in length and shall be increased as necessary to maintain ground clearance.

- (b) Underground Electric Service.
  - (1) Ground Mounted Service. The ground mounted service shall be installed on a corrosion resistant pedestal or structure with a service disconnect switch, meter base (if required), and all appurtenances to complete the installation.
  - (2) Pole Mounted Service. The service shall be installed on a 12 ft (3.7 m) wood pole on which the meter base (if required) and service disconnect switch shall be channel

mounted. The wood pole shall be installed according to Article 830.03(c), except the pole shall be plumb.

(c) Conduit Protection. Feeder conductors in PVC conduit on the service pole or structure shall be protected by galvanized steel "U" guard. When on a pole, the "U" guard shall be attached with 3/8 in. x 3 in. (M10 x 75 mm) galvanized steel lag bolts."

Revise Article 804.05 of the Standard Specifications to read:

"804.05 Basis of Payment. This work will be paid for at the contract unit price per each for ELECTRIC SERVICE INSTALLATION.

For aerial electric service, work on the utility side of the weatherhead at the service pole will be paid for according to Article 109.04 when not provided by the utility company.

For underground electric service, work on the utility side of the service pole, pedestal, or structure where the service cables penetrate the ground will be paid for according to Article 109.04 when not provided by the utility company.

Any charges by the utility company to provide electrical service will be paid for according to Article 109.05."

### **ENGINEER'S FIELD OFFICE AND LABORATORY (BDE)**

Effective: January 1, 2020

Revise the last sentence of the first paragraph of Article 670.01 of the Standard Specifications to read:

"The building shall remain available for use until released by the Engineer."

Revise the fifth and sixth paragraphs of Article 670.02 of the Standard Specifications to read:

"Sanitary facilities shall include hot and cold potable running water, lavatory and toilet as an integral part of the office where available. A portable toilet, if necessary, shall be serviced once per week. Solid waste disposal consisting of two waste baskets and an outside trash container of sufficient size to accommodate a weekly provided pick-up service.

In addition, the following furniture and equipment meeting the approval of the Engineer shall be furnished."

Revise Article 670.02(b) through 670.02(r) of the Standard Specifications to read:

- "(b) One desk with minimum working surface of 48 x 72 in. (1.2 x 1.8 m).
- (c) Two free standing four drawer legal size file cabinets with lock and an underwriters' laboratories insulated file device 350 degrees one hour rating.
- (d) Table(s) and chairs capable of seating 10 people.
- (e) One equipment cabinet of minimum inside dimension of 44 in. (1100 mm) high x 24 in. (600 mm) wide x 30 in. (750 mm) deep with lock. The walls shall be of steel with a 3/32 in. (2 mm) minimum thickness with concealed hinges and enclosed lock constructed in such a manner as to prevent entry by force. The cabinet assembly shall be permanently attached to a structural element of the field office in a manner to prevent theft of the entire cabinet.
- (f) One refrigerator with a minimum size of 14 cu ft (0.40 cu m) with a freezer unit.
- (g) One electric desk type tape printing calculator.
- (h) A minimum of two communication paths. The configuration shall include:
  - (1) Internet Connection. An internet service connection with a wireless router capable of providing service to a minimum of five devices. The internet service shall be for unlimited data with a minimum internet data download speed of 25 megabits per second. For areas where this minimum download speed is not available, the maximum speed available for the area shall be provided.

- (2) Telephone Line. One landline touch tone telephone with voicemail or answering machine. The telephone shall have an unpublished number.
- (i) One plain paper wireless color printer capable of reproducing prints up to 11 x 17 in. (280 x 432 mm) with an automatic feed tray. Separate paper trays for letter size and 11 x 17 in. (280 x 432 mm) paper shall be provided. The wireless printer shall also be equipped to copy in color and scan documents.
- (j) One electric water cooler dispenser.
- (k) One first-aid cabinet fully equipped.
- (I) One microwave oven (minimum 700 watt) with a turntable and 1 cu ft (0.03 cu m) minimum capacity.
- (m) One fire-proof safe, 0.5 cu ft (0.01 cu m) minimum capacity.
- (n) One electric paper shredder.
- (o) One post mounted rain gauge, located on the project site for each 5 miles (8 km) of project length."

Revise the last sentence of the first paragraph of Articles 670.04 and 670.05 of the Standard Specifications to read:

"Doors and windows shall be equipped with locks."

Revise Article 670.04(c) through 670.04(n) of the Standard Specifications to read:

- "(c) Two folding chairs.
- (d) One equipment cabinet of minimum inside dimension of 44 in. (1100 mm) high x 24 in. (600 mm) wide x 30 in. (750 mm) deep with lock. The walls shall be of steel with a 3/32 in. (2 mm) minimum thickness with concealed hinges and enclosed lock constructed to prevent entry by force. The cabinet assembly shall be permanently attached to a structural element of the field office to prevent theft of the entire cabinet.
- (e) A minimum of two communication paths. The configuration shall include:
  - (1) Internet Connection. An internet service connection with a wireless router capable of providing service to a minimum of five devices. The internet service shall be for unlimited data with a minimum internet download speed of 25 megabits per second. For areas where this minimum download speed is not available, the maximum speed available for the area shall be provided.

- (2) Telephone Line. One land line touch tone telephone with voicemail or answering machine. The telephone shall have an unpublished number.
- (f) One electric desk type tape printing calculator.
- (g) One first-aid cabinet fully equipped.
- (h) One plain paper wireless color printer capable of reproducing prints up to 11 x 17 in. (280 x 432 mm) with an automatic feed tray. Separate paper trays for letter size and 11 x 17 in. (280 x 432 mm) paper shall be provided. The wireless printer shall also be equipped to copy in color and scan documents.
- (i) A portable toilet meeting Federal, State, and local health department requirements shall be provided, maintained clean and in good working condition, and shall be stocked with lavatory and sanitary supplies at all times. The portable toilet shall be serviced once per week.
- (j) One electric water cooler dispenser.
- (k) One refrigerator with a minimum size of 14 cu ft (0.45 cu m) with a freezer unit.
- (I) One microwave oven (minimum 700 watt) with a turntable and 1 cu ft (0.03 cu m) minimum capacity."

Revise Article 670.05(f) of the Standard Specifications to read:

"(f) One landline touch tone telephone with voicemail or an answering machine. The telephone shall have an unpublished number."

Delete the last sentence of the second paragraph of Article 670.06 of the Standard Specifications.

Revise the fifth sentence of the first paragraph of Article 670.07 of the Supplemental Specifications to read:

"This price shall include all utility costs and shall reflect the salvage value of the building or buildings, equipment, and furniture which remain the property of the Contractor after release by the Engineer, except the Department will pay that portion of the monthly long distance and monthly local telephone, when combined, exceed \$250."

### **EQUIPMENT PARKING AND STORAGE (BDE)**

Effective: November 1, 2017

Replace the first paragraph of Article 701.11 of the Standard Specifications with the following.

"701.11 Equipment Parking and Storage. During working hours, all vehicles and/or nonoperating equipment which are parked, two hours or less, shall be parked at least 8 ft (2.5 m) from the open traffic lane. For other periods of time during working and for all nonworking hours, all vehicles, materials, and equipment shall be parked or stored as follows.

- (a) When the project has adequate right-of-way, vehicles, materials, and equipment shall be located a minimum of 30 ft (9 m) from the pavement.
- (b) When adequate right-of-way does not exist, vehicles, materials, and equipment shall be located a minimum of 15 ft (4.5 m) from the edge of any pavement open to traffic.
- (c) Behind temporary concrete barrier, vehicles, materials, and equipment shall be located a minimum of 24 in. (600 mm) behind free standing barrier or a minimum of 6 in. (150 mm) behind barrier that is either pinned or restrained according to Article 704.04. The 24 in. or 6 in. measurement shall be from the base of the non-traffic side of the barrier.
- (d) Behind other man-made or natural barriers meeting the approval of the Engineer."

## MANHOLES, VALVE VAULTS, AND FLAT SLAB TOPS (BDE)

Effective: January 1, 2018 Revised: March 1, 2019

<u>Description</u>. In addition to those manufactured according to the current standards included in this contract, manholes, valve vaults, and flat slab tops manufactured prior to March 1, 2019, according to the previous Highway Standards listed below will be accepted on this contract:

Product	` Previous Standards		
Precast Manhole Type A, 4' (1.22 m) Diameter	602401-05	602401-04	602401-03
Precast Manhole Type A, 5' (1.52 m) Diameter	602402-01	602402	602401-03
Precast Manhole Type A, 6' (1.83 m) Diameter	602406-09	602406-08	602406-07
Precast Manhole Type A, 7' (2.13 m) Diameter	602411-07	602411-06	602411-05
Precast Manhole Type A, 8' (2.44 m) Diameter	602416-07	602416-06	602416-05
Precast Manhole Type A, 9' (2.74 m) Diameter	602421-07	602421-06	602421-05
Precast Manhole Type A, 10' (3.05 m) Diameter	602426-01	602426	
Precast Valve Vault Type A, 4' (1.22 m) Diameter	602501-04	602501-03	602501-02
Precast Valve Vault Type A, 5' (1.52 m) Diameter	602506-01	602506	602501-02
Precast Reinforced Concrete Flat Slab Top	602601-05	602601-04	

The following revisions to the Standard Specifications shall apply to manholes, valve vaults, and flat slab tops manufactured according to the current standards included in this contract:

Revise Article 602.02(g) of the Standard Specifications to read:

"(g) Structural Steel (Note 4)	1006.04
--------------------------------	---------

Note 4. All components of the manhole joint splice shall be galvanized according to the requirements of AASHTO M 111 or M 232 as applicable."

Add the following to Article 602.02 of the Standard Specifications:

Note 5. The threaded rods for the manhole joint splice shall be according to the requirements of ASTM F 1554, Grade 55, (Grade 380)."

Revise the second paragraph of Article 1042.10 of the Standard Specifications to read:

"Catch basin Types A, B, C, and D; Manhole Type A; Inlet Types A and B; Drainage Structures Types 1, 2, 3, 4, 5, and 6; Valve Vault Type A; and reinforced concrete flat slab top (Highway Standard 602601) shall be manufactured according to AASHTO M 199 (M 199M), except the minimum wall thickness shall be as shown on the plans. Additionally, catch basins, inlets, and drainage structures shall have a minimum concrete compressive strength of 4500 psi

(31,000 kPa) at 28 days and manholes, valve vaults, and reinforced concrete flat slab tops shall have a minimum concrete compressive strength of 5000 psi (34,500 kPa) at 28 days."

### **PAVEMENT MARKING REMOVAL (BDE)**

Effective: July 1, 2016

Revise Article 783.02 of the Standard Specifications to read:

"783.02 Equipment. Equipment shall be according to the following.

Note 1. Grinding equipment shall be approved by the Engineer."

Revise the first paragraph of Article 783.03 of the Standard Specifications to read:

"783.03 Removal of Conflicting Markings. Existing pavement markings that conflict with revised traffic patterns shall be removed. If darkness or inclement weather prohibits the removal operations, such operations shall be resumed the next morning or when weather permits. In the event of removal equipment failure, such equipment shall be repaired, replaced, or leased so removal operations can be resumed within 24 hours."

Revise the first and second sentences of the first paragraph of Article 783.03(a) of the Standard Specifications to read:

"The existing pavement markings shall be removed by the method specified and in a manner that does not materially damage the surface or texture of the pavement or surfacing. Small particles of tightly adhering existing markings may remain in place, if in the opinion of the Engineer, complete removal of the small particles will result in pavement surface damage."

Revise the first paragraph of Article 783.04 of the Standard Specifications to read:

"783.04 Cleaning. The roadway surface shall be cleaned of debris or any other deleterious material by the use of compressed air or water blast."

Revise the first paragraph of Article 783.06 of the Standard Specifications to read:

"783.06 Basis of Payment. This work will be paid for at the contract unit price per each for RAISED REFLECTIVE PAVEMENT MARKER REMOVAL, or at the contract unit price per square foot (square meter) for PAVEMENT MARKING REMOVAL – GRINDING and/or PAVEMENT MARKING REMOVAL – WATER BLASTING."

Delete Article 1101.13 from the Standard Specifications.

## PORTLAND CEMENT CONCRETE (BDE)

Effective: November 1, 2017

Revise the Air Content % of Class PP Concrete in Table 1 Classes of Concrete and Mix Design Criteria in Article 1020.04 of the Standard Specifications to read:

"TABLI	"TABLE 1. CLASSES OF CONCRETE AND MIX DESIGN CRITERIA		
Class of Conc.	Use	Air Content %	
PP	Pavement Patching Bridge Deck Patching (10)		
ill delegation	PP-1 PP-2 PP-3 PP-4 PP-5	4,0 - 8.0"	

Revise Note (4) at the end of Table 1 Classes of Concrete and Mix Design Criteria in Article 1020.04 of the Standard Specifications to read:

"(4) For all classes of concrete, the maximum slump may be increased to 7 in (175 mm) when a high range water-reducing admixture is used. For Class SC, the maximum slump may be increased to 8 in. (200 mm). For Class PS, the maximum slump may be increased to 8 1/2 in. (215 mm) if the high range water-reducing admixture is the polycarboxylate type."

### PROGRESS PAYMENTS (BDE)

Effective: November 2, 2013

Revise Article 109.07(a) of the Standard Specifications to read:

"(a) Progress Payments. At least once each month, the Engineer will make a written estimate of the quantity of work performed in accordance with the contract, and the value thereof at the contract unit prices. The amount of the estimate approved as due for payment will be vouchered by the Department and presented to the State Comptroller for payment. No amount less than \$1000.00 will be approved for payment other than the final payment.

Progress payments may be reduced by liens filed pursuant to Section 23(c) of the Mechanics' Lien Act, 770 ILCS 60/23(c).

If a Contractor or subcontractor has defaulted on a loan issued under the Department's Disadvantaged Business Revolving Loan Program (20 ILCS 2705/2705-610), progress payments may be reduced pursuant to the terms of that loan agreement. In such cases, the amount of the estimate related to the work performed by the Contractor or subcontractor, in default of the loan agreement, will be offset, in whole or in part, and vouchered by the Department to the Working Capital Revolving Fund or designated escrow account. Payment for the work shall be considered as issued and received by the Contractor or subcontractor on the date of the offset voucher. Further, the amount of the offset voucher shall be a credit against the Department's obligation to pay the Contractor, the Contractor's obligation to pay the subcontractor, and the Contractor's or subcontractor's total loan indebtedness to the Department. The offset shall continue until such time as the entire loan indebtedness is satisfied. The Department will notify the Contractor and Fund Control Agent in a timely manner of such offset. The Contractor or subcontractor shall not be entitled to additional payment in consideration of the offset.

The failure to perform any requirement, obligation, or term of the contract by the Contractor shall be reason for withholding any progress payments until the Department determines that compliance has been achieved."

# REMOVAL AND DISPOSAL OF REGULATED SUBSTANCES (BDE)

Effective: January 1, 2019 Revised: January 1, 2020

Revise Section 669 of the Standard Specifications to read:

# "SECTION 669. REMOVAL AND DISPOSAL OF REGULATED SUBSTANCES

**669.01 Description.** This work shall consist of the transportation and proper disposal of regulated substances. This work shall also consist of the removal, transportation, and proper disposal of underground storage tanks (UST), their contents and associated underground piping to the point where the piping is above the ground, including determining the content types and estimated quantities.

669.02 Equipment. The Contractor shall notify the Engineer of the delivery of all excavation, storage, and transportation equipment to a work area location. The equipment shall comply with OSHA and American Petroleum Institute (API) guidelines and shall be furnished in a clean condition. Clean condition means the equipment does not contain any residual material classified as a non-special waste, non-hazardous special waste, or hazardous waste. Residual materials include, but are not limited to, petroleum products, chemical products, sludges, or any other material present in or on equipment.

Before beginning any associated soil or groundwater management activity, the Contractor shall provide the Engineer with the opportunity to visually inspect and approve the equipment. If the equipment contains any contaminated residual material, decontamination shall be performed on the equipment as appropriate to the regulated substance and degree of contamination present according to OSHA and API guidelines. All cleaning fluids used shall be treated as the contaminant unless laboratory testing proves otherwise.

669.03 Pre-Construction Submittals and Qualifications. Prior to beginning this work, or working in areas with regulated substances, the Contractor shall submit a "Regulated Substances Pre-Construction Plan (RSPCP)" to the Engineer for review and approval using form BDE 2730. The form shall be signed by an Illinois licensed Professional Engineer or Professional Geologist.

As part of the RSPCP, the Contractor(s) or firm(s) performing the work shall meet the following qualifications.

(a) Regulated Substances Monitoring. Qualification for environmental observation and field screening of regulated substances work and environmental observation of UST removal shall require either pre-qualification in Hazardous Waste by the Department or demonstration of acceptable project experience in remediation and operations for contaminated sites in accordance with applicable Federal, State, or local regulatory requirements using BDE 2730.

- Qualification for each individual performing regulated substances monitoring shall require a minimum of one-year of experience in similar activities as those required for the project.
- (b) Underground Storage Tank Removal. Qualification for underground storage tank (UST) removal work shall require licensing and certification with the Office of the State Fire Marshall (OSFM) and possession of all permits required to perform the work. A copy of the permit shall be provided to the Engineer prior to tank removal.

The qualified Contractor(s) or firm(s) shall also document it does not have any current or former ties with any of the properties contained within, adjoining, or potentially affecting the work.

The Engineer will require up to 21 calendar days for review of the RSPCP. The review may involve rejection or revision and resubmittal; in which case, an additional 21 days will be required for each subsequent review. Work shall not commence until the RSPCP has been approved by the Engineer. After approval, the RSPCP shall be revised as necessary to reflect changed conditions in the field and documented using BDE 2730A "Regulated Substances Pre-Construction Plan (RSPCP) Addendum" and submitted to the Engineer for approval.

#### **CONSTRUCTION REQUIREMENTS**

- **669.04** Regulated Substances Monitoring. Regulated substances monitoring includes environmental observation and field screening during regulated substances management activities at the contract specific work areas. As part of the regulated substances monitoring, the monitoring personnel shall perform and document the applicable duties listed on form BDE 2732 "Regulated Substances Monitoring Daily Record (RSMDR)".
  - (a) Environmental Observation. Prior to beginning excavation, the Contractor shall mark the limits of the contract specific work areas. Once work begins, the monitoring personnel shall be present on-site continuously during the excavation and loading of material.
  - (b) Field Screening. Field screening shall be performed during the excavation and loading of material from the contract specific work areas, except for material classified according to Article 669.05(b)(1) or 669.05(c) where field screening is not required.

Field screening shall be performed with either a photoionization detector (PID) (minimum 10.6eV lamp) or a flame ionization detector (FID), and other equipment as appropriate, to monitor for potential contaminants associated with regulated substances. The PID or FID shall be calibrated on-site, and background level readings taken and recorded daily, and as field and weather conditions change. Field screen readings on the PID or FID in excess of background levels indicates the potential presence of regulated substances requiring handling as a non-special waste, special waste, or hazardous waste. PID or FID readings may be used as the basis of increasing the limits of removal with the approval of the Engineer but shall in no case be used to decrease the limits.

669.05 Regulated Substances Management and Disposal. The management and disposal of soil and/or groundwater containing regulated substances shall be according to the following:

- (a) Soil Analytical Results Exceed Most Stringent MAC. When the soil analytical results indicate detected levels exceed the most stringent maximum allowable concentration (MAC) for chemical constituents in soil established pursuant to Subpart F of 35 III. Adm. Code 1100.605, the soil shall be managed as follows:
  - (1) When analytical results indicate inorganic chemical constituents exceed the most stringent MAC, but still considered within area background levels by the Engineer, the excavated soil can be utilized within the right-of-way as embankment or fill, when suitable. If the soils cannot be utilized within the right-of-way, they shall be managed and disposed of at a landfill as a non-special waste.
  - (2) When analytical results indicate inorganic chemical constituents exceed the most stringent MAC but do not exceed the MAC for a Metropolitan Statistical Area (MSA) County identified in 35 III. Admin. Code 742 Appendix A. Table G, the excavated soil can be utilized within the right-of-way as embankment or fill, when suitable, or managed and disposed of at a clean construction and demolition debris (CCDD) facility or an uncontaminated soil fill operation (USFO) within an MSA County provided the pH of the soil is within the range of 6.25 - 9.0, inclusive.
  - (3) When analytical results indicate chemical constituents exceed the most stringent MAC but do not exceed the MAC for an MSA County excluding Chicago, or the MAC within the Chicago corporate limits, the excavated soil can be utilized within the right-of-way as embankment or fill, when suitable, or managed and disposed of off-site at a CCDD facility or an USFO within an MSA County excluding Chicago or within the Chicago corporate limits provided the pH of the soil is within the range of 6.25 9.0, inclusive.
  - (4) When analytical results indicate chemical constituents exceed the most stringent MAC but do not exceed the MAC for an MSA County excluding Chicago, the excavated soil can be utilized within the right-of-way as embankment or fill, when suitable, or managed and disposed of off-site at a CCDD facility or an USFO within an MSA County excluding Chicago provided the pH of the soil is within the range of 6.25 9.0, inclusive.
  - (5) When the Engineer determines soil cannot be managed according to Articles 669.05(a)(1) through (a)(4) above and the materials do not contain special waste or hazardous waste, as determined by the Engineer, the soil shall be managed and disposed of at a landfill as a non-special waste.
  - (6) When analytical results indicate soil is hazardous by characteristic or listing pursuant to 35 III. Admin. Code 721, contains radiological constituents, or the Engineer otherwise determines the soil cannot be managed according to Articles 669.05(a)(1)

through (a)(5) above, the soil shall be managed and disposed of off-site as a special waste or hazardous waste as applicable.

- (b) Soil Analytical Results Do Not Exceed Most Stringent MAC. When the soil analytical results indicate that detected levels do not exceed the most stringent MAC, the excavated soil can be utilized within the right-of-way as embankment or fill, when suitable, or managed and disposed of off-site according to Article 202.03. However, the excavated soil cannot be taken to a CCDD facility or an USFO for any of the following reasons.
  - (1) The pH of the soil is less than 6.25 or greater than 9.0.
  - (2) The soil exhibited PID or FID readings in excess of background levels.
- (c) Soil Analytical Results Exceed Most Stringent MAC but Do Not Exceed Tiered Approach to Corrective Action Objectives (TACO) Residential. When the soil analytical results indicate that detected levels exceed the most stringent MAC but do not exceed TACO Tier 1 Soil Remediation Objectives for Residential Properties pursuant to 35 III. Admin. Code 742 Appendix B Table A, the excavated soil can be utilized within the right-of-way as embankment or fill, when suitable, or managed and disposed of off-site according to Article 202.03. However, the excavated soil cannot be taken to a CCDD facility or an USFO.
- (d) Groundwater. When groundwater analytical results indicate the detected levels are above Appendix B, Table E of 35 III. Admin. Code 742, the most stringent Tier 1 Groundwater Remediation Objectives for Groundwater Component of the Groundwater Ingestion Route for Class 1 groundwater, the groundwater shall be managed off-site as a special waste or hazardous waste as applicable. Special waste groundwater shall be containerized and trucked to an off-site treatment facility, or may be discharged to a sanitary sewer or combined sewer when permitted by the local sewer authority. Groundwater discharged to a sanitary sewer or combined sewer shall be pre-treated to remove particulates and measured with a calibrated flow meter to comply with applicable discharge limits. A copy of the permit shall be provided to the Engineer prior to discharging groundwater to the sanitary sewer or combined sewer.

Groundwater encountered within trenches may be managed within the trench and allowed to infiltrate back into the ground. If the groundwater cannot be managed within the trench, it may be discharged to a sanitary sewer or combined sewer when permitted by the local sewer authority, or it shall be containerized and trucked to an off-site treatment facility as a special waste or hazardous waste. The Contractor is prohibited from discharging groundwater within the trench through a storm sewer. The Contractor shall install backfill plugs within the area of groundwater contamination.

One backfill plug shall be placed down gradient to the area of groundwater contamination. Backfill plugs shall be installed at intervals not to exceed 50 ft (15 m). Backfill plugs are to be 4 ft (1.2 m) long, measured parallel to the trench, full trench width and depth. Backfill plugs shall not have any fine aggregate bedding or backfill, but shall be entirely cohesive

soil or any class of concrete. The Contractor shall provide test data that the material has a permeability of less than  $10^{-7}$  cm/sec according to ASTM D 5084, Method A or per another test method approved by the Engineer.

The Contractor shall use due care when transferring contaminated material from the area of origin to the transporter. Should releases of contaminated material to the environment occur (i.e., spillage onto the ground, etc.), the Contractor shall clean-up spilled material and place in the appropriate storage containers as previously specified. Clean-up shall include, but not be limited to, sampling beneath the material staging area to determine complete removal of the spilled material.

The Contractor shall provide engineered barriers, when required, and shall include materials sufficient to completely line excavation surfaces, including sloped surfaces, bottoms, and sidewall faces, within the areas designated for protection.

The Contractor shall obtain all documentation including any permits and/or licenses required to transport the material containing regulated substances to the disposal facility. The Contractor shall coordinate with the Engineer on the completion of all documentation. The Contractor shall make all arrangements for collection and analysis of landfill acceptance testing. The Contractor shall coordinate waste disposal approvals with the disposal facility.

The Contractor shall provide the Engineer with all transport-related documentation within two days of transport or receipt of said document(s). For management of special or hazardous waste, the Contractor shall provide the Engineer with documentation that the Contractor is operating with a valid Illinois special waste transporter permit at least two weeks before transporting the first load of contaminated material.

Transportation and disposal of material classified according to Article 669.05(a)(5) or 669.05(a)(6) shall be completed each day so that none of the material remains on-site by the close of business, except when temporary staging has been approved.

Any waste generated as a special or hazardous waste from a non-fixed facility shall be manifested off-site using the Department's county generator number provided by the Bureau of Design and Environment. An authorized representative of the Department shall sign all manifests for the disposal of the contaminated material and confirm the Contractor's transported volume. Any waste generated as a non-special waste may be managed off-site without a manifest, a special waste transporter, or a generator number.

The Contractor shall select a landfill permitted for disposal of the contaminant within the State of Illinois. The Department will review and approve or reject the facility proposed by the Contractor to use as a landfill. The Contractor shall verify whether the selected disposal facility is compliant with those applicable standards as mandated by their permit and whether the disposal facility is presently, has previously been, or has never been, on the United States Environmental Protection Agency (U.S. EPA) National Priorities List or the Resource Conservation and Recovery Act (RCRA) List of Violating Facilities. The use of a Contractor selected landfill shall in no manner delay the construction schedule or alter the Contractor's responsibilities as set forth.

- **669.06 Non-Special Waste Certification.** An authorized representative of the Department shall sign and date all non-special waste certifications. The Contractor shall be responsible for providing the Engineer with the required information that will allow the Engineer to certify the waste is not a special waste.
  - (a) Definition. A waste is considered a non-special waste as long as it is not:
    - (1) a potentially infectious medical waste;
    - (2) a hazardous waste as defined in 35 III. Admin. Code 721;
    - (3) an industrial process waste or pollution control waste that contains liquids, as determined using the paint filter test set forth in subdivision (3)(A) of subsection (m) of 35 III. Admin. Code 811.107;
    - (4) a regulated asbestos-containing waste material, as defined under the National Emission Standards for Hazardous Air Pollutants in 40 CFR Part 61.141;
    - (5) a material containing polychlorinated biphenyls (PCB's) regulated pursuant to 40 CFR Part 761:
    - (6) a material subject to the waste analysis and recordkeeping requirements of 35 III. Admin. Code 728.107 under land disposal restrictions of 35 III. Admin. Code 728;
    - (7) a waste material generated by processing recyclable metals by shredding and required to be managed as a special waste under Section 22.29 of the Environmental Protection Act; or
    - (8) an empty portable device or container in which a special or hazardous waste has been stored, transported, treated, disposed of, or otherwise handled.
  - (b) Certification Information. All information used to determine the waste is not a special waste shall be attached to the certification. The information shall include but not be limited to:
    - (1) the means by which the generator has determined the waste is not a hazardous waste;
    - (2) the means by which the generator has determined the waste is not a liquid;
    - (3) if the waste undergoes testing, the analytic results obtained from testing, signed and dated by the person responsible for completing the analysis;
    - (4) if the waste does not undergo testing, an explanation as to why no testing is needed;

- (5) a description of the process generating the waste; and
- (6) relevant material safety data sheets.

669.07 Temporary Staging. Soil classified according to Articles 669.05(a)(2), (b)(1), or (c) may be temporarily staged at the Contractor's option. Soil classified according to Articles 669.05(a)(1), (a)(3), (a)(4), (a)(5), (a)(6), or (b)(2) shall be managed and disposed of without temporary staging to the greatest extent practicable. If circumstances beyond the Contractor's control require temporary staging of these latter materials, the Contractor shall request approval from the Engineer in writing.

Temporary staging shall be accomplished within the right-of-way and the Contractor's means and methods shall be described in the approved or amended RSPCP. Staging areas shall not be located within 200 feet (61 m) of a public or private water supply well; nor within 100 feet (30 m) of sensitive environmental receptor areas, including wetlands, rivers, streams, lakes, or designated habitat zones.

The method of staging shall consist of containerization or stockpiling as applicable for the type, classification, and physical state (i.e., liquid, solid, semisolid) of the material. Materials of different classifications shall be staged separately with no mixing or co-mingling.

When containers are used, the containers and their contents shall remain intact and inaccessible to unauthorized persons until the manner of disposal is determined. The Contractor shall be responsible for all activities associated with the storage containers including, but not limited to, the procurement, transport, and labeling of the containers. The Contractor shall not use a storage container if visual inspection of the container reveals the presence of free liquids or other substances that could cause the waste to be reclassified as a hazardous or special waste.

When stockpiles are used, they shall be covered with a minimum 20-mil plastic sheeting or tarps secured using weights or tie-downs. Perimeter berms or diversionary trenches shall be provided to contain and collect for disposal any water that drains from the soil. Stockpiles shall be managed to prevent or reduce potential dust generation.

When staging non-special waste, special waste, or hazardous waste, the following additional requirements shall apply:

- (a) Non-Special Waste. When stockpiling soil classified according to Article 669.05(a)(1) or 669.05(a)(5), an impermeable surface barrier between the materials and the ground surface shall be installed. The impermeable barrier shall consist of a minimum 20-mil plastic liner material and the surface of the stockpile area shall be clean and free of debris prior to placement of the liner. Measures shall also be taken to limit or discourage access to the staging area.
- (b) Special Waste and Hazardous Waste. Soil classified according to Article 669.05(a)(6) shall not be stockpiled but shall be containerized immediately upon generation in containers, tanks or containment buildings as defined by RCRA, Toxic Substances Control

Act (TSCA), and other applicable State or local regulations and requirements, including 35 Ill. Admin. Code Part 722, Standards Applicable to Generators of Hazardous Waste.

The staging area(s) shall be enclosed (by a fence or other structure) to restrict direct access to the area, and all required regulatory identification signs applicable to a staging area containing special waste or hazardous waste shall be deployed.

Storage containers shall be placed on an all-weather gravel-packed, asphalt, or concrete surface. Containers shall be in good condition and free of leaks, large dents, or severe rusting, which may compromise containment integrity. Containers must be constructed of, or lined with, materials that will not react or be otherwise incompatible with the hazardous or special waste contents. Containers used to store liquids shall not be filled more than 80 percent of the rated capacity. Incompatible wastes shall not be placed in the same container or comingled.

All containers shall be legibly labeled and marked using pre-printed labels and permanent marker in accordance with applicable regulations, clearly showing the date of waste generation, location and/or area of waste generation, and type of waste. The Contractor shall place these identifying markings on an exterior side surface of the container.

Storage containers shall be kept closed, and storage pads covered, except when access is needed by authorized personnel.

Special waste and hazardous waste shall be transported and disposed within 90 days from the date of generation.

669.08 Underground Storage Tank Removal. For the purposes of this section, an underground storage tank (UST) includes the underground storage tank, piping, electrical controls, pump island, vent pipes and appurtenances.

Prior to removing an UST, the Engineer shall determine whether the Department is considered an "owner" or "operator" of the UST as defined by the UST regulations (41 III. Adm. Code Part 176). Ownership of the UST refers to the Department's owning title to the UST during storage, use or dispensing of regulated substances. The Department may be considered an "operator" of the UST if it has control of, or has responsibility for, the daily operation of the UST. The Department may however voluntarily undertake actions to remove an UST from the ground without being deemed an "operator" of the UST.

In the event the Department is deemed not to be the "owner" or "operator" of the UST, the OSFM removal permit shall reflect who was the past "owner" or "operator" of the UST. If the "owner" or "operator" cannot be determined from past UST registration documents from OSFM, then the OSFM removal permit will state the "owner" or "operator" of the UST is the Department. The Department's Office of Chief Counsel (OCC) will review all UST removal permits prior to submitting any removal permit to the OSFM. If the Department is not the "owner" or "operator" of the UST then it will not register the UST or pay any registration fee.

The Contractor shall be responsible for obtaining permits required for removing the UST, notification to the OSFM, using an OSFM certified tank contractor, removal and disposal of the UST and its contents, and preparation and submittal of the OSFM Site Assessment Report in accordance with 41 III. Admin. Code Part 176.330.

The Contractor shall contact the Engineer and the OSFM's office at least 72 hours prior to removal to confirm the OSFM inspector's presence during the UST removal. Removal, transport, and disposal of the UST shall be according to the applicable portions of the latest revision of the "American Petroleum Institute (API) Recommended Practice 1604".

The Contractor shall collect and analyze tank content (sludge) for disposal purposes. The Contractor shall remove as much of the regulated substance from the UST system as necessary to prevent further release into the environment. All contents within the tank shall be removed, transported and disposed of, or recycled. The tank shall be removed and rendered empty according to IEPA definition.

The Contractor shall collect soil samples from the bottom and sidewalls of the excavated area in accordance with 35 III. Admin. Code Part 734.210(h) after the required backfill has been removed during the initial response action, to determine the level of contamination remaining in the ground, regardless if a release is confirmed or not by the OSFM on-site inspector.

In the event the UST is designated a leaking underground storage tank (LUST) by the OSFM's inspector, or confirmation by analytical results, the Contractor shall notify the Engineer and the District Environmental Studies Unit (DESU). Upon confirmation of a release of contaminants and notifications to the Engineer and DESU, the Contractor shall report the release to the Illinois Emergency Management Agency (IEMA) (e.g., by telephone or electronic mail) and provide them with whatever information is available ("owner" or "operator" shall be stated as the past registered "owner" or "operator", or the IDOT District in which the tank is located and the DESU Manager).

The Contractor shall perform the following initial response actions if a release is indicated by the OSFM inspector:

- (a) Take immediate action to prevent any further release of the regulated substance to the environment, which may include removing, at the Engineer's discretion, and disposing of up to 4 ft (1.2 m) of the contaminated material, as measured from the outside dimension of the tank;
- (b) Identify and mitigate fire, explosion and vapor hazards;
- (c) Visually inspect any above ground releases or exposed below ground releases and prevent further migration of the released substance into surrounding soils and groundwater; and
- (d) Continue to monitor and mitigate any additional fire and safety hazards posed by vapors and free product that have migrated from the tank excavation zone and entered into subsurface structures (such as sewers or basements).

The tank excavation shall be backfilled according to applicable portions of Sections 205, 208, and 550 with a material that will compact and develop stability. All uncontaminated concrete and soil removed during tank extraction may be used to backfill the excavation, at the discretion of the Engineer.

After backfilling the excavation, the site shall be graded and cleaned.

- **669.09** Regulated Substances Final Construction Report. Not later than 90 days after completing this work, the Contractor shall submit a "Regulated Substances Final Construction Report (RSFCR)" to the Engineer using form BDE 2733 and required attachments. The form shall be signed by an Illinois licensed Professional Engineer or Professional Geologist.
- 669.10 Method of Measurement. Non-special waste, special waste, and hazardous waste soil will be measured for payment according to Article 202.07(b) when performing earth excavation, Article 502.12(b) when excavating for structures, or by computing the volume of the trench using the maximum trench width permitted and the actual depth of the trench.

Groundwater containerized and transported off-site for management, storage, and disposal will be measured for payment in gallons (liters).

Backfill plugs will be measured in cubic yards (cubic meters) in place, except the quantity for which payment will be made shall not exceed the volume of the trench, as computed by using the maximum width of trench permitted by the Specifications and the actual depth of the trench, with a deduction for the volume of the pipe.

Engineered Barriers will be measured for payment in square yards (square meters).

**669.11 Basis of Payment.** The work of preparing, submitting and administering a Regulated Substances Pre-Construction Plan will be paid for at the contract lump sum price for REGULATED SUBSTANCES PRE-CONSTRUCTION PLAN.

Regulated substances monitoring, including completion of form BDE 2732 for each day of work, will be paid for at the contract unit price per calendar day, or fraction thereof to the nearest 0.5 calendar day, for REGULATED SUBSTANCES MONITORING.

The installation of engineered barriers will be paid for at the contract unit price per square yard (square meter) for ENGINEERED BARRIER.

The work of UST removal, soil excavation, soil and content sampling, the management of excavated soil and UST content, and UST disposal, will be paid for at the contract unit price per each for UNDERGROUND STORAGE TANK REMOVAL.

The transportation and disposal of soil and other materials from an excavation determined to be contaminated will be paid for at the contract unit price per cubic yard (cubic meter) for NON-SPECIAL WASTE DISPOSAL, SPECIAL WASTE DISPOSAL, or HAZARDOUS WASTE DISPOSAL.

The transportation and disposal of groundwater from an excavation determined to be contaminated will be paid for at the contract unit price per gallon (liter) for SPECIAL WASTE GROUNDWATER DISPOSAL or HAZARDOUS WASTE GROUNDWATER DISPOSAL. When groundwater is discharged to a sanitary or combined sewer by permit, the cost will be paid for according to Article 109.05.

Backfill plugs will be paid for at the contract unit price per cubic yard (cubic meter) for BACKFILL PLUGS.

Payment for temporary staging of soil classified according to Articles 669.05(a)(1), (a)(3), (a)(4), (a)(5), (a)(6), or (b)(2) will be paid for according to Article 109.04. The Department will not be responsible for any additional costs incurred, if mismanagement of the staging area, storage containers, or their contents by the Contractor results in excess cost expenditure for disposal or other material management requirements.

Payment for accumulated stormwater removal and disposal will be according to Article 109.04. Payment will only be allowed if appropriate stormwater and erosion control methods were used.

Payment for decontamination, labor, material, and equipment for monitoring areas beyond the specified areas, with the Engineer's prior written approval, will be according to Article 109.04.

When the waste material for disposal requires sampling for landfill disposal acceptance, the samples shall be analyzed for TCLP VOCs, SVOCs, RCRA metals, pH, ignitability, and paint filter test. The analysis will be paid for at the contract unit price per each for SOIL DISPOSAL ANALYSIS using EPA Methods 1311 (extraction), 8260B for VOCs, 8270C for SVOCs, 6010B and 7470A for RCRA metals, 9045C for pH, 1030 for ignitability, and 9095A for paint filter.

The work of preparing, submitting and administering a Regulated Substances Final Construction Report will be paid for at the contract lump sum price REGULATED SUBSTANCES FINAL CONSTRUCTION REPORT."

## SILT FENCE, GROUND STABILIZATION AND RIPRAP FILTER FABRIC (BDE)

Effective: November 1, 2019

Revise Article 1080.02 of the Standard Specifications to read:

"1080.02 Geotextile Fabric. The fabric for silt filter fence shall consist of woven fabric meeting the requirements of AASHTO M 288 for unsupported silt fence.

The fabric for ground stabilization shall consist of woven yarns or nonwoven filaments of polyolefins or polyesters. Woven fabrics shall be Class 2 and nonwoven fabrics shall be Class 1 according to AASHTO M 288.

The physical properties for silt fence and ground stabilization fabrics shall be according to the following.

PHYSICAL PROPERTIES				
	Silt Fence Woven <sup>1/</sup>	Ground Stabilization Woven <sup>2/</sup>	Ground Stabilization Nonwoven <sup>2/</sup>	
Grab Strength, lb (N) 3/ ASTM D 4632	123 (550) MD 101 (450) XD	247 (1100) min. <sup>4/</sup>	202 (900) min. 4/	
Elongation/Grab Strain, % ASTM D 4632 4/	49 max.	49 max.	50 min.	
Trapezoidal Tear Strength, lb (N) ASTM D 4533 4/		90 (400) min.	79 (350) min.	
Puncture Strength, lb (N) ASTM D 6241 4/		494 (2200) min.	433 (1925) min.	
Apparent Opening Size, Sieve No. (mm) ASTM D 4751 5/	30 (0.60) max.	40 (0.43) max.	40 (0.43) max.	
Permittivity, sec <sup>-1</sup> ASTM D 4491	0.05 min.			
Ultraviolet Stability, % retained strength after 500 hours of exposure ASTM D 4355	70 min.	50 min.	50 min.	

- 1/ NTPEP results or manufacturer's certification to meet test requirements.
- 2/ NTPEP results to meet test requirements. Manufacturer shall have public release status and current reports on laboratory results in Test Data of NTPEP's DataMine.
- 3/ MD = Machine direction. XD = Cross-machine direction.
- 4/ Values represent the minimum average roll value (MARV) in the weaker principle direction, MD or XD.

5/ Values represent the maximum average roll value."

Revise Article 1080.03 of the Standard Specifications to read:

"1080.03 Filter Fabric. The filter fabric shall consist of woven yarns or nonwoven filaments of polyolefins or polyesters. Woven fabrics shall be Class 3 for riprap gradations RR 4 and RR 5, and Class 2 for RR 6 and RR 7 according to AASHTO M 288. Woven slit film geotextiles (i.e. geotextiles made from yarns of a flat, tape-like character) shall not be permitted. Nonwoven fabrics shall be Class 2 for riprap gradations RR 4 and RR 5, and Class 1 for RR 6 and RR 7 according to AASHTO M 288. After forming, the fabric shall be processed so that the yarns or filaments retain their relative positions with respect to each other. The fabric shall be new and undamaged.

The filter fabric shall be manufactured in widths of not less than 6 ft (2 m). Sheets of fabric may be sewn together with thread of a material meeting the chemical requirements given for the yarns or filaments to form fabric widths as required. The sheets of filter fabric shall be sewn together at the point of manufacture or another approved location.

The filter fabric shall be according to the following.

P	HYSICAL PRO	OPERTIES 1/		
	Gradation Nos. RR 4 & RR 5		Gradation Nos. RR 6 & RR 7	
	Woven	Nonwoven	Woven	Nonwoven
Grab Strength, lb (N) ASTM D 4632 2/	180 (800) min.	157 (700) min.	247 (1100) min.	202 (900) min.
Elongation/Grab Strain, % ASTM D 4632 2/	49 max.	50 min.	49 max.	50 min.
Trapezoidal Tear Strength, lb (N) ASTM D 4533 2/	67 (300) min.	56 (250) min.	90 (400) min.	79 (350) min.
Puncture Strength, lb (N) ASTM D 6241 2/	370 (1650) min.	309 (1375) min.	494 (2200) min.	433 (1925) min.
Ultraviolet Stability, % retained strength after 500 hours of exposure - ASTM D 4355	50 min.			

- 1/ NTPEP results to meet test requirements. Manufacturer shall have public release status and current reports on laboratory results in Test Data of NTPEP's DataMine.
- 2/ Values represent the minimum average roll value (MARV) in the weaker principle direction [machine direction (MD) or cross-machine direction (XD)].

As determined by the Engineer, the filter fabric shall meet the requirements noted in the following after an onsite investigation of the soil to be protected.

Soil by Weight (Mass) Passing the No. 200 sieve (75 µm), %	Apparent Opening Size, Sieve No. (mm) - ASTM D 4751 <sup>1/</sup>	Permittivity, sec <sup>-1</sup> ASTM D 4491
49 max.	60 (0.25) max.	0.2 min.
50 min.	70 (0.22) max.	0.1 min.

<sup>1/</sup> Values represent the maximum average roll value."

## SUBCONTRACTOR AND DBE PAYMENT REPORTING (BDE)

Effective: April 2, 2018

Add the following to Section 109 of the Standard Specifications.

"109.14 Subcontractor and Disadvantaged Business Enterprise Payment Reporting. The Contractor shall report all payments made to the following parties:

- (a) first tier subcontractors;
- (b) lower tier subcontractors affecting disadvantaged business enterprise (DBE) goal credit;
- (c) material suppliers or trucking firms that are part of the Contractor's submitted DBE utilization plan.

The report shall be made through the Department's on-line subcontractor payment reporting system within 21 days of making the payment."

### SUBCONTRACTOR MOBILIZATION PAYMENTS (BDE)

Effective: November 2, 2017

Revised: April 1, 2019

Replace the second paragraph of Article 109.12 of the Standard Specifications with the following:

"This mobilization payment shall be made at least seven days prior to the subcontractor starting work. The amount paid shall be at the following percentage of the amount of the subcontract reported on form BC 260A submitted for the approval of the subcontractor's work.

Value of Subcontract Reported on Form BC 260A	Mobilization Percentage
Less than \$10,000	25%
\$10,000 to less than \$20,000	20%
\$20,000 to less than \$40,000	18%
\$40,000 to less than \$60,000	16%
\$60,000 to less than \$80,000	14%
\$80,000 to less than \$100,000	12%
\$100,000 to less than \$250,000	10%
\$250,000 to less than \$500,000	9%
\$500,000 to \$750,000	8%
Over \$750,000	7%"

## TRAFFIC CONTROL DEVICES - CONES (BDE)

Effective: January 1, 2019

Revise Article 701.15(a) of the Standard Specifications to read:

"(a) Cones. Cones are used to channelize traffic. Cones used to channelize traffic at night shall be reflectorized; however, cones shall not be used in nighttime lane closure tapers or nighttime lane shifts."

Revise Article 1106.02(b) of the Standard Specifications to read:

"(b) Cones. Cones shall be predominantly orange. Cones used at night that are 28 to 36 in. (700 to 900 mm) in height shall have two white circumferential stripes. If non-reflective spaces are left between the stripes, the spaces shall be no more than 2 in. (50mm) in width. Cones used at night that are taller than 36 in. (900 mm) shall have a minimum of two white and two fluorescent orange alternating, circumferential stripes with the top stripe being fluorescent orange. If non-reflective spaces are left between the stripes, the spaces shall be no more than 3 in. (75 mm) in width.

The minimum weights for the various cone heights shall be 4 lb for 18 in. (2 kg for 450 mm), 7 lb for 28 in. (3 kg for 700 mm), and 10 lb for 36 in. (5 kg for 900 mm) with a minimum of 60 percent of the total weight in the base. Cones taller than 36 in. shall be weighted per the manufacturer's specifications such that they are not moved by wind or passing traffic."

## WEEKLY DBE TRUCKING REPORTS (BDE)

Effective: June 2, 2012 Revised: April 2, 2015

The Contractor shall submit a weekly report of Disadvantaged Business Enterprise (DBE) trucks hired by the Contractor or subcontractors (i.e. not owned by the Contractor or subcontractors) that are used for DBE goal credit.

The report shall be submitted to the Engineer on Department form "SBE 723" within ten business days following the reporting period. The reporting period shall be Monday through Sunday for each week reportable trucking activities occur.

Any costs associated with providing weekly DBE trucking reports shall be considered as included in the contract unit prices bid for the various items of work involved and no additional compensation will be allowed.

# WORKING DAYS (BDE)

Effective: January 1, 2002

The Contractor shall complete the work within  $^{130}$  working days.

# REQUIRED CONTRACT PROVISIONS FEDERAL-AID CONSTRUCTION CONTRACTS

- General
- Nondiscrimination
- III. Nonsegregated Facilities
- IV. Davis-Bacon and Related Act Provisions
- V. Contract Work Hours and Safety Standards Act Provisions
- VI. Subletting or Assigning the Contract
- VII. Safety: Accident Prevention
- VIII. False Statements Concerning Highway Projects
- IX. Implementation of Clean Air Act and Federal Water Pollution Control Act
- Compliance with Governmentwide Suspension and Debarment Requirements
- XI. Certification Regarding Use of Contract Funds for Lobbying

#### **ATTACHMENTS**

A. Employment and Materials Preference for Appalachian Development Highway System or Appalachian Local Access Road Contracts (included in Appalachian contracts only)

#### I. GENERAL

 Form FHWA-1273 must be physically incorporated in each construction contract funded under Title 23 (excluding emergency contracts solely intended for debris removal). The contractor (or subcontractor) must insert this form in each subcontract and further require its inclusion in all lower tier subcontracts (excluding purchase orders, rental agreements and other agreements for supplies or services).

The applicable requirements of Form FHWA-1273 are incorporated by reference for work done under any purchase order, rental agreement or agreement for other services. The prime contractor shall be responsible for compliance by any subcontractor, lower-tier subcontractor or service provider.

Form FHWA-1273 must be included in all Federal-aid design-build contracts, in all subcontracts and in lower tier subcontracts (excluding subcontracts for design services, purchase orders, rental agreements and other agreements for supplies or services). The design-builder shall be responsible for compliance by any subcontractor, lower-tier subcontractor or service provider.

Contracting agencies may reference Form FHWA-1273 in bid proposal or request for proposal documents, however, the Form FHWA-1273 must be physically incorporated (not referenced) in all contracts, subcontracts and lower-tier subcontracts (excluding purchase orders, rental agreements and other agreements for supplies or services related to a construction contract).

- Subject to the applicability criteria noted in the following sections, these contract provisions shall apply to all work performed on the contract by the contractor's own organization and with the assistance of workers under the contractor's immediate superintendence and to all work performed on the contract by piecework, station work, or by subcontract.
- 3. A breach of any of the stipulations contained in these Required Contract Provisions may be sufficient grounds for withholding of progress payments, withholding of final payment, termination of the contract, suspension / debarment or any other action determined to be appropriate by the contracting agency and FHWA.
- 4. Selection of Labor: During the performance of this contract, the contractor shall not use convict labor for any purpose within the limits of a construction project on a Federal-aid highway unless it is labor

performed by convicts who are on parole, supervised release, or probation. The term Federal-aid highway does not include roadways functionally classified as local roads or rural minor collectors.

#### II. NONDISCRIMINATION

The provisions of this section related to 23 CFR Part 230 are applicable to all Federal-aid construction contracts and to all related construction subcontracts of \$10,000 or more. The provisions of 23 CFR Part 230 are not applicable to material supply, engineering, or architectural service contracts.

In addition, the contractor and all subcontractors must comply with the following policies: Executive Order 11246, 41 CFR 60, 29 CFR 1625-1627, Title 23 USC Section 140, the Rehabilitation Act of 1973, as amended (29 USC 794), Title VI of the Civil Rights Act of 1964, as amended, and related regulations including 49 CFR Parts 21, 26 and 27; and 23 CFR Parts 200, 230, and 633.

The contractor and all subcontractors must comply with: the requirements of the Equal Opportunity Clause in 41 CFR 60-1.4(b) and, for all construction contracts exceeding \$10,000, the Standard Federal Equal Employment Opportunity Construction Contract Specifications in 41 CFR 60-4.3.

Note: The U.S. Department of Labor has exclusive authority to determine compliance with Executive Order 11246 and the policies of the Secretary of Labor including 41 CFR 60, and 29 CFR 1625-1627. The contracting agency and the FHWA have the authority and the responsibility to ensure compliance with Title 23 USC Section 140, the Rehabilitation Act of 1973, as amended (29 USC 794), and Title VI of the Civil Rights Act of 1964, as amended, and related regulations including 49 CFR Parts 21, 26 and 27; and 23 CFR Parts 200, 230, and 633.

The following provision is adopted from 23 CFR 230, Appendix A, with appropriate revisions to conform to the U.S. Department of Labor (US DOL) and FHWA requirements.

- 1. Equal Employment Opportunity: Equal employment opportunity (EEO) requirements not to discriminate and to take affirmative action to assure equal opportunity as set forth under laws, executive orders, rules, regulations (28 CFR 35, 29 CFR 1630, 29 CFR 1625-1627, 41 CFR 60 and 49 CFR 27) and orders of the Secretary of Labor as modified by the provisions prescribed herein, and imposed pursuant to 23 U.S.C. 140 shall constitute the EEO and specific affirmative action standards for the contractor's project activities under this contract. The provisions of the Americans with Disabilities Act of 1990 (42 U.S.C. 12101 et seq.) set forth under 28 CFR 35 and 29 CFR 1630 are incorporated by reference in this contract. In the execution of this contract, the contractor agrees to comply with the following minimum specific requirement activities of EEO:
- a. The contractor will work with the contracting agency and the Federal Government to ensure that it has made every good faith effort to provide equal opportunity with respect to all of its terms and conditions of employment and in their review of activities under the contract.
- b. The contractor will accept as its operating policy the following statement:
- "It is the policy of this Company to assure that applicants are employed, and that employees are treated during employment, without regard to their race, religion, sex, color, national origin, age or disability. Such action shall include: employment, upgrading, demotion, or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection

for training, including apprenticeship, pre-apprenticeship, and/or on-the-job training."

- 2. EEO Officer: The contractor will designate and make known to the contracting officers an EEO Officer who will have the responsibility for and must be capable of effectively administering and promoting an active EEO program and who must be assigned adequate authority and responsibility to do so.
- 3. Dissemination of Policy: All members of the contractor's staff who are authorized to hire, supervise, promote, and discharge employees, or who recommend such action, or who are substantially involved in such action, will be made fully cognizant of, and will implement, the contractor's EEO policy and contractual responsibilities to provide EEO in each grade and classification of employment. To ensure that the above agreement will be met, the following actions will be taken as a minimum:
- a. Periodic meetings of supervisory and personnel office employees will be conducted before the start of work and then not less often than once every six months, at which time the contractor's EEO policy and its implementation will be reviewed and explained. The meetings will be conducted by the EEO Officer.
- b. All new supervisory or personnel office employees will be given a thorough indoctrination by the EEO Officer, covering all major aspects of the contractor's EEO obligations within thirty days following their reporting for duty with the contractor.
- c. All personnel who are engaged in direct recruitment for the project will be instructed by the EEO Officer in the contractor's procedures for locating and hiring minorities and women.
- d. Notices and posters setting forth the contractor's EEO policy will be placed in areas readily accessible to employees, applicants for employment and potential employees.
- e. The contractor's EEO policy and the procedures to implement such policy will be brought to the attention of employees by means of meetings, employee handbooks, or other appropriate means.
- 4. Recruitment: When advertising for employees, the contractor will include in all advertisements for employees the notation: "An Equal Opportunity Employer." All such advertisements will be placed in publications having a large circulation among minorities and women in the area from which the project work force would normally be derived.
- a. The contractor will, unless precluded by a valid bargaining agreement, conduct systematic and direct recruitment through public and private employee referral sources likely to yield qualified minorities and women. To meet this requirement, the contractor will identify sources of potential minority group employees, and establish with such identified sources procedures whereby minority and women applicants may be referred to the contractor for employment consideration.
- b. In the event the contractor has a valid bargaining agreement providing for exclusive hiring hall referrals, the contractor is expected to observe the provisions of that agreement to the extent that the system meets the contractor's compliance with EEO contract provisions. Where implementation of such an agreement has the effect of discriminating against minorities or women, or obligates the contractor to do the same, such implementation violates Federal nondiscrimination provisions.
- c. The contractor will encourage its present employees to refer minorities and women as applicants for employment. Information and procedures with regard to referring such applicants will be discussed with employees.
- 5. Personnel Actions: Wages, working conditions, and employee benefits shall be established and administered, and personnel actions of every type, including hiring, upgrading, promotion, transfer, demotion, layoff, and termination, shall be taken without regard to race, color, religion, sex, national origin, age or disability. The following procedures shall be followed:

- a. The contractor will conduct periodic inspections of project sites to insure that working conditions and employee facilities do not indicate discriminatory treatment of project site personnel.
- The contractor will periodically evaluate the spread of wages paid within each classification to determine any evidence of discriminatory wage practices.
- c. The contractor will periodically review selected personnel actions in depth to determine whether there is evidence of discrimination. Where evidence is found, the contractor will promptly take corrective action. If the review indicates that the discrimination may extend beyond the actions reviewed, such corrective action shall include all affected persons.
- d. The contractor will promptly investigate all complaints of alleged discrimination made to the contractor in connection with its obligations under this contract, will attempt to resolve such complaints, and will take appropriate corrective action within a reasonable time. If the investigation indicates that the discrimination may affect persons other than the complainant, such corrective action shall include such other persons. Upon completion of each investigation, the contractor will inform every complainant of all of their avenues of appeal.

### 6. Training and Promotion:

- a. The contractor will assist in locating, qualifying, and increasing the skills of minorities and women who are applicants for employment or current employees. Such efforts should be aimed at developing full journey level status employees in the type of trade or job classification involved.
- b. Consistent with the contractor's work force requirements and as permissible under Federal and State regulations, the contractor shall make full use of training programs, i.e., apprenticeship, and on-the-job training programs for the geographical area of contract performance. In the event a special provision for training is provided under this contract, this subparagraph will be superseded as indicated in the special provision. The contracting agency may reserve training positions for persons who receive welfare assistance in accordance with 23 U.S.C. 140(a).
- c. The contractor will advise employees and applicants for employment of available training programs and entrance requirements for each.
- d. The contractor will periodically review the training and promotion potential of employees who are minorities and women and will encourage eligible employees to apply for such training and promotion.
- 7. Unions: If the contractor relies in whole or in part upon unions as a source of employees, the contractor will use good faith efforts to obtain the cooperation of such unions to increase opportunities for minorities and women. Actions by the contractor, either directly or through a contractor's association acting as agent, will include the procedures set forth below:
- a. The contractor will use good faith efforts to develop, in cooperation with the unions, joint training programs aimed toward qualifying more minorities and women for membership in the unions and increasing the skills of minorities and women so that they may qualify for higher paying employment.
- b. The contractor will use good faith efforts to incorporate an EEO clause into each union agreement to the end that such union will be contractually bound to refer applicants without regard to their race, color, religion, sex, national origin, age or disability.
- c. The contractor is to obtain information as to the referral practices and policies of the labor union except that to the extent such information is within the exclusive possession of the labor union and such labor union refuses to furnish such information to the contractor, the contractor shall so certify to the contracting agency and shall set forth what efforts have been made to obtain such information.

- d. In the event the union is unable to provide the contractor with a reasonable flow of referrals within the time limit set forth in the collective bargaining agreement, the contractor will, through independent recruitment efforts, fill the employment vacancies without regard to race, color, religion, sex, national origin, age or disability; making full efforts to obtain qualified and/or qualifiable minorities and women. The failure of a union to provide sufficient referrals (even though it is obligated to provide exclusive referrals under the terms of a collective bargaining agreement) does not relieve the contractor from the requirements of this paragraph. In the event the union referral practice prevents the contractor from meeting the obligations pursuant to Executive Order 11246, as amended, and these special provisions, such contractor shall immediately notify the contracting agency.
- 8. Reasonable Accommodation for Applicants / Employees with Disabilities: The contractor must be familiar with the requirements for and comply with the Americans with Disabilities Act and all rules and regulations established there under. Employers must provide reasonable accommodation in all employment activities unless to do so would cause an undue hardship.
- 9. Selection of Subcontractors, Procurement of Materials and Leasing of Equipment: The contractor shall not discriminate on the grounds of race, color, religion, sex, national origin, age or disability in the selection and retention of subcontractors, including procurement of materials and leases of equipment. The contractor shall take all necessary and reasonable steps to ensure nondiscrimination in the administration of this contract,
- a. The contractor shall notify all potential subcontractors and suppliers and lessors of their EEO obligations under this contract.
- b. The contractor will use good faith efforts to ensure subcontractor compliance with their EEO obligations.

#### 10. Assurance Required by 49 CFR 26.13(b):

- a. The requirements of 49 CFR Part 26 and the State DOT's U.S. DOT-approved DBE program are incorporated by reference.
- b. The contractor or subcontractor shall not discriminate on the basis of race, color, national origin, or sex in the performance of this contract. The contractor shall carry out applicable requirements of 49 CFR Part 26 in the award and administration of DOT-assisted contracts. Failure by the contractor to carry out these requirements is a material breach of this contract, which may result in the termination of this contract or such other remedy as the contracting agency deems appropriate.
- 11. Records and Reports: The contractor shall keep such records as necessary to document compliance with the EEO requirements. Such records shall be retained for a period of three years following the date of the final payment to the contractor for all contract work and shall be available at reasonable times and places for inspection by authorized representatives of the contracting agency and the FHWA.
  - a. The records kept by the contractor shall document the following:
- (1) The number and work hours of minority and nonminority group members and women employed in each work classification on the project;
  - (2) The progress and efforts being made in cooperation with unions, when applicable, to increase employment opportunities for minorities and women; and
  - (3) The progress and efforts being made in locating, hiring, training, qualifying, and upgrading minorities and women;
- b. The contractors and subcontractors will submit an annual report to the contracting agency each July for the duration of the project, indicating the number of minority, women, and non-minority group employees currently engaged in each work classification required by the contract work. This information is to be reported on <u>Form FHWA-1391</u>.

The staffing data should represent the project work force on board in all or any part of the last payroll period preceding the end of July. If on-the-job training is being required by special provision, the contractor will be required to collect and report training data. The employment data should reflect the work force on board during all or any part of the last payroll period preceding the end of July.

#### III. NONSEGREGATED FACILITIES

This provision is applicable to all Federal-aid construction contracts and to all related construction subcontracts of \$10,000 or more.

The contractor must ensure that facilities provided for employees are provided in such a manner that segregation on the basis of race, color, religion, sex, or national origin cannot result. The contractor may neither require such segregated use by written or oral policies nor tolerate such use by employee custom. The contractor's obligation extends further to ensure that its employees are not assigned to perform their services at any location, under the contractor's control, where the facilities are segregated. The term "facilities" includes waiting rooms, work areas, restaurants and other eating areas, time clocks, restrooms, washrooms, locker rooms, and other storage or dressing areas, parking lots, drinking fountains, recreation or entertainment areas, transportation, and housing provided for employees. The contractor shall provide separate or singleuser restrooms and necessary dressing or sleeping areas to assure privacy between sexes.

#### IV. DAVIS-BACON AND RELATED ACT PROVISIONS

This section is applicable to all Federal-aid construction projects exceeding \$2,000 and to all related subcontracts and lower-tier subcontracts (regardless of subcontract size). The requirements apply to all projects located within the right-of-way of a roadway that is functionally classified as Federal-aid highway. This excludes roadways functionally classified as local roads or rural minor collectors, which are exempt. Contracting agencies may elect to apply these requirements to other projects.

The following provisions are from the U.S. Department of Labor regulations in 29 CFR 5.5 "Contract provisions and related matters" with minor revisions to conform to the FHWA-1273 format and FHWA program requirements.

#### 1. Minimum wages

a. All laborers and mechanics employed or working upon the site of the work, will be paid unconditionally and not less often than once a week, and without subsequent deduction or rebate on any account (except such payroll deductions as are permitted by regulations issued by the Secretary of Labor under the Copeland Act (29 CFR part 3)), the full amount of wages and bona fide fringe benefits (or cash equivalents thereof) due at time of payment computed at rates not less than those contained in the wage determination of the Secretary of Labor which is attached hereto and made a part hereof, regardless of any contractual relationship which may be alleged to exist between the contractor and such laborers and mechanics.

Contributions made or costs reasonably anticipated for bona fide fringe benefits under section 1(b)(2) of the Davis-Bacon Act on behalf of laborers or mechanics are considered wages paid to such laborers or mechanics, subject to the provisions of paragraph 1.d. of this section; also, regular contributions made or costs incurred for more than a weekly period (but not less often than quarterly) under plans, funds, or programs which cover the particular weekly period, are deemed to be constructively made or incurred during such weekly period. Such laborers and mechanics shall be paid the appropriate wage rate and fringe benefits on the wage determination for the classification of work actually performed, without regard to skill, except as provided in 29 CFR 5.5(a)(4). Laborers or mechanics performing work in more than one classification may be compensated at the rate specified for each

classification for the time actually worked therein: Provided, That the employer's payroll records accurately set forth the time spent in each classification in which work is performed. The wage determination (including any additional classification and wage rates conformed under paragraph 1.b. of this section) and the Davis-Bacon poster (WH–1321) shall be posted at all times by the contractor and its subcontractors at the site of the work in a prominent and accessible place where it can be easily seen by the workers.

- b. (1) The contracting officer shall require that any class of laborers or mechanics, including helpers, which is not listed in the wage determination and which is to be employed under the contract shall be classified in conformance with the wage determination. The contracting officer shall approve an additional classification and wage rate and fringe benefits therefore only when the following criteria have been met:
  - (i) The work to be performed by the classification requested is not performed by a classification in the wage determination; and
  - (ii) The classification is utilized in the area by the construction industry; and
  - (iii) The proposed wage rate, including any bona fide fringe benefits, bears a reasonable relationship to the wage rates contained in the wage determination.
  - (2) If the contractor and the laborers and mechanics to be employed in the classification (if known), or their representatives, and the contracting officer agree on the classification and wage rate (including the amount designated for fringe benefits where appropriate), a report of the action taken shall be sent by the contracting officer to the Administrator of the Wage and Hour Division, Employment Standards Administration, U.S. Department of Labor, Washington, DC 20210. The Administrator, or an authorized representative, will approve, modify, or disapprove every additional classification action within 30 days of receipt and so advise the contracting officer or will notify the contracting officer within the 30-day period that additional time is necessary.
  - (3) In the event the contractor, the laborers or mechanics to be employed in the classification or their representatives, and the contracting officer do not agree on the proposed classification and wage rate (including the amount designated for fringe benefits, where appropriate), the contracting officer shall refer the questions, including the views of all interested parties and the recommendation of the contracting officer, to the Wage and Hour Administrator for determination. The Wage and Hour Administrator, or an authorized representative, will issue a determination within 30 days of receipt and so advise the contracting officer or will notify the contracting officer within the 30-day period that additional time is necessary.
  - (4) The wage rate (including fringe benefits where appropriate) determined pursuant to paragraphs 1.b.(2) or 1.b.(3) of this section, shall be paid to all workers performing work in the classification under this contract from the first day on which work is performed in the classification.
- c. Whenever the minimum wage rate prescribed in the contract for a class of laborers or mechanics includes a fringe benefit which is not expressed as an hourly rate, the contractor shall either pay the benefit as stated in the wage determination or shall pay another bona fide fringe benefit or an hourly cash equivalent thereof.
- d. If the contractor does not make payments to a trustee or other third person, the contractor may consider as part of the wages of any laborer or mechanic the amount of any costs reasonably anticipated in providing bona fide fringe benefits under a plan or program, Provided, That the Secretary of Labor has found, upon the written request of the contractor, that the applicable standards of the Davis-Bacon Act have been met. The Secretary of Labor may require the contractor to set aside in a

separate account assets for the meeting of obligations under the plan or program.

#### 2. Withholding

The contracting agency shall upon its own action or upon written request of an authorized representative of the Department of Labor, withhold or cause to be withheld from the contractor under this contract, or any other Federal contract with the same prime contractor, or any other federallyassisted contract subject to Davis-Bacon prevailing wage requirements, which is held by the same prime contractor, so much of the accrued payments or advances as may be considered necessary to pay laborers and mechanics, including apprentices, trainees, and helpers, employed by the contractor or any subcontractor the full amount of wages required by the contract. In the event of failure to pay any laborer or mechanic, including any apprentice, trainee, or helper, employed or working on the site of the work, all or part of the wages required by the contract, the contracting agency may, after written notice to the contractor, take such action as may be necessary to cause the suspension of any further payment, advance, or guarantee of funds until such violations have ceased.

#### 3. Payrolls and basic records

- a. Payrolls and basic records relating thereto shall be maintained by the contractor during the course of the work and preserved for a period of three years thereafter for all laborers and mechanics working at the site of the work. Such records shall contain the name, address, and social security number of each such worker, his or her correct classification, hourly rates of wages paid (including rates of contributions or costs anticipated for bona fide fringe benefits or cash equivalents thereof of the types described in section 1(b)(2)(B) of the Davis-Bacon Act), daily and weekly number of hours worked, deductions made and actual wages pald. Whenever the Secretary of Labor has found under 29 CFR 5.5(a)(1)(iv) that the wages of any laborer or mechanic include the amount of any costs reasonably anticipated in providing benefits under a plan or program described in section 1(b)(2)(B) of the Davis-Bacon Act, the contractor shall maintain records which show that the commitment to provide such benefits is enforceable, that the plan or program is financially responsible, and that the plan or program has been communicated in writing to the laborers or mechanics affected, and records which show the costs anticipated or the actual cost incurred in providing such benefits. Contractors employing apprentices or trainees under approved programs shall maintain written evidence of the registration of apprenticeship programs and certification of trainee programs, the registration of the apprentices and trainees, and the ratios and wage rates prescribed in the applicable programs.
- (1) The contractor shall submit weekly for each week in which any contract work is performed a copy of all payrolls to the contracting agency. The payrolls submitted shall set out accurately and completely all of the information required to be maintained under 29 CFR 5.5(a)(3)(i), except that full social security numbers and home addresses shall not be included on weekly transmittals. Instead the payrolis shall only need to include an individually identifying number for each employee (e.g., the last four digits of the employee's social security number). The required weekly payroll information may be submitted in any form desired. Optional Form WH-347 is available for this purpose from the Wage and Hour Division Web site at http://www.dol.gov/esa/whd/forms/wh347instr.htm or its successor site. The prime contractor is responsible for the submission of copies of payrolls by all subcontractors. Contractors and subcontractors shall maintain the full social security number and current address of each covered worker, and shall provide them upon request to the contracting agency for transmission to the State DOT, the FHWA or the Wage and Hour Division of the Department of Labor for purposes of an investigation or audit of compliance with prevailing wage requirements. It is not a violation of this section for a prime contractor to require a subcontractor to provide addresses and social security numbers to the prime contractor for its own records, without weekly submission to the contracting agency..

- (2) Each payroll submitted shall be accompanied by a "Statement of Compliance," signed by the contractor or subcontractor or his or her agent who pays or supervises the payment of the persons employed under the contract and shall certify the following:
  - (i) That the payroll for the payroll period contains the information required to be provided under §5.5 (a)(3)(ii) of Regulations, 29 CFR part 5, the appropriate information is being maintained under §5.5 (a)(3)(i) of Regulations, 29 CFR part 5, and that such information is correct and complete;
  - (ii) That each laborer or mechanic (including each helper, apprentice, and trainee) employed on the contract during the payroll period has been paid the full weekly wages earned, without rebate, either directly or indirectly, and that no deductions have been made either directly or indirectly from the full wages earned, other than permissible deductions as set forth in Regulations, 29 CFR part 3;
  - (iii) That each laborer or mechanic has been paid not less than the applicable wage rates and fringe benefits or cash equivalents for the classification of work performed, as specified in the applicable wage determination incorporated into the contract.
  - (3) The weekly submission of a properly executed certification set forth on the reverse side of Optional Form WH–347 shall satisfy the requirement for submission of the "Statement of Compliance" required by paragraph 3.b.(2) of this section.
- (4) The falsification of any of the above certifications may subject the contractor or subcontractor to civil or criminal prosecution under section 1001 of title 18 and section 231 of title 31 of the United States Code.
- c. The contractor or subcontractor shall make the records required under paragraph 3.a. of this section available for inspection, copying, or transcription by authorized representatives of the contracting agency, the State DOT, the FHWA, or the Department of Labor, and shall permit such representatives to interview employees during working hours on the job. If the contractor or subcontractor fails to submit the required records or to make them available, the FHWA may, after written notice to the contractor, the contracting agency or the State DOT, take such action as may be necessary to cause the suspension of any further payment, advance, or guarantee of funds. Furthermore, failure to submit the required records upon request or to make such records available may be grounds for debarment action pursuant to 29 CFR 5.12.

#### 4. Apprentices and trainees

a. Apprentices (programs of the USDOL).

Apprentices will be permitted to work at less than the predetermined rate for the work they performed when they are employed pursuant to and individually registered in a bona fide apprenticeship program registered with the U.S. Department of Labor, Employment and Training Administration, Office of Apprenticeship Training, Employer and Labor Services, or with a State Apprenticeship Agency recognized by the Office, or if a person is employed in his or her first 90 days of probationary employment as an apprentice in such an apprenticeship program, who is not individually registered in the program, but who has been certified by the Office of Apprenticeship Training, Employer and Labor Services or a State Apprenticeship Agency (where appropriate) to be eligible for probationary employment as an apprentice.

The allowable ratio of apprentices to journeymen on the job site in any craft classification shall not be greater than the ratio permitted to the contractor as to the entire work force under the registered program. Any worker listed on a payroll at an apprentice wage rate, who is not registered or otherwise employed as stated above, shall be paid not less than the applicable wage rate on the wage determination for the classification of work actually performed. In addition, any apprentice

performing work on the job site in excess of the ratio permitted under the registered program shall be paid not less than the applicable wage rate on the wage determination for the work actually performed. Where a contractor is performing construction on a project in a locality other than that in which its program is registered, the ratios and wage rates (expressed in percentages of the journeyman's hourly rate) specified in the contractor's or subcontractor's registered program shall be observed.

Every apprentice must be paid at not less than the rate specified in the registered program for the apprentice's level of progress, expressed as a percentage of the journeymen hourly rate specified in the applicable wage determination. Apprentices shall be paid fringe benefits in accordance with the provisions of the apprenticeship program. If the apprenticeship program does not specify fringe benefits, apprentices must be paid the full amount of fringe benefits listed on the wage determination for the applicable classification. If the Administrator determines that a different practice prevalls for the applicable apprentice classification, fringes shall be paid in accordance with that determination.

In the event the Office of Apprenticeship Training, Employer and Labor Services, or a State Apprenticeship Agency recognized by the Office, withdraws approval of an apprenticeship program, the contractor will no longer be permitted to utilize apprentices at less than the applicable predetermined rate for the work performed until an acceptable program is approved.

b. Trainees (programs of the USDOL).

Except as provided in 29 CFR 5.16, trainees will not be permitted to work at less than the predetermined rate for the work performed unless they are employed pursuant to and individually registered in a program which has received prior approval, evidenced by formal certification by the U.S. Department of Labor, Employment and Training Administration.

The ratio of trainees to journeymen on the job site shall not be greater than permitted under the plan approved by the Employment and Training Administration.

Every trainee must be paid at not less than the rate specified in the approved program for the trainee's level of progress, expressed as a percentage of the journeyman hourly rate specified in the applicable wage determination. Trainees shall be paid fringe benefits in accordance with the provisions of the trainee program. If the trainee program does not mention fringe benefits, trainees shall be paid the full amount of fringe benefits listed on the wage determination unless the Administrator of the Wage and Hour Division determines that there is an apprenticeship program associated with the corresponding journeyman wage rate on the wage determination which provides for less than full fringe benefits for apprentices. Any employee listed on the payroll at a trainee rate who is not registered and participating in a training plan approved by the Employment and Training Administration shall be paid not less than the applicable wage rate on the wage determination for the classification of work actually performed. In addition, any trainee performing work on the job site in excess of the ratio permitted under the registered program shall be paid not less than the applicable wage rate on the wage determination for the work actually performed.

In the event the Employment and Training Administration withdraws approval of a training program, the contractor will no longer be permitted to utilize trainees at less than the applicable predetermined rate for the work performed until an acceptable program is approved.

- c. Equal employment opportunity. The utilization of apprentices, trainees and journeymen under this part shall be in conformity with the equal employment opportunity requirements of Executive Order 11246, as amended, and 29 CFR part 30.
  - d. Apprentices and Trainees (programs of the U.S. DOT).

Apprentices and trainees working under apprenticeship and skill training programs which have been certified by the Secretary of Transportation as promoting EEO in connection with Federal-aid highway construction programs are not subject to the requirements of paragraph 4 of this Section IV. The straight time hourly wage rates for apprentices and trainees under such programs will be established by the particular programs. The ratio of apprentices and trainees to journeymen shall not be greater than permitted by the terms of the particular program.

- Compliance with Copeland Act requirements. The contractor shall comply with the requirements of 29 CFR part 3, which are incorporated by reference in this contract.
- 6. Subcontracts. The contractor or subcontractor shall insert Form FHWA-1273 in any subcontracts and also require the subcontractors to include Form FHWA-1273 in any lower tier subcontracts. The prime contractor shall be responsible for the compliance by any subcontractor or lower tier subcontractor with all the contract clauses in 29 CFR 5.5.
- 7. Contract termination: debarment. A breach of the contract clauses in 29 CFR 5.5 may be grounds for termination of the contract, and for debarment as a contractor and a subcontractor as provided in 29 CFR 5.12.
- 8. Compliance with Davis-Bacon and Related Act requirements. All rulings and interpretations of the Davis-Bacon and Related Acts contained in 29 CFR parts 1, 3, and 5 are herein incorporated by reference in this contract.
- 9. Disputes concerning labor standards. Disputes arising out of the labor standards provisions of this contract shall not be subject to the general disputes clause of this contract. Such disputes shall be resolved in accordance with the procedures of the Department of Labor set forth in 29 CFR parts 5, 6, and 7. Disputes within the meaning of this clause include disputes between the contractor (or any of its subcontractors) and the contracting agency, the U.S. Department of Labor, or the employees or their representatives.

### 10. Certification of eligibility.

- a. By entering into this contract, the contractor certifies that neither it (nor he or she) nor any person or firm who has an interest in the contractor's firm is a person or firm ineligible to be awarded Government contracts by virtue of section 3(a) of the Davis-Bacon Act or 29 CFR 5.12(a)(1).
- b. No part of this contract shall be subcontracted to any person or firm ineligible for award of a Government contract by virtue of section 3(a) of the Davis-Bacon Act or 29 CFR 5.12(a)(1).
- c. The penalty for making false statements is prescribed in the U.S. Criminal Code, 18 U.S.C. 1001.

## V. CONTRACT WORK HOURS AND SAFETY STANDARDS ACT

The following clauses apply to any Federal-aid construction contract in an amount in excess of \$100,000 and subject to the overtime provisions of the Contract Work Hours and Safety Standards Act. These clauses shall be inserted in addition to the clauses required by 29 CFR 5.5(a) or 29 CFR 4.6. As used in this paragraph, the terms laborers and mechanics include watchmen and guards.

1. Overtime requirements. No contractor or subcontractor contracting for any part of the contract work which may require or involve the employment of laborers or mechanics shall require or permit any such laborer or mechanic in any workweek in which he or she is employed on such work to work in excess of forty hours in such workweek unless such laborer or mechanic receives compensation at a rate not less than one

and one-half times the basic rate of pay for all hours worked in excess of forty hours in such workweek.

- 2. Violation; liability for unpaid wages; liquidated damages. In the event of any violation of the clause set forth in paragraph (1.) of this section, the contractor and any subcontractor responsible therefor shall be liable for the unpaid wages. In addition, such contractor and subcontractor shall be liable to the United States (in the case of work done under contract for the District of Columbia or a territory, to such District or to such territory), for liquidated damages. Such liquidated damages shall be computed with respect to each individual laborer or mechanic, including watchmen and guards, employed in violation of the clause set forth in paragraph (1.) of this section, in the sum of \$10 for each calendar day on which such individual was required or permitted to work in excess of the standard workweek of forty hours without payment of the overtime wages required by the clause set forth in paragraph (1.) of this section.
- 3. Withholding for unpaid wages and liquidated damages. The FHWA or the contacting agency shall upon its own action or upon written request of an authorized representative of the Department of Labor withhold or cause to be withheld, from any moneys payable on account of work performed by the contractor or subcontractor under any such contract or any other Federal contract with the same prime contractor, or any other federally-assisted contract subject to the Contract Work Hours and Safety Standards Act, which is held by the same prime contractor, such sums as may be determined to be necessary to satisfy any liabilities of such contractor or subcontractor for unpaid wages and liquidated damages as provided in the clause set forth in paragraph (2.) of this section.
- 4. Subcontracts. The contractor or subcontractor shall insert in any subcontracts the clauses set forth in paragraph (1.) through (4.) of this section and also a clause requiring the subcontractors to include these clauses in any lower tier subcontracts. The prime contractor shall be responsible for compliance by any subcontractor or lower tier subcontractor with the clauses set forth in paragraphs (1.) through (4.) of this section.

#### VI. SUBLETTING OR ASSIGNING THE CONTRACT

This provision is applicable to all Federal-aid construction contracts on the National Highway System.

- 1. The contractor shall perform with its own organization contract work amounting to not less than 30 percent (or a greater percentage if specified elsewhere in the contract) of the total original contract price, excluding any specialty items designated by the contracting agency. Specialty items may be performed by subcontract and the amount of any such specialty items performed may be deducted from the total original contract price before computing the amount of work required to be performed by the contractor's own organization (23 CFR 635.116).
- a. The term "perform work with its own organization" refers to workers employed or leased by the prime contractor, and equipment owned or rented by the prime contractor, with or without operators. Such term does not include employees or equipment of a subcontractor or lower tier subcontractor, agents of the prime contractor, or any other assignees. The term may include payments for the costs of hiring leased employees from an employee leasing firm meeting all relevant Federal and State regulatory requirements. Leased employees may only be included in this term if the prime contractor meets all of the following conditions:
- (1) the prime contractor maintains control over the supervision of the day-to-day activities of the leased employees;
   (2) the prime contractor remains responsible for the quality of the

work of the leased employees;

(3) the prime contractor retains all power to accept or exclude individual employees from work on the project; and

- (4) the prime contractor remains ultimately responsible for the payment of predetermined minimum wages, the submission of payrolls, statements of compliance and all other Federal regulatory requirements.
- b. "Specialty Items" shall be construed to be limited to work that requires highly specialized knowledge, abilities, or equipment not ordinarily available in the type of contracting organizations qualified and expected to bid or propose on the contract as a whole and in general are to be limited to minor components of the overall contract.
- The contract amount upon which the requirements set forth in paragraph (1) of Section VI is computed includes the cost of material and manufactured products which are to be purchased or produced by the contractor under the contract provisions.
- 3. The contractor shall furnish (a) a competent superintendent or supervisor who is employed by the firm, has full authority to direct performance of the work in accordance with the contract requirements, and is in charge of all construction operations (regardless of who performs the work) and (b) such other of its own organizational resources (supervision, management, and engineering services) as the contracting officer determines is necessary to assure the performance of the contract.
- 4. No portion of the contract shall be sublet, assigned or otherwise disposed of except with the written consent of the contracting officer, or authorized representative, and such consent when given shall not be construed to relieve the contractor of any responsibility for the fulfillment of the contract. Written consent will be given only after the contracting agency has assured that each subcontract is evidenced in writing and that it contains all perlinent provisions and requirements of the prime contract.
- 5. The 30% self-performance requirement of paragraph (1) is not applicable to design-build contracts; however, contracting agencies may establish their own self-performance requirements.

### VII. SAFETY: ACCIDENT PREVENTION

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts.

- 1. In the performance of this contract the contractor shall comply with all applicable Federal, State, and local laws governing safety, health, and sanitation (23 CFR 635). The contractor shall provide all safeguards, safety devices and protective equipment and take any other needed actions as it determines, or as the contracting officer may determine, to be reasonably necessary to protect the life and health of employees on the job and the safety of the public and to protect property in connection with the performance of the work covered by the contract.
- 2. It is a condition of this contract, and shall be made a condition of each subcontract, which the contractor enters into pursuant to this contract, that the contractor and any subcontractor shall not permit any employee, in performance of the contract, to work in surroundings or under conditions which are unsanitary, hazardous or dangerous to his/her health or safety, as determined under construction safety and health standards (29 CFR 1926) promulgated by the Secretary of Labor, in accordance with Section 107 of the Contract Work Hours and Safety Standards Act (40 U.S.C. 3704).
- 3. Pursuant to 29 CFR 1926.3, it is a condition of this contract that the Secretary of Labor or authorized representative thereof, shall have right of entry to any site of contract performance to inspect or investigate the matter of compliance with the construction safety and health standards and to carry out the duties of the Secretary under Section 107 of the Contract Work Hours and Safety Standards Act (40 U.S.C.3704).

### VIII. FALSE STATEMENTS CONCERNING HIGHWAY PROJECTS

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts.

In order to assure high quality and durable construction in conformity with approved plans and specifications and a high degree of reliability on statements and representations made by engineers, contractors, suppliers, and workers on Federal-aid highway projects, it is essential that all persons concerned with the project perform their functions as carefully, thoroughly, and honestly as possible. Willful falsification, distortion, or misrepresentation with respect to any facts related to the project is a violation of Federal law. To prevent any misunderstanding regarding the seriousness of these and similar acts, Form FHWA-1022 shall be posted on each Federal-aid highway project (23 CFR 635) in one or more places where it is readily available to all persons concerned with the project:

#### 18 U.S.C. 1020 reads as follows:

"Whoever, being an officer, agent, or employee of the United States, or of any State or Territory, or whoever, whether a person, association, firm, or corporation, knowingly makes any false statement, false representation, or false report as to the character, quality, quantity, or cost of the material used or to be used, or the quantity or quality of the work performed or to be performed, or the cost thereof in connection with the submission of plans, maps, specifications, contracts, or costs of construction on any highway or related project submitted for approval to the Secretary of Transportation; or

Whoever knowingly makes any false statement, false representation, false report or false claim with respect to the character, quality, quantity, or cost of any work performed or to be performed, or materials furnished or to be furnished, in connection with the construction of any highway or related project approved by the Secretary of Transportation; or

Whoever knowingly makes any false statement or false representation as to material fact in any statement, certificate, or report submitted pursuant to provisions of the Federal-aid Roads Act approved July 1, 1916, (39 Stat. 355), as amended and supplemented;

Shall be fined under this title or imprisoned not more than 5 years or both."

# IX, IMPLEMENTATION OF CLEAN AIR ACT AND FEDERAL WATER POLLUTION CONTROL ACT

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts.

By submission of this bid/proposal or the execution of this contract, or subcontract, as appropriate, the bidder, proposer, Federal-aid construction contractor, or subcontractor, as appropriate, will be deemed to have stipulated as follows:

- 1. That any person who is or will be utilized in the performance of this contract is not prohibited from receiving an award due to a violation of Section 508 of the Clean Water Act or Section 306 of the Clean Air Act.
- 2. That the contractor agrees to include or cause to be included the requirements of paragraph (1) of this Section X in every subcontract, and further agrees to take such action as the contracting agency may direct as a means of enforcing such requirements.

# X. CERTIFICATION REGARDING DEBARMENT, SUSPENSION, INELIGIBILITY AND VOLUNTARY EXCLUSION

This provision is applicable to all Federal-aid construction contracts, design-build contracts, subcontracts, lower-tier subcontracts, purchase orders, lease agreements, consultant contracts or any other covered transaction requiring FHWA approval or that is estimated to cost \$25,000 or more — as defined in 2 CFR Parts 180 and 1200.

1. Instructions for Certification – First Tier Participants:

- a. By signing and submitting this proposal, the prospective first tier participant is providing the certification set out below.
- b. The inability of a person to provide the certification set out below will not necessarily result in denial of participation in this covered transaction. The prospective first tier participant shall submit an explanation of why it cannot provide the certification set out below. The certification or explanation will be considered in connection with the department or agency's determination whether to enter into this transaction. However, failure of the prospective first tier participant to furnish a certification or an explanation shall disqualify such a person from participation in this transaction.
- c. The certification in this clause is a material representation of fact upon which reliance was placed when the contracting agency determined to enter into this transaction. If it is later determined that the prospective participant knowingly rendered an erroneous certification, in addition to other remedies available to the Federal Government, the contracting agency may terminate this transaction for cause of default.
- d. The prospective first tier participant shall provide immediate written notice to the contracting agency to whom this proposal is submitted if any time the prospective first tier participant learns that its certification was erroneous when submitted or has become erroneous by reason of changed circumstances.
- e. The terms "covered transaction," "debarred," "suspended," "ineligible," "participant," "person," "principal," and "voluntarily excluded," as used in this clause, are defined in 2 CFR Parts 180 and 1200. "First Tier Covered Transactions' refers to any covered transaction between a grantee or subgrantee of Federal funds and a participant (such as the prime or general contract). "Lower Tier Covered Transactions" refers to any covered transaction under a First Tier Covered Transaction (such as subcontracts). "First Tier Participant" refers to the participant who has entered into a covered transaction with a grantee or subgrantee of Federal funds (such as the prime or general contractor). "Lower Tier Participant" refers any participant who has entered into a covered transaction with a First Tier Participant or other Lower Tier Participants (such as subcontractors and suppliers).
- f. The prospective first tier participant agrees by submitting this proposal that, should the proposed covered transaction be entered into, it shall not knowingly enter into any lower tier covered transaction with a person who is debarred, suspended, declared ineligible, or voluntarily excluded from participation in this covered transaction, unless authorized by the department or agency entering into this transaction.
- g. The prospective first tier participant further agrees by submitting this proposal that it will include the clause littled "Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion-Lower Tier Covered Transactions," provided by the department or contracting agency, entering into this covered transaction, without modification, in all lower tier covered transactions and in all solicitations for lower tier covered transactions exceeding the \$25,000 threshold.
- h. A participant in a covered transaction may rely upon a certification of a prospective participant in a lower tier covered transaction that is not debarred, suspended, ineligible, or voluntarily excluded from the covered transaction, unless it knows that the certification is erroneous. A participant is responsible for ensuring that its principals are not suspended, debarred, or otherwise ineligible to participate in covered transactions. To verify the eligibility of its principals, as well as the eligibility of any lower tier prospective participants, each participant may, but is not required to, check the Excluded Parties List System website (<a href="https://www.epls.gov/">https://www.epls.gov/</a>), which is compiled by the General Services Administration.
- i. Nothing contained in the foregoing shall be construed to require the establishment of a system of records in order to render in good faith the certification required by this clause. The knowledge and information of the prospective participant is not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.

j. Except for transactions authorized under paragraph (f) of these instructions, if a participant in a covered transaction knowingly enters into a lower tier covered transaction with a person who is suspended, debarred, ineligible, or voluntarily excluded from participation in this transaction, in addition to other remedies available to the Federal Government, the department or agency may terminate this transaction for cause or default.

\* \* \* \* \*

# 2. Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion – First Tier Participants:

- a. The prospective first tier participant certifies to the best of its knowledge and belief, that it and its principals:
- (1) Are not presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from participating in covered transactions by any Federal department or agency;
- (2) Have not within a three-year period preceding this proposal been convicted of or had a civil judgment rendered against them for commission of fraud or a criminal offense in connection with obtaining, attempting to obtain, or performing a public (Federal, State or local) transaction or contract under a public transaction; violation of Federal or State antitrust statutes or commission of embezzlement, theft, forgery, bribery, falsification or destruction of records, making false statements, or receiving stolen property;
- (3) Are not presently indicted for or otherwise criminally or civilly charged by a governmental entity (Federal, State or local) with commission of any of the offenses enumerated in paragraph (a)(2) of this certification; and
- (4) Have not within a three-year period preceding this application/proposal had one or more public transactions (Federal, State or local) terminated for cause or default.
- b. Where the prospective participant is unable to certify to any of the statements in this certification, such prospective participant shall attach an explanation to this proposal.

### 2. Instructions for Certification - Lower Tier Participants:

(Applicable to all subcontracts, purchase orders and other lower tier transactions requiring prior FHWA approval or estimated to cost \$25,000 or more - 2 CFR Parts 180 and 1200)

- a. By signing and submitting this proposal, the prospective lower tier is providing the certification set out below.
- b. The certification in this clause is a material representation of fact upon which reliance was placed when this transaction was entered into. If it is later determined that the prospective lower tier participant knowingly rendered an erroneous certification, in addition to other remedies available to the Federal Government, the department, or agency with which this transaction originated may pursue available remedies, including suspension and/or debarment.
- c. The prospective lower tier participant shall provide immediate written notice to the person to which this proposal is submitted if at any time the prospective lower tier participant learns that its certification was erroneous by reason of changed circumstances.
- d. The terms "covered transaction," "debarred," "suspended," "ineligible," "participant," "person," "principal," and "voluntarily excluded," as used in this clause, are defined in 2 CFR Parts 180 and 1200. You may contact the person to which this proposal is submitted for assistance in obtaining a copy of those regulations. "First Tier Covered Transactions" refers to any covered transaction between a grantee or subgrantee of Federal funds and a participant (such as the prime or general contract). "Lower Tier Covered Transactions" refers to any covered transaction under a First Tier Covered Transaction (such as subcontracts). "First Tier Participant" refers to the participant who has entered into a covered transaction with a grantee or subgrantee of

Federal funds (such as the prime or general contractor). "Lower Tier Participant" refers any participant who has entered into a covered transaction with a First Tier Participant or other Lower Tier Participants (such as subcontractors and suppliers).

- e. The prospective lower tier participant agrees by submitting this proposal that, should the proposed covered transaction be entered into, it shall not knowingly enter into any lower tier covered transaction with a person who is debarred, suspended, declared ineligible, or voluntarily excluded from participation in this covered transaction, unless authorized by the department or agency with which this transaction originated.
- f. The prospective lower tier participant further agrees by submitting this proposal that it will include this clause titled "Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion-Lower Tier Covered Transaction," without modification, in all lower tier covered transactions and in all solicitations for lower tier covered transactions exceeding the \$25,000 threshold.
- g. A participant in a covered transaction may rely upon a certification of a prospective participant in a lower tier covered transaction that is not debarred, suspended, ineligible, or voluntarily excluded from the covered transaction, unless it knows that the certification is erroneous. A participant is responsible for ensuring that its principals are not suspended, debarred, or otherwise ineligible to participate in covered transactions. To verify the eligibility of its principals, as well as the eligibility of any lower tier prospective participants, each participant may, but is not required to, check the Excluded Parties List System website (https://www.epls.gov/), which is compiled by the General Services Administration.
- h. Nothing contained in the foregoing shall be construed to require establishment of a system of records in order to render in good faith the certification required by this clause. The knowledge and information of participant is not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.
- i, Except for transactions authorized under paragraph e of these instructions, if a participant in a covered transaction knowingly enters into a lower tier covered transaction with a person who is suspended, debarred, ineligible, or voluntarily excluded from participation in this transaction, in addition to other remedies available to the Federal Government, the department or agency with which this transaction originated may pursue available remedies, including suspension and/or debarment.

# Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion--Lower Tier Participants:

- The prospective lower tier participant certifies, by submission of this
  proposal, that neither it nor its principals is presently debarred,
  suspended, proposed for debarment, declared ineligible, or voluntarily
  excluded from participating in covered transactions by any Federal
  department or agency.
- 2. Where the prospective lower tier participant is unable to certify to any of the statements in this certification, such prospective participant shall attach an explanation to this proposal.

# XI. CERTIFICATION REGARDING USE OF CONTRACT FUNDS FOR LOBBYING

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts which exceed \$100,000 (49 CFR 20).

- 1. The prospective participant certifies, by signing and submitting this bid or proposal, to the best of his or her knowledge and belief, that:
- a. No Federal appropriated funds have been paid or will be paid, by or on behalf of the undersigned, to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of

Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with the awarding of any Federal contract, the making of any Federal grant, the making of any Federal loan, the entering into of any cooperative agreement, and the extension, continuation, renewal, amendment, or modification of any Federal contract, grant, loan, or cooperative agreement.

- b. If any funds other than Federal appropriated funds have been paid or will be paid to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with this Federal contract, grant, loan, or cooperative agreement, the undersigned shall complete and submit Standard Form-LLL, "Disclosure Form to Report Lobbying," in accordance with its instructions.
- 2. This certification is a material representation of fact upon which reliance was placed when this transaction was made or entered into. Submission of this certification is a prerequisite for making or entering into this transaction imposed by 31 U.S.C. 1352. Any person who fails to file the required certification shall be subject to a civil penalty of not less than \$10,000 and not more than \$100,000 for each such failure.
- 3. The prospective participant also agrees by submitting its bid or proposal that the participant shall require that the language of this certification be included in all lower tier subcontracts, which exceed \$100,000 and that all such recipients shall certify and disclose accordingly.

#### ATTACHMENT A - EMPLOYMENT AND MATERIALS PREFERENCE FOR APPALACHIAN DEVELOPMENT HIGHWAY SYSTEM OR APPALACHIAN LOCAL ACCESS ROAD CONTRACTS

This provision is applicable to all Federal-aid projects funded under the Appalachian Regional Development Act of 1965.

- 1. During the performance of this contract, the contractor undertaking to do work which is, or reasonably may be, done as on-site work, shall give preference to qualified persons who regularly reside in the labor area as designated by the DOL wherein the contract work is situated, or the subregion, or the Appalachian counties of the State wherein the contract work is situated, except:
- a. To the extent that qualified persons regularly residing in the area are not available.
- b. For the reasonable needs of the contractor to employ supervisory or specially experienced personnel necessary to assure an efficient execution of the contract work.
- c. For the obligation of the contractor to offer employment to present or former employees as the result of a lawful collective bargaining contract, provided that the number of nonresident persons employed under this subparagraph (1c) shall not exceed 20 percent of the total number of employees employed by the contractor on the contract work, except as provided in subparagraph (4) below.
- 2. The contractor shall place a job order with the State Employment Service indicating (a) the classifications of the laborers, mechanics and other employees required to perform the contract work, (b) the number of employees required in each classification, (c) the date on which the participant estimates such employees will be required, and (d) any other pertinent information required by the State Employment Service to complete the job order form. The job order may be placed with the State Employment Service in writing or by telephone. If during the course of the contract work, the information submitted by the contractor in the original job order is substantially modified, the participant shall promptly notify the State Employment Service.
- 3. The contractor shall give full consideration to all qualified job applicants referred to him by the State Employment Service. The contractor is not required to grant employment to any job applicants who, in his opinion, are not qualified to perform the classification of work required.
- 4. If, within one week following the placing of a job order by the contractor with the State Employment Service, the State Employment Service is unable to refer any qualified job applicants to the contractor, or less than the number requested, the State Employment Service will forward a certificate to the contractor indicating the unavailability of applicants. Such certificate shall be made a part of the contractor's permanent project records. Upon receipt of this certificate, the contractor may employ persons who do not normally reside in the labor area to fill positions covered by the certificate, notwithstanding the provisions of subparagraph (1c) above.
- The provisions of 23 CFR 633.207(e) allow the contracting agency to provide a contractual preference for the use of mineral resource materials native to the Appalachian region.
- 6. The contractor shall include the provisions of Sections 1 through 4 of this Attachment A in every subcontract for work which is, or reasonably may be, done as on-site work.

### Contract Provision - Cargo Preference Requirements

In accordance with Title 46 CFR § 381.7 (b), the contractor agrees—

- "(1) To utilize privately owned United States-flag commercial vessels to ship at least 50 percent of the gross tonnage (computed separately for dry bulk carriers, dry cargo liners, and tankers) involved, whenever shipping any equipment, material, or commodities pursuant to this contract, to the extent such vessels are available at fair and reasonable rates for United States-flag commercial vessels.
- (2) To furnish within 20 days following the date of loading for shipments originating within the United States or within 30 working days following the date of loading for shipments originating outside the United States, a legible copy of a rated, 'on-board' commercial ocean bill-of-lading in English for each shipment of cargo described in paragraph (b) (1) of this section to both the Contracting Officer (through the prime contractor in the case of subcontractor bills-of-lading) and to the Division of National Cargo, Office of Market Development, Maritime Administration, Washington, DC 20590.
- (3) To insert the substance of the provisions of this clause in all subcontracts issued pursuant to this contract."

Provisions (1) and (2) apply to materials or equipment that are acquired solely for the project. The two provisions do not apply to goods or materials that come into inventories independent of the project, such as shipments of Portland cement, asphalt cement, or aggregates, when industry suppliers and contractors use these materials to replenish existing inventories.

# MINIMUM WAGES FOR FEDERAL AND FEDERALLY ASSISTED CONSTRUCTION CONTRACTS

This project is funded, in part, with Federal-aid funds and, as such, is subject to the provisions of the Davis-Bacon Act of March 3, 1931, as amended (46 Sta. 1494, as amended, 40 U.S.C. 276a) and of other Federal statutes referred to in a 29 CFR Part 1, Appendix A, as well as such additional statutes as may from time to time be enacted containing provisions for the payment of wages determined to be prevailing by the Secretary of Labor in accordance with the Davis-Bacon Act and pursuant to the provisions of 29 CFR Part 1. The prevailing rates and fringe benefits shown in the General Wage Determination Decisions issued by the U.S. Department of Labor shall, in accordance with the provisions of the foregoing statutes, constitute the minimum wages payable on Federal and federally assisted construction projects to laborers and mechanics of the specified classes engaged on contract work of the character and in the localities described therein.

General Wage Determination Decisions, modifications and supersedes decisions thereto are to be used in accordance with the provisions of 29 CFR Parts 1 and 5. Accordingly, the applicable decision, together with any modifications issued, must be made a part of every contract for performance of the described work within the geographic area indicated as required by an applicable DBRA Federal prevailing wage law and 29 CFR Part 5. The wage rates and fringe benefits contained in the General Wage Determination Decision shall be the minimum paid by contractors and subcontractors to laborers and mechanics.

Art. 561.01

#### Water Main

#### SECTION 561. WATER MAIN

561.01 Description. This work shall consist of constructing a water main.

561.02 Materials. Materials shall be as shown in the contract.

## **CONSTRUCTION REQUIREMENTS**

561.03 General. The construction of water mains, including protection from sewers, pressure testing, and disinfection, shall be according to the "Standard Specifications for Water & Sewer Main Construction in Illinois", except as follows.

- (a) Excavation and Foundation. This work shall be according to the applicable requirements of Article 550,04.
- (b) Backfilling. This work shall be according to Article 550.07, except backfilling shall not be done in freezing weather nor made with frozen material.

Backfilling around joints shall not be performed until the pressure testing has been completed.

561.04 Method of Measurement. This work will be measured for payment in place in feet (meters). The length measured will include stops, fittings, and valves.

Excavation in rock will be measured for payment according to Article 502.12.

Trench backfill will be measured for payment according to Article 208.03.

561.05 Basis of Payment. This work will be paid for at the contract unit price per foot (meter) for WATER MAIN, of the diameter specified.

Excavation in rock will be paid for according to Article 502.13.

Trench backfill will be paid for according to Article 208.04.

### SECTION 562. WATER SERVICE LINE -

562.01 Description. This work shall consist of constructing a water service line.

562.02 Materials. Materials shall be as shown in the contract.

#### CONSTRUCTION REQUIREMENTS

562.03 General. Work shall be performed according to the Illinois Plumbing Code or local codes where applicable, except as follows. Adjusting Sanitary Sewers and Water Service Lines A

Art. 563.04

Any excavation required shall be only sufficient to install the water service line. Surplus material shall be disposed of according to Article 202.03.

The applicable requirements of Article 550.07 shall govern the backfilling, except that backfilling shall not be done in freezing weather nor made with frozen material.

562.04 Method of Measurement. This work will be measured for payment in place in feet (meters). The length measured will include stops, fittings, and valves.

Excavation in rock will be measured for payment according to Article 502.12.

Trench backfill will be measured for payment according to Article 208.03.

562.05 Basis of Payment. This work will be paid for at the contract unit price per foot (meter) for WATER SERVICE LINE, of the internal diameter specified.

Excavation in rock will be paid for according to Article 502.13.

Trench backfill will be paid for according to Article 208.04.

## SECTION 563. ADJUSTING SANITARY SEWERS AND WATER SERVICE LINES

- 563.01 Description. This work shall consist of adjusting sanitary sewers and water service lines.
- 563.02 Materials. Materials shall be as shown in the contract. Materials for replacement shall be new and of the same kind as, or equal to, the material being replaced.

## CONSTRUCTION REQUIREMENTS

563.03 General. When a Sanitary District, Municipality, or Water District has jurisdiction of a sanitary sewer or water service line, the work shall be performed as prescribed by the Sanitary District, Municipality, or Water District and shall meet the approval of its Engineer.

Materials suitable for reuse in the opinion of the Engineer shall be carefully removed to prevent damage. Such materials damaged by the Contractor shall be replaced. All material removed and not reused shall become the property of the Contractor.

Surplus material shall be disposed of according to Article 202.03.

563.04 Adjusting Sanitary Sewers. Adjustment of sanitary sewers shall be according to the "Standard Specifications for Water and Sewer Main Construction in Illinois". The applicable requirements of Article 550.07 shall govern the backfilling, except that backfilling shall not be done in freezing weather nor made with frozen material.

Art. 563.05 Adjusting Sanitary Sewers and Water Service Lines

563.05 Adjusting Water Service Lines. The work necessary to adjust water service lines shall be performed according to Article 562.03.

Any water service line, other than copper, which is or will be under a base or surface course and which requires adjustment, shall be replaced with copper pipe according to the requirements of Article 1006.33.

563.06 Method of Measurement. This work will be measured for payment in place in feet (meters). The length measured will include stops, fittings, and valves.

Excavation in rock will be measured for payment according to Article 502.12.

Trench backfill will be measured for payment according to Article 208.03.

563.07 Basis of Payment. This work will be paid for at the contract unit price per foot (meter) for ADJUSTING SANITARY SEWERS, (8 IN. (200 MM) DIAMETER OR LESS); ADJUSTING SANITARY SEWERS, (OVER 8 IN. (200 MM) DIAMETER); and ADJUSTING WATER SERVICE LINES.

Excavation in rock will be paid for according to Article 502.13.

Trench Backfill will be paid for according to Article 208.04.

The furnishing of materials, except for replacement of materials damaged by the Contractor, will be paid for according to Article 109.04.

#### SECTION 564. MOVING FIRE HYDRANTS

**564.01 Description.** This work shall consist of moving and adjusting existing fire hydrants, with auxiliary valves when applicable, which interfere with the construction of the proposed improvement.

564.02 Materials. Materials shall be as shown in the contract. Materials for replacement shall be new and of the same kind as, or equal to, the material being replaced.

#### CONSTRUCTION REQUIREMENTS

**564.03** General. The work shall be performed in a manner approved by the Engineer of the Municipality or the Water District.

Fire Hydrants shall be set on a firm foundation and shall be thrust blocked. Thrust blocking shall consist of Class SI concrete cast against the fittings and the undisturbed earth on the side where the thrust is expected to occur. A minimum of 1/4 cu yd (0.2 cu m) of concrete shall be used for the thrust block. The dimensions of the thrust block shall be determined by the Engineer. Blocking shall be placed such that the pipe, fittings and joints shall be accessible for future repair.

Upon completion of relocating or adjusting the fire hydrant, it shall be tested and disinfected according to Article 561.03.

1006.30 Aluminum for Railings. Aluminum for railings shall be as follows.

- (a) Cast Aluminum Railing Posts. Cast aluminum railing posts shall be according to ASTM B 108, Alloy A444.0-T4 for permanent mold castings; ASTM B 26, Alloy 520.0-T4 for sand castings; or ASTM B 618, Alloy 520.0-T4 for investment castings. All castings shall have a radiographic discontinuity level according to Grade C, 1/4 in. (6 mm) section thickness.
- (b) Aluminum Alloy Extruded Rail. Aluminum alloy extruded rail shall be according to ASTM B 221 (B 221M), Alloy 6061-T6 with a minimum yield of 35,000 psi (240,000 kPa), a minimum tensile strength of 38,000 psi (262,000 kPa), and an elongation of ten percent in 2 in. (50 mm).

1006.31 Stainless Steel Hardware. Stainless steel hardware shall be as follows.

- (a) Stainless Steel Machine Bolts or Cap Screws. Stainless steel nuts, washers, lock washers, machine bolts, or cap screws shall be according to the requirements of Article 1006.29(d).
- (b) Stainless Steel Bars. Stainless steel bars shall be according to the requirements of ASTM A 276, Type No. 302 or 304, Condition B. Threads, when required, shall be Class 2B.

1006.32 Stud Shear Connectors. Stud shear connectors shall be according to the requirements of AASHTO M 169 cold drawn bars, Grades 1015, 1018, or 1020, either semi- or fully-killed. Welding and workmanship shall be according to the requirements of the BWC.

1006.33 Seamless Copper Water Tube. Seamless copper water tube shall be according to the requirements of ASTM B 88 (B 88M), Type K, except that the tolerance for wall thickness and weight/foot (mass/meter) shall be increased by 50 percent.

1006.34 Gälvanized Steel for Railings. Galvanized steel for railing shall be according to the following.

- (a) Steel Posts for Railings. Steel posts shall be according to the requirements of AASHTO M 270, Grade 50, and shall be galvanized according to AASHTO M 111.
- (b) Tubular Steel Rail for Railings. Tubular steel rail shall be according to the requirements of ASTM A 500, Grade B, and shall be galvanized according to AASHTO M 111.

Tubular steel from all heats supplied shall be tested for impact toughness according to ASTM E 23, "Charpy V-Notch (CVN) Impact Testing of Metallic Materials". The CVN impact requirements shall be 15 ft lb (20 J) at 0 °F (-18 °C). For each heat supplied, the manufacturer shall furnish one 24 in. (600 mm) specimen, marked with its heat number, for impact testing.

\*(

(c

(ď)